



Webster Combustion Technology
619 Industrial Road, Winfield, KS 67156

Installation, Startup, Operation and Maintenance Manual

Model HDRMB Burner

Ultra Low NOx Burner



Manual Part No. 950087

www.webstercombustion.com

September, 2014

© 2014 All Rights Reserved

SAFETY PRECAUTIONS

Good safety practices must be used when working on burner equipment. The potential energy in the electrical supply, fuel and related equipment must be handled with extreme care to prevent equipment failures, injuries and potential death.

Throughout this manual, the following symbols are used to identify potential problems.

WARNING

This indicates a potential hazardous situation, which if not avoided, could result in personal injury or death.

CAUTION

This indicates a potentially hazardous situation, which if not avoided, could result in damage to the equipment.

The following general safety precautions apply to all equipment work.

WARNING

IF YOU SMELL GAS, OPEN WINDOW, EXTINGUISH ANY OPEN FLAMES, STAY AWAY FROM ELECTRICAL SWITCHES, EVACUATE THE BUILDING AND IMMEDIATELY CALL THE GAS COMPANY.

IN ACCORDANCE WITH OSHA STANDARDS, ALL EQUIPMENT, MACHINES AND PROCESSES SHALL BE LOCKED OUT PRIOR TO SERVICING.

IF THIS EQUIPMENT IS NOT INSTALLED, OPERATED AND MAINTAINED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS, THIS PRODUCT COULD EXPOSE YOU TO SUBSTANCES IN FUEL OR FROM FUEL COMBUSTION WHICH CAN CAUSE DEATH OR SERIOUS ILLNESS AND WHICH ARE KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER, BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.

IMPROPER SERVICING OF THIS EQUIPMENT MAY CREATE A POTENTIAL HAZARD TO EQUIPMENT AND OPERATORS.

SERVICING MUST BE DONE BY A FULLY TRAINED AND QUALIFIED PERSONNEL.

BEFORE DISCONNECTING OR OPENING UP A FUEL LINE AND BEFORE CLEANING OR REPLACING PARTS OF ANY KIND,

- **TURN OFF THE MAIN MANUAL FUEL SHUTOFF VALVES INCLUDING THE PILOT COCK, IF APPLICABLE. IF A MULTIPLE FUEL BURNER, SHUT OFF ALL FUELS.**
- **TURN OFF ALL ELECTRICAL DISCONNECTS TO THE BURNER AND ANY OTHER EQUIPMENT OR SYSTEMS ELECTRICALLY INTERLOCKED WITH THE BURNER.**

Service Organization Information:

Company Name _____

Address _____

Phone Number _____

Date of Startup

Lead Technician

Table of Contents

A. General	Page 4		4. Gas Fuel System	Page 47
1. Nameplate Information	Page 4		5. Oil Fuel System	Page 47
2. Ratings	Page 4		6. FGR Systems	Page 47
3. Product Offering	Page 4		7. Combustion Air Fan	Page 47
4. Your Complete Manual	Page 6		8. Burner Refractory and Internals	Page 47
5. Service and Parts	Page 6		9. Inspection and Maintenance Schedule	Page 48
			10. Combustion Chart	Page 49
B. Components	Page 8			
1. General	Page 10		H. Trouble Shooting	Page 50
2. Combustion Air	Page 10			
3. Burner Drawer	Page 11			
3.5 Refractory Front Plate	Page 12			
4. Gas Fuel Components	Page 12			
5. Oil Fuel Components	Page 13			
6. Flue Gas Recirculation (FGR).....	Page 15			
7. Fuel-Air-Ratio Controls	Page 16			
8. Electrical Controls	Page 17			
C. Installation	Page 18			
1. General Considerations	Page 18			
2. Refractory Frontplate	Page 19			
3. Burner Mounting	Page 19			
4. Gas Piping	Page 20			
5. Gas Pilot	Page 21			
6. General Oil Piping	Page 21			
7. Air Atomized #2 Oil	Page 24			
8. FGR System	Page 24			
9. Draft and Stacks	Page 27			
10. Electrical System	Page 28			
D. Fuel and Control Systems	Page 29			
1. Gas Systems	Page 29			
2. Gas Pilot	Page 30			
3. Air Atomized #2 Oil	Page 31			
4. Fuel-Air-Ratio Controls	Page 31			
5. Electrical Controls	Page 31			
6. Operating and Modulating Controls	Page 31			
7. Flame Safeguards	Page 32			
E. Preliminary Adjustments	Page 34			
1. Visual Inspection	Page 34			
2. Motor Rotation	Page 34			
3. Oil Gun Setup	Page 34			
4. Fuel, FGR and Air Control	Page 34			
5. Fuel Cam Adjustments	Page 35			
6. Air Damper Adjustments	Page 35			
7. Pilot and Scanner Setup	Page 36			
8. Gas System Adjustments	Page 36			
9. Oil System Adjustments	Page 37			
10. Air Proving Switch	Page 37			
11. Operating and Modulating Controls	Page 37			
F. Startup and Operating Adjustments	Page 38			
1. Pre-Start Check List	Page 38			
2. Linkage Adjustments	Page 38			
3. Fuel Cam Adjustments	Page 39			
4. FGR Adjustments	Page 40			
5. Burner Drawer Adjustments	Page 40			
6. Single Fuel Setups	Page 40			
7. Combination Gas and Air Atomized #2 Oil	Page 40			
8. Gas Setup	Page 41			
9. Air Atomized #2 Oil Setup	Page 42			
10. Operating Control Adjustments	Page 43			
11. Limit Tests	Page 44			
12. Pilot Test.....	Page 44			
13. Burner Shutdown	Page 44			
14. Restarting After Extended Shutdown	Page 44			
G. Maintenance	Page 46			
1. General	Page 46			
2. Physical Inspection	Page 46			
3. Fuel-Air-Ratio Controls	Page 46			

A. GENERAL

1. Nameplate Information
2. Ratings
3. Product Offering
4. Your Complete Manual
5. Service and Parts

This manual covers the Model HDRMB burner offered by Webster Engineering & Manufacturing Co., LLC. This burner is intended for commercial and industrial applications for Firetube and Watertube type boilers (Firetube, Flextube, "D" Type, etc.). They can fire gas, oil or combinations of gas and oil.

READ AND SAVE THESE INSTRUCTIONS FOR REFERENCE

WARNING

DO NOT ATTEMPT TO START, ADJUST OR MAINTAIN THIS BURNER WITHOUT PROPER TRAINING OR EXPERIENCE. FAILURE TO USE KNOWLEDGE-ABLE TECHNICIANS CAN RESULT IN EQUIPMENT DAMAGE, PERSONAL INJURY OR DEATH.

The startup and maintenance of the HDRMB burner requires the skills of an experienced and properly trained burner technician. Inexperienced individuals should not attempt to start or adjust this burner.

THE INSTALLATION OF THE EQUIPMENT SHALL BE IN ACCORDANCE WITH THE REGULATION OF AUTHORITIES HAVING JURISDICTION, INCLUDING THE NATIONAL ELECTRICAL CODE, AND ALL LOCAL CODES.

Every attempt has been made to accurately reflect the burner construction, however, product upgrades and special order requirements may result in differences between the content of this manual and the actual equipment. These special components will be described in the infor-

mation provided with the burner and should be used as the controlling document.

NOTE: This manual must be readily available to all operators and maintained in legible condition.

1. Nameplate Information

Each burner has a nameplate with important job details, similar to the nameplate shown in Figure A-1.

The serial number represents the unique number for that burner and is a critical number that will be needed for any communications with Webster Engineering.

The input rates define the maximum and minimum inputs for that burner, given in MBH for gas and GPH for oil. Air atomized burners (Figure A-1) show both the oil pressure and air pressure. For gas firing, the gas manifold pressure is given in "in wc" which is inches of water column.

The electrical ratings of the burner are given, with the voltage, current load, frequency and phase (this will either be single or 3-phase). For motors, the motor HP is listed.

2. Ratings

The ratings for each specific burner are given on the nameplate (Figure A-1). The general burner ratings are given in Figure A-3. The maximum and minimum inputs are given, based on the type of fuel. Other conditions, like the supply gas pressure or the combination of fuels, emission requirements and control systems may limit the turndown.

Turndown is defined as the ratio of the maximum input to the minimum input. For example, a burner with a maximum input of 120 GPH and a minimum input of 12 GPH has a 10:1 turndown.

3. Product Offering

The burner can fire natural gas, #2 oil or combination of natural gas and #2 oil.

DO NOT USE GASOLINE, CRANKCASE OIL OR ANY OIL CONTAINING GASOLINE.

This burner is a low emission burner, and can operate at NOx levels of 9, 12 or 15ppm. It is also capable of low CO emissions.

Figure A-2 lists the common variations and options available on this product.


The minimum furnace conditions for this burner will vary with performance requirements, and cannot be stated in simple dimensions. Each job is analyzed to provide the correct burner design and compares that to the furnace and operating conditions. The figure in A-3 show typical minimum values for furnace sizes. In addition, the volume heat release rates would be limited to about 185,000 btu/ft³ on firetubes and 85,000 btu/ft³ on watertube boilers.

Figure A-1 Nameplate

MODEL NUMBER		SERIAL NUMBER	
HDRMBC-400B-5V 150 RM7800L-M.25 VGD		U73586A-02	
JOB LOCATION		DATE MFG	
Georgia		30 - Nov - 04	
GAS INPUT RATING		OIL INPUT RATING	
	MBTU/HR	IN.WC	GPH
MAXIMUM	16738	8.4	119.6
MINIMUM	2790	0.15	23
		PSI	
MAXIMUM		28/31	
MINIMUM		12/21	
FUEL		#2 OIL / AIR	
NATURAL GAS		#2 OIL / AIR	
	VOLTS	AMPS	HERTZ
CONTROL CIRCUIT	115	5	60
BURNER MOTOR	460	20.1	60
OIL PUMP MOTOR	460	2.9	60
			PHASE
CONTROL CIRCUIT			1
BURNER MOTOR			3
OIL PUMP MOTOR			3
			HP
BURNER MOTOR			15
OIL PUMP MOTOR			1.5

MODEL HDRMB BURNER MODEL CONFIGURATION FIGURE A-2

HDRMB C - 500 - 19 - 9 SR - 600

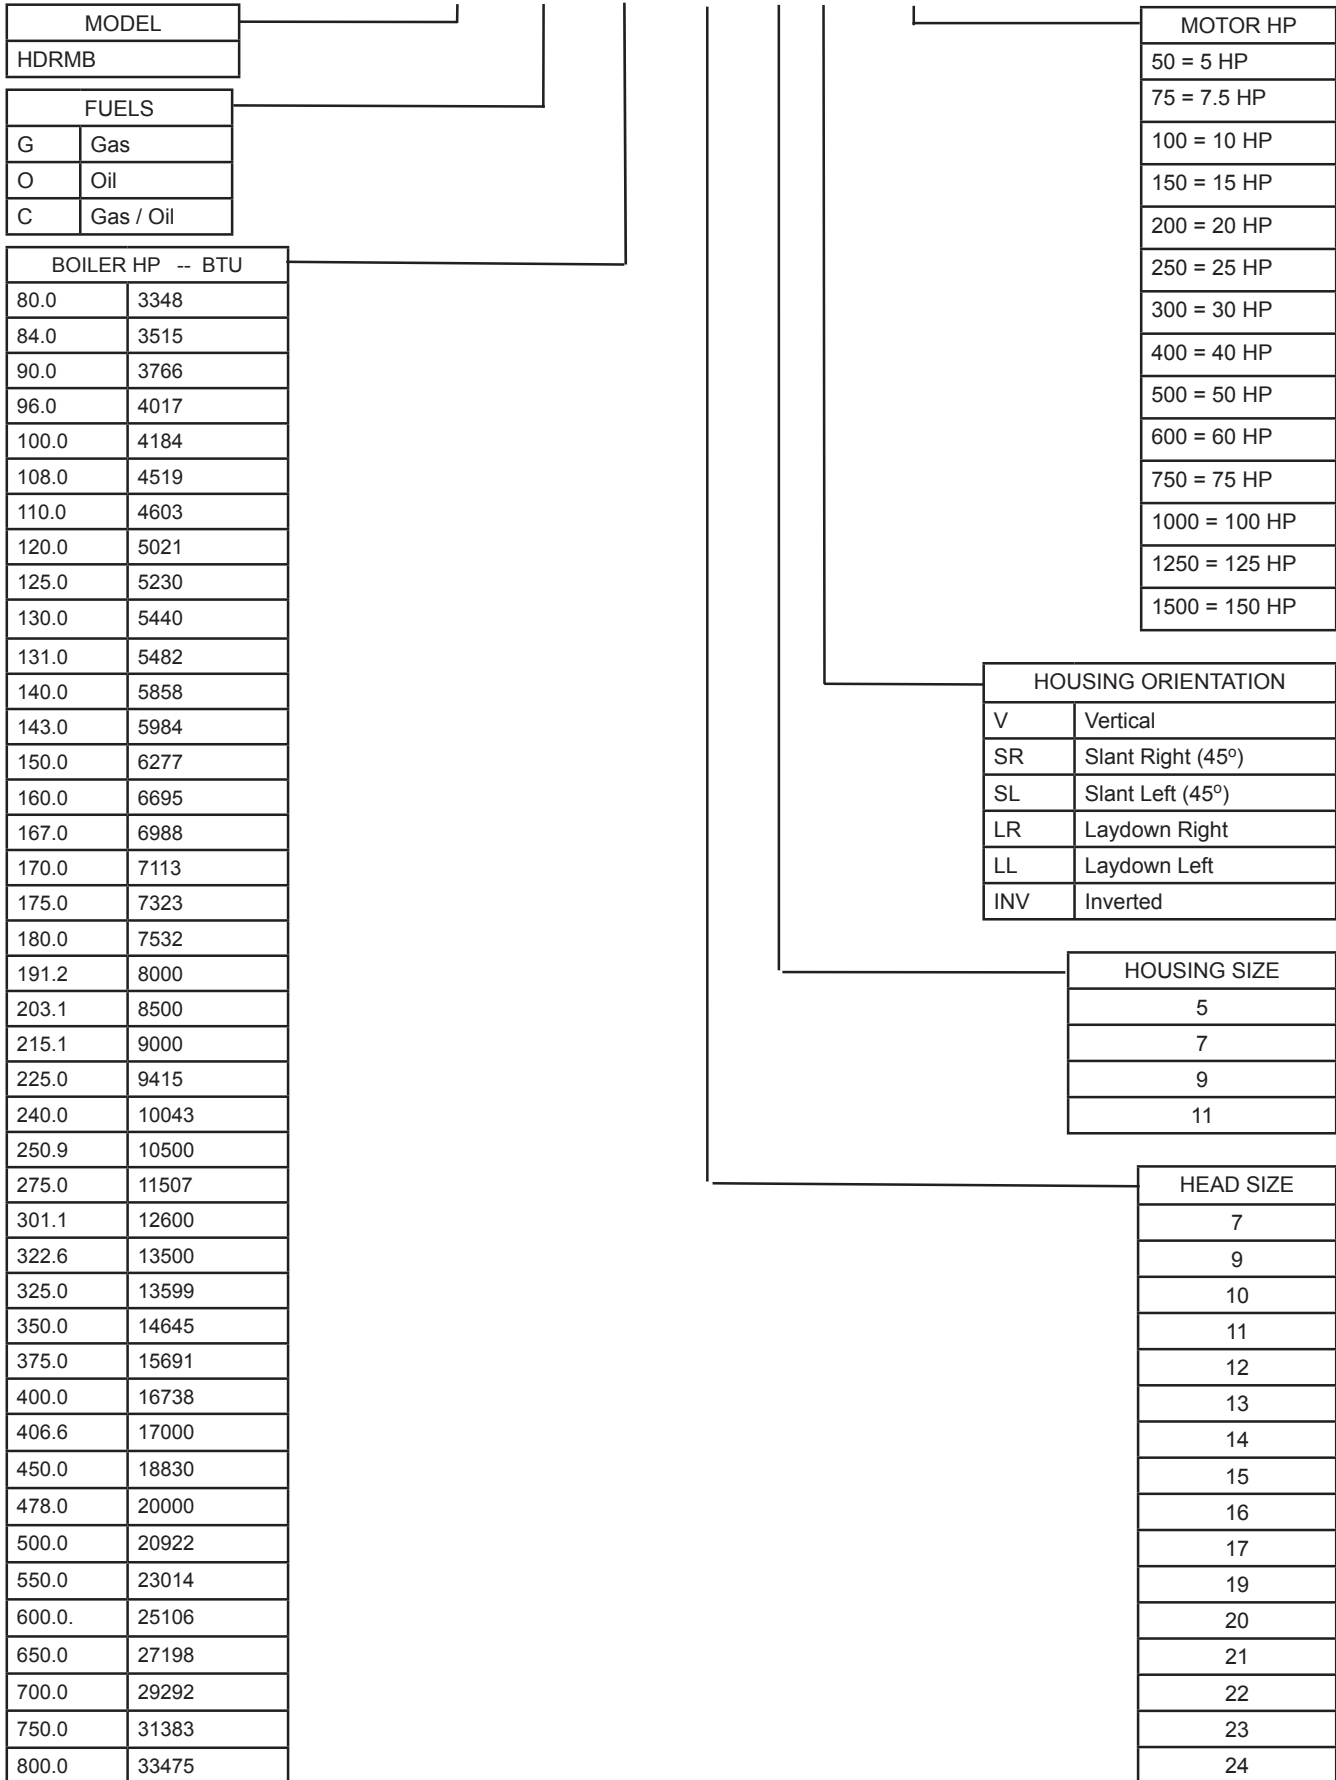

4. Your Complete Manual

In addition to this manual, there are several other documents that should be considered as part of the complete manual for the burner. All of these documents are needed to support the installation and startup of the unit. These additional items include:

- a. The wiring diagram, which shows the limits and inter-connection of the burner and vessel controls.
- b. The gas and oil piping schematics, which show the components and their relative positions in the piping train.
- c. The unit material list which provides an overview of the burner requirements and a complete bill of material, including the part numbers and description for each item.
- d. The flame safeguard manual provides the operating sequence for the burner management system. This will

be a critical document for troubleshooting any future problems.

- e. Catalog cuts of the major components. These provide details on the installation, adjustment and maintenance of the components used on the burner.

5. Service, Parts and other Information

Service and parts are available from your local Webster Representative. For a list of Webster Representatives, please visit the Webster web site at:

www.webster-engineering.com or call 620-221-7464.

**Figure A-3
Typical Ratings for High Pressure Steam Firetube Boilers**

	BHP	Gas Input MBH		Oil Input GPH		Firetube Boiler, High Pressure Steam 9ppm NOx			
		MIN	MAX	MIN	MAX	FURNACE PRESS	HEAD DIA.	MOTOR HP	MIN FURN DIA.
HDRMB - 100-8-5-100	100	1046	4184	7.5	29.9	2.5	8.0	10.0	19.5
HDRMB - 125-9-5-150	125	1308	5230	9.3	37.4	2.6	9.0	15.0	21.0
HDRMB - 150-10-5-150	150	1569	6277	11.2	44.8	2.8	10.0	15.0	22.5
HDRMB - 200-11-7-100	200	2092	8369	14.9	59.8	3.0	11.0	20.0	25.0
HDRMB - 250-11-7-150	250	2615	10461	18.7	74.7	3.3	12.0	30.0	27.0
HDRMB - 300-13-7-150	300	3138	12553	22.4	89.7	3.5	14.0	30.0	29.0
HDRMB - 350-14-7-200	350	3661	14645	26.2	104.6	3.8	15.0	40.0	30.5
HDRMB - 400-15-7-200	400	4184	16738	29.9	119.5	4.0	16.0	40.0	32.0
HDRMB - 450-16-7-250	450	4707	18830	33.6	134.5	4.3	17.0	50.0	33.5
HDRMB - 500-16-7-250	500	5230	20922	37.4	149.4	4.5	18.0	50.0	35.0
HDRMB - 550-17-9-250	550	5754	23014	41.1	164.4	4.8	19.0	50.0	36.5
HDRMB - 600-18-9-300	600	6277	25106	44.8	179	5.0	20.0	50.0	38.0
HDRMB - 650-19-9-400	650	6800	27198	48.6	194	5.3	20.0	75.0	39.0
HDRMB - 700-20-9-400	700	7323	29291	52.3	209	5.5	21.0	75.0	40.0
HDRMB - 750-20-9-400	750	7846	31383	56.0	224	5.8	22.0	100.0	41.0
HBRMB - 800-21-9-500	800	8369	33475	59.8	239	6.0	23.0	100.0	42.0
HDRMB - 1000-23-11-1250	1000	10461	41844	74.7	299	7.0	25.0	125.0	46.0

**Figure A-4
Typical Ratings for Hot Water Flextube Boilers**

	BHP	Gas Input MBH		Oil Input GPH		Watertube Boiler, Hot Water 9ppm NOx				
		MIN	MAX	MIN	MAX	FURNACE PRESS	HEAD DIA.	MOTOR HP	MIN FURN WIDTH	MIN FURN HEIGHT
HDRMB - 100-7.5-50	100	1046	4184	7.5	29.9	0.8	7.0	5.0	26.6	25.0
HDRMB - 125-8.5-75	125	1308	5230	9.3	37.4	0.8	8.0	7.5	31.7	29.8
HDRMB - 150-9.5-75	150	1569	6277	11.2	44.8	0.9	9.0	7.5	35.9	33.8
HDRMB - 200-10-7-100	200	2092	8369	14.9	59.8	1.0	10.0	10.0	42.5	40.0

HDRMB - 250-11-7-150	250	2615	10461	18.7	74.7	1.1	11.0	15.0	47.6	44.8
HDRMB - 300-13-7-150	300	3138	12553	22.4	89.7	1.3	13.0	15.0	51.8	48.7
HDRMB - 350-14-7-200	350	3661	14645	26.2	104.6	1.4	14.0	20.0	55.3	52.1
HDRMB - 400-15-7-200	400	4184	16738	29.9	119.5	1.5	15.0	20.0	58.4	55.0
HDRMB - 450-16-7-250	450	4707	18830	33.6	134.5	1.6	15.0	25.0	61.1	57.5
HDRMB - 500-16-7-250	500	5230	20922	37.4	149.4	1.8	16.0	25.0	63.5	59.8
HDRMB - 550-17-9-250	550	5754	23014	41.1	164.4	1.9	17.0	25.0	65.7	61.8
HDRMB - 600-18-9-300	600	6277	25106	44.8	179	2.0	18.0	30.0	67.7	63.7
HDRMB - 650-19-9-400	650	6800	27198	48.6	194	2.1	19.0	40.0	69.5	65.4
HDRMB - 700-20-9-400	700	7323	29291	52.3	209	2.3	20.0	40.0	71.2	67.0
HDRMB - 750-20-9-400	750	7846	31383	56.0	224	2.4	20.0	40.0	72.8	68.5
HBRMB - 800-21-9-500	800	8369	33475	59.8	239	2.5	21.0	50.0	74.3	69.9
HDRMB - 1000-23-11-1250	1000	10461	41844	74.7	299	3.0	23.0	50.0	79.4	74.7


B. COMPONENT DESCRIPTIONS

1. General
2. Combustion Air
3. Burner Drawer
4. Gas Fuel Components

5. Oil Fuel Components
6. Flue Gas Recirculation (FGR)
7. Fuel-Air-Ratio Controls
8. Electrical Controls

This section describes the components of the HDRMB burner line and provides some details on their application and operation. Other sections of this manual provide a

more detailed review of how the components work as a system and explain the overall operation of the burner.

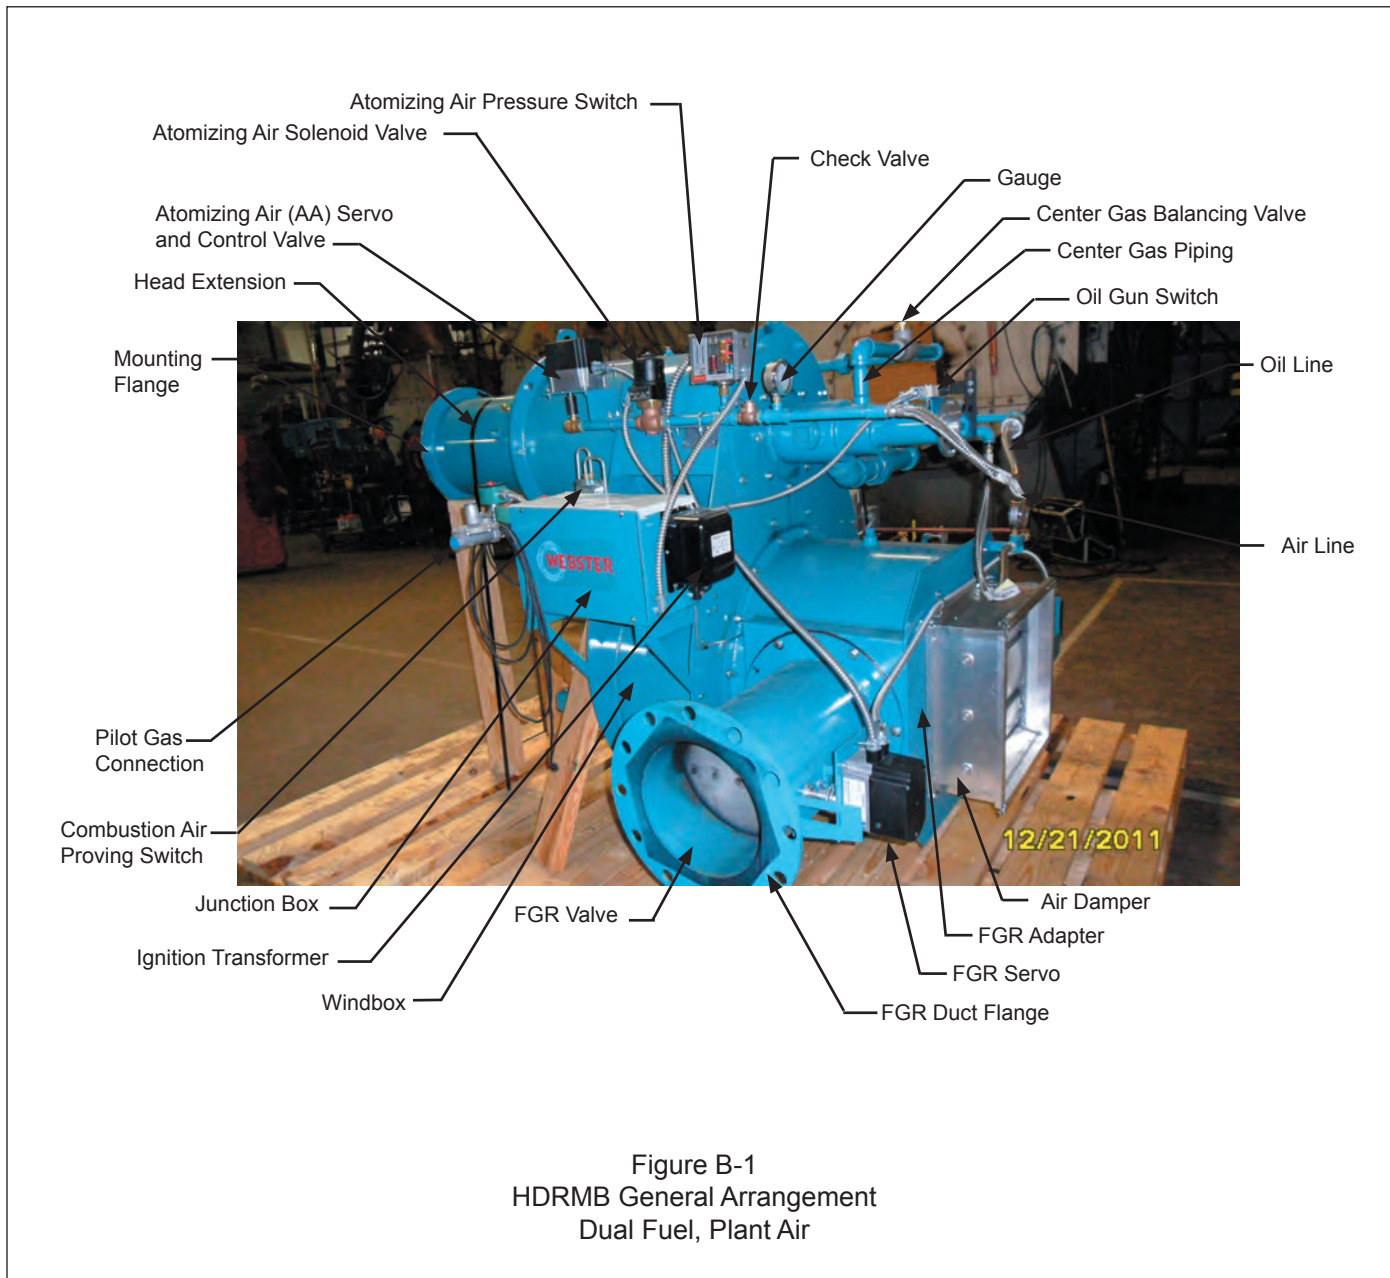

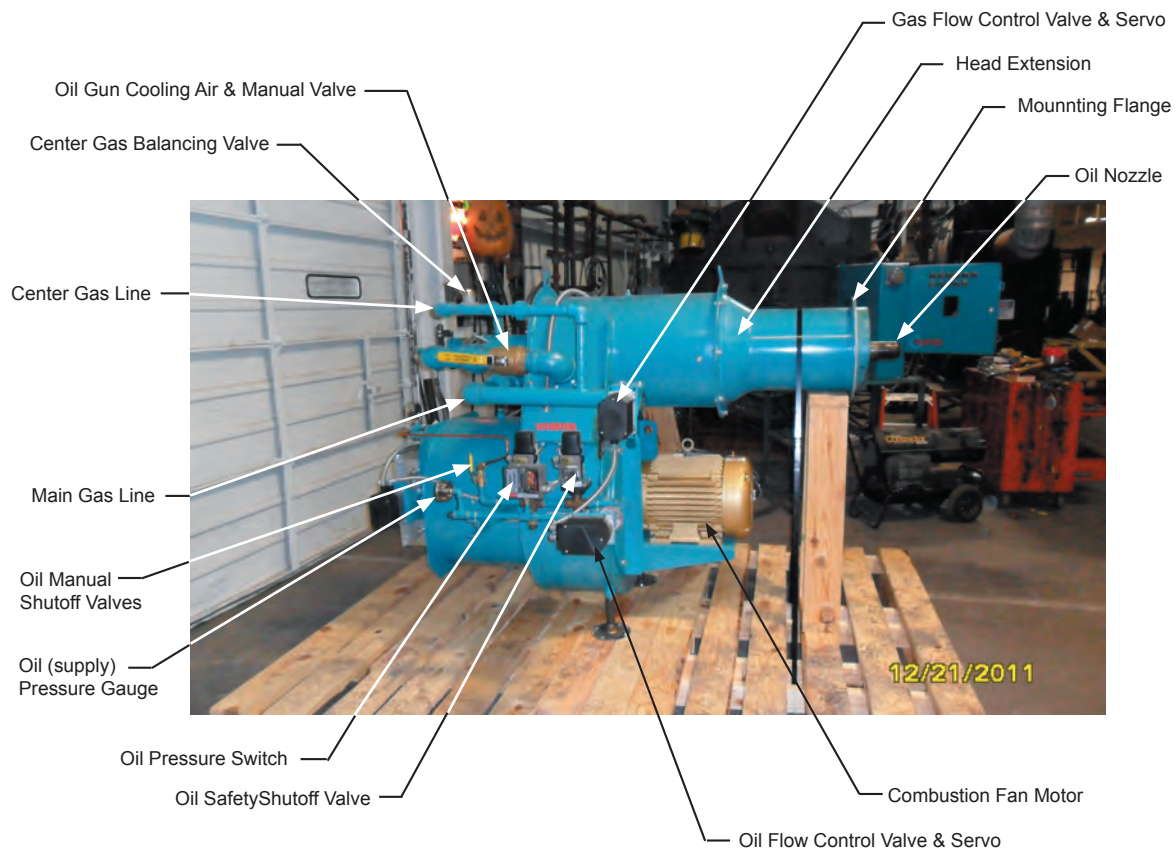


Figure B-2
HDRMB General Arrangement, Dual Fuel


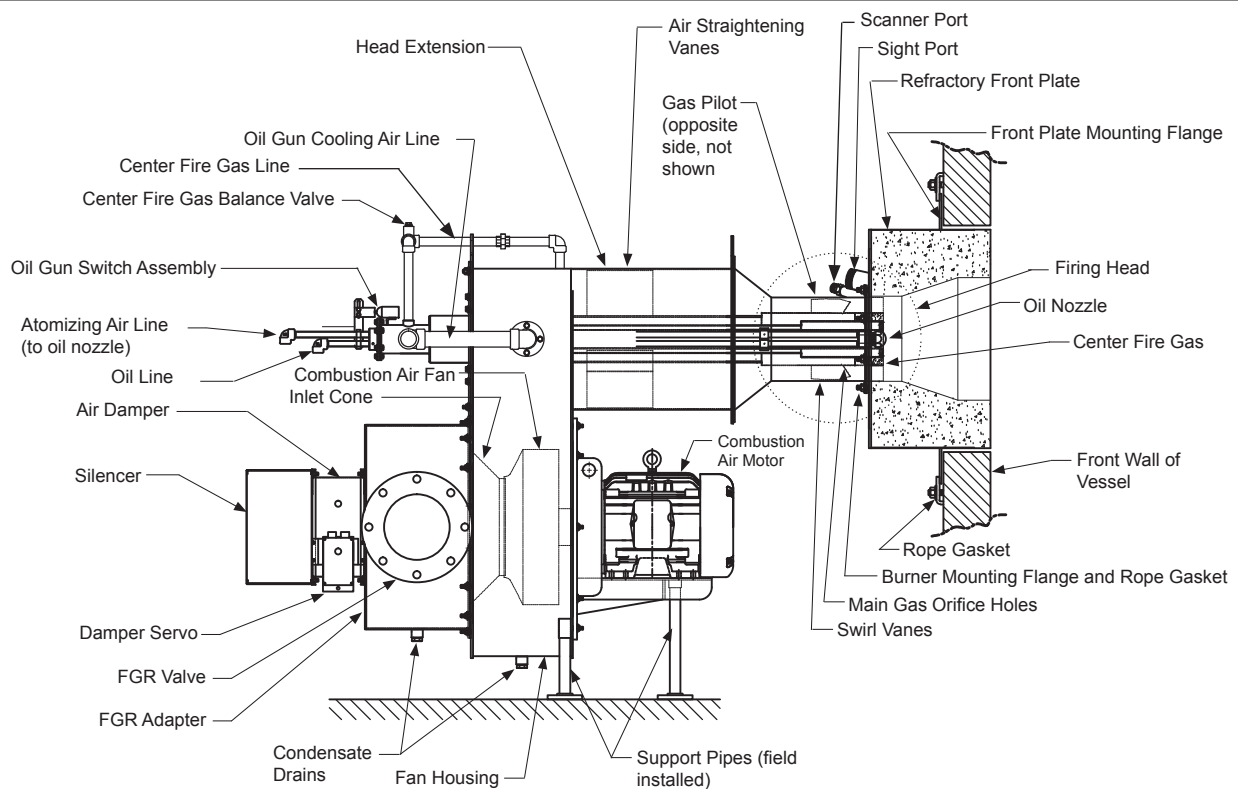


Figure B-3
HDRMB General Arrangement

Figure B4 not pictured

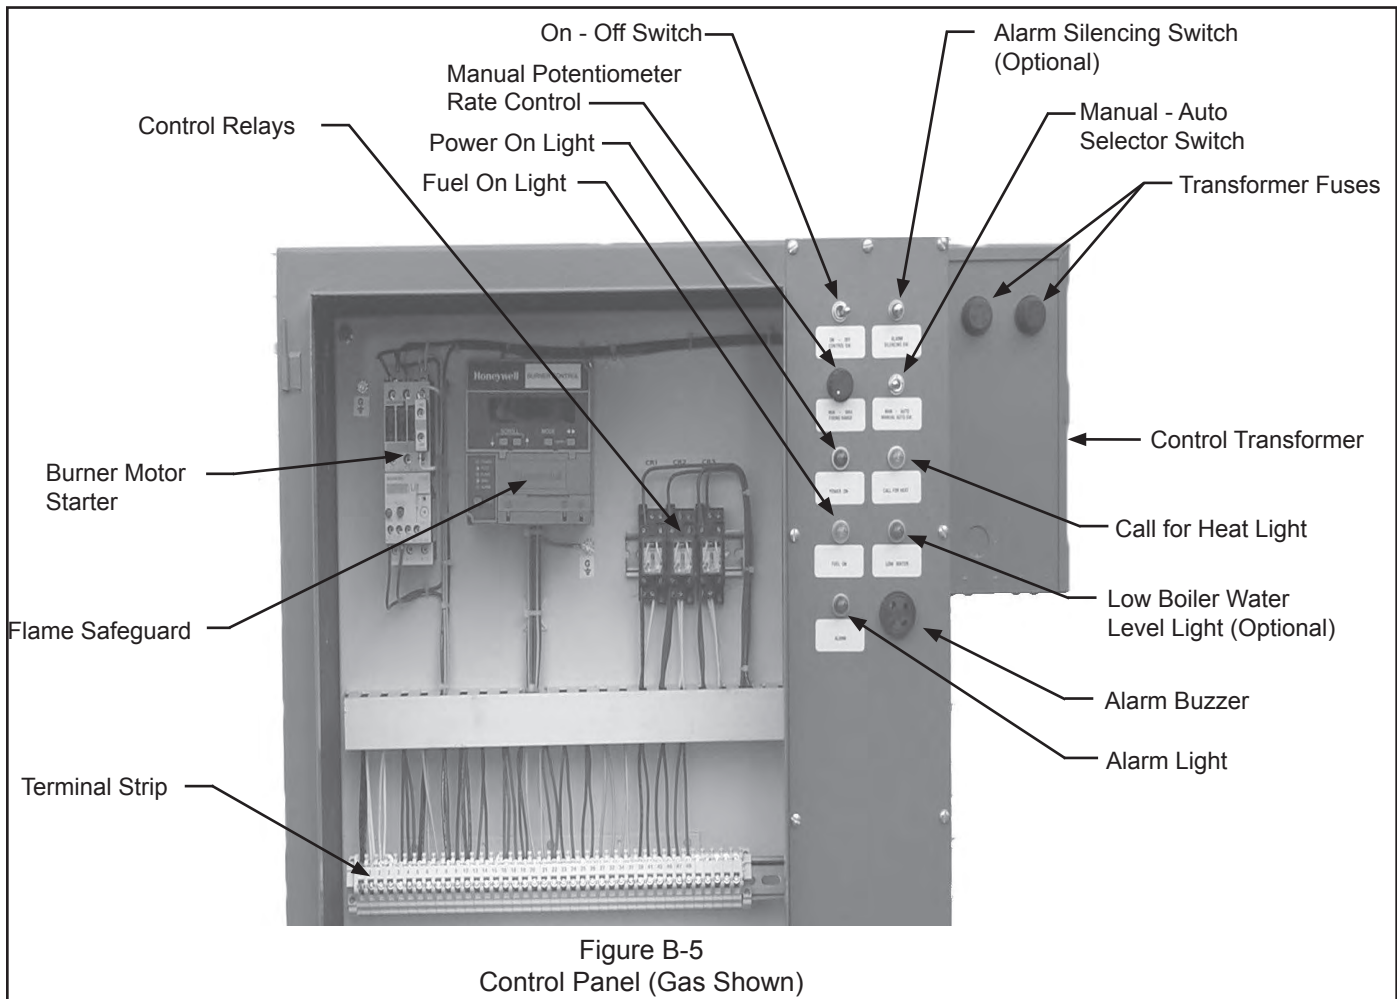

1. General

The HDRMB burner line is configured from a common group of components that may vary in size and style depending on the capacity, NO_x level, fuels and application. These common groups of components are described in this section, however the exact detail of any specific burner must be taken from the unit specific information provided with each burner. This would include the material list, wiring diagram, catalog cuts and fuel train drawings.

2. Combustion Air

Fan

A backward curved fan is used to supply the combustion air to burn the fuel. The fan also provides the recirculated flue gas. The fan diameter and width will vary to match the required combustion air flow rate, FGR rate, burner altitude and vessel backpressure.

An inlet cone (Figure B3) is used with the fan to provide a smooth air flow transition to the fan. Each fan has a matching inlet cone. In some cases, the inlet cone bolts directly to the housing and in other cases, it bolts to an adapter that bolts to the housing. The inlet cone should

extend into the fan inlet about 1/4 inch.

Fan and Motor Assembly

The combustion air fan and motor are assembled together on a motor support plate that attaches to the windbox. This assembly, as shown in the photo (Figure B-6), is built and balanced as a sub-assembly that can be removed for maintenance and repair.

The fan can have either a taper lock hub or the fan is machined to match the motor shaft diameter. Setscrews are used to lock the fan to the hub. The fan can be adjusted on the shaft to provide the correct overlap between the fan and inlet cone.

Several different motor styles can be used depending on the application. An Open-Drip-Proof style is most common and used in a typical enclosed, clean environment. A TEFC (Totally Enclosed Fan Cooled) would typically be used in a dirty or wet environment. Other styles are also available for special applications. The motor dimensions, including the shaft diameter can vary by motor type.

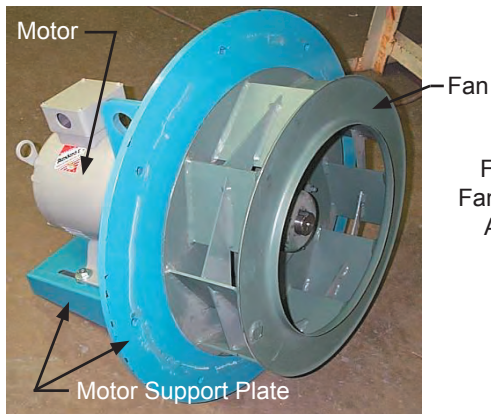


Figure B-6
Fan and Motor
Assembly

Windbox

The windbox is an enclosure that routes the combustion air from the fan to the firing head and provides the primary mechanical structure for all of the components of the burner. The combustion air fan and inlet cone are contained within the windbox. The firing head is connected by the head extension. The FGR adapter and air damper are also connected to the windbox, opposite the combustion air motor.

The windbox serves as the building block of the burner. It requires good structural support to the boiler and floor to handle the weight and movement of rotating components.

Head Extension

The head extension connects the firing head to the windbox. It also allows different combinations of firing heads to be used with different fan and windbox sizes.

Firing Head

The firing head is that area of the burner front where the combustion originates, just downstream of the swirl vanes and center gas ports, and at the entrance of the refractory. This is the same location if firing oil, where the flame will originate downstream of the oil nozzle. This is where the fuel and air are mixed and start burning.

Air Damper

The air damper regulates the flow of air to the burner.

On a single point positioning system (linkage), the damper shaft is connected by linkage to the jackshaft. On a parallel positioning system (linkageless), the shaft is directly coupled to the actuator for the air damper.

The air damper is connected to the FGR adapter plate, so that the flue gas can enter down-stream of the damper where there is a negative pressure. If an optional silencer were used, it would be mounted to the inlet of the air damper.

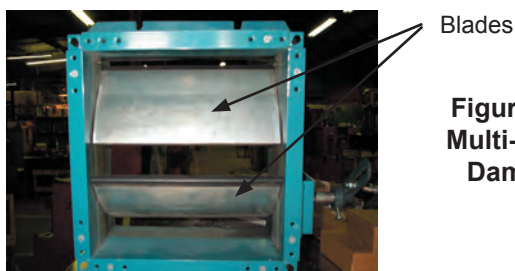


Figure B-8
Multi-blade
Damper

3. Burner Drawer

The burner drawer contains the gas manifold, swirl vanes and oil gun. These components are all attached to the backplate. The burner drawer slides through the windbox and head extension. It is attached to the burner by bolting the backplate to the windbox.

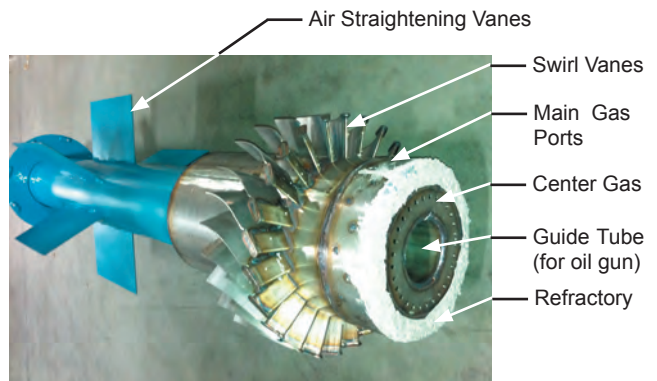


Figure B-9 Burner Drawer Assembly

The oil gun position can be adjusted (in and out) by sliding the gun tube through the backplate. Setscrews are used to lock these tubes into position. The oil gun can be removed for inspection or extended gas firing without removing the burner drawer.

The refractory front plate acts to shape the flame, protect the burner face from the flame temperatures and also contains the scanner, pilot and sight port. The firing head is designed to have as near perfect fuel and air mixing as possible, so these components are moved to a location where they do not disturb the fuel and air flows.

The refractory front plate is attached to the vessel, usually by bolts but sometimes by seal welding. If it is bolted, there must be a good seal between the vessel and front plate. The burner is bolted to the front plate, and it also must have a good seal. Webster recommends and supplies a fiberglass rope for this purpose, which should be used to cover the full width of the flange.

Gas Manifold

The gas manifold is built into the burner drawer, and provides the gas passage from the entry at the back of the burner drawer to the main gas and center gas ports at the front of the firing head. In a Firetube burner, the main gas ports are holes positioned radially just downstream of the swirl vanes (see Figure B-15). In a Watertube burner, the main gas ports are in a small tube at the end of the swirl vanes called riser tubes (see Figure B-15.1)

Swirl Vanes and main gas ports

The swirl vanes provide the “spin” of the combustion air used to improve the fuel and air mixing. All the combustion air passes through the swirl vanes. Just downstream of the swirl vanes are the main gas ports, where most of the natural gas enters the firing head for combustion. There are two different types of main gas ports. On Firetube boilers, the main gas ports are on the outer tube of the gas manifold, in a pattern of multiple rows and hole sizes. On

Watertube boilers, there is a riser tube at the end of the swirl vane which has a series of small holes for gas flow. In both cases, the design provides excellent mixing of the fuel and air, and a very stable flame front.

Center Gas

A small amount of gas is provided to the center gas ports, close to the flame front. This small amount of gas is used to improve the visibility of the flame with a small less turbulent mix at the base of the flame. The balancing valve can be adjusted to vary the flow of center gas, as a % of main gas flow.

3.5 Refractory Front Plate

The refractory front plate is used to connect the burner to the vessel, and provides both the mechanical support as well as the refractory shield for heat protection. The refractory has a special shape used to control the flame geometry. Gaskets must be applied to both the attachment to the vessel and the burner attachment to the refractory front plate. The HDRMB also has the scanner, pilot and view port in the refractory front plate, so there is more uniform mixing of the fuel and air.

Scanner

The scanner is mounted to a sight tube in the refractory front plate. It requires a cooling air line.

Pilot

The pilot is mounted in the refractory plate. Gas and air are piped into the pilot, and additional raw gas is piped into the pilot mounting tube to increase the flame size.

Mounting Flange

The primary support for the burner is the mounting flange on the head extension. This provides a clamping surface to attach the burner to the vessel. A fiberglass rope gasket (3/8" dia) is used to seal the mounting flange to the refractory front plate. The rope is wrapped around the flange several times to seal the full diameter and surface area of the flange.



Figure B-12 Pilot

Air Straightening Vanes

The air straightener (Figure B-9) consists of multiple plates in the burner drawer used to straighten the air before the swirl vanes.

4. Gas Fuel Components

Gas Train

The gas train contains the safety shut-off valves, manual shut-off valves, pressure switches and other components that may be required for the specific installation, available



Figure B-14.1 Center Gas Balancing Valve

gas pressure, insurance codes and local regulations (Figure D-1). The details of the gas train can vary greatly from burner to burner. Gas trains tend to be designed

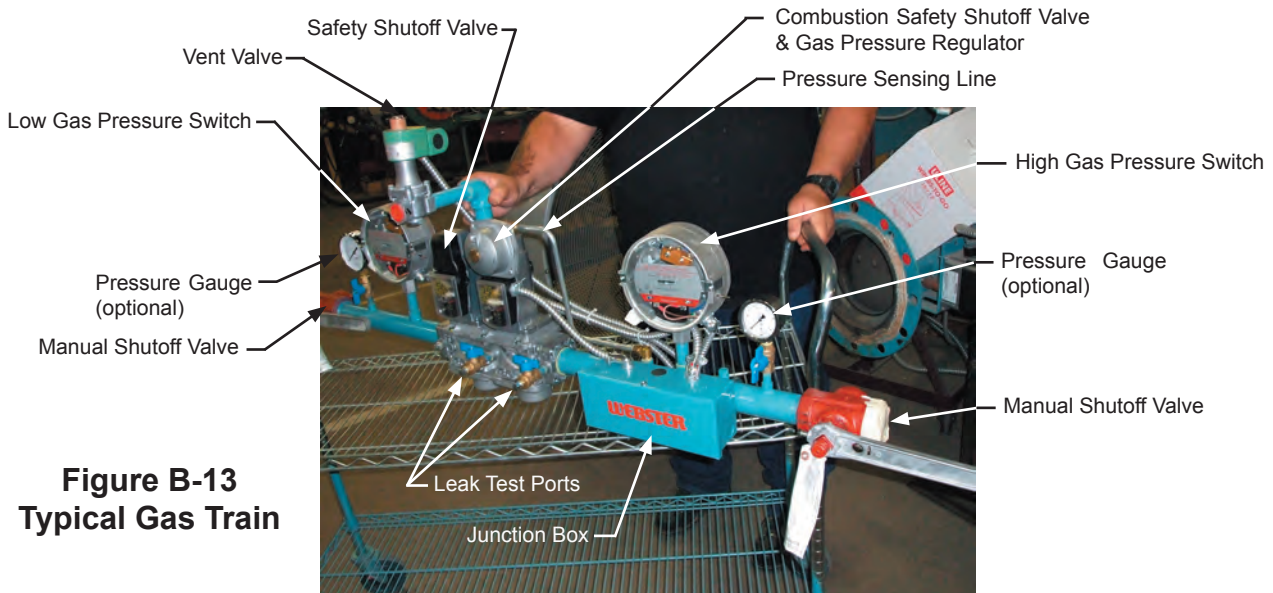


Figure B-13 Typical Gas Train

for each application and a unit specific gas train assembly drawing is provided for each unit, identifying the major components. Details are provided in the burner manual included with each burner.

The gas train shown in Figure C-4 uses a gas pressure regulator upstream of two safety shutoff valves. Another common style is to have the gas pressure regulation built into the second safety shutoff valve. The gas train in Figure B-13 uses a combination shutoff and regulator in the second safety shutoff valve.

Center Gas Balancing Valve

The amount of gas flowing to the center gas ports is regulated by the center gas balancing valve. This valve allows the flow to be increased or decreased proportional to the main gas flow. This is the only adjustment for the natural gas combustion flame shape.

Gas Safety Shutoff Valve

Each gas train has two shutoff valves in the gas train. These shutoff valves are usually motorized to open and spring return to close. They may contain a proof of closure switch to prove that the valve is in the closed position prior to starting the burner.

High Gas Pressure Switch

This switch is located after the last shutoff valve and before the gas flow control valve. It is set at a pressure that is greater than the highest gas pressure expected at this location. If the gas pressure rises above this level, it will trip the switch and cause the burner to shut down.

Low Gas Pressure Switch

This switch is located before the first shutoff valve. It is set to a pressure that is below the expected gas pressure at this location. If the gas pressure falls below this setting, the switch will trip and cause the burner to shut down.

Gas Pressure Regulator

Each gas train must have a gas pressure regulator. The regulator insures a consistent supply pressure to the burner. Often the gas pressure regulator is the first item in the gas train or can be integrated into the second shutoff valve.

Gas Control Valve

The gas control valve is used to modulate the flow of gas fuel to the burner. On a single point positioning system (linkage), it is connected to the jackshaft and uses a fuel cam to make fine adjustments to fuel flow. With a parallel positioning system (linkageless), an actuator is connected to the gas control valve, and modulated by electronic control to the desired position. The gas control valve is located on the pipe that connects to the gas manifold.

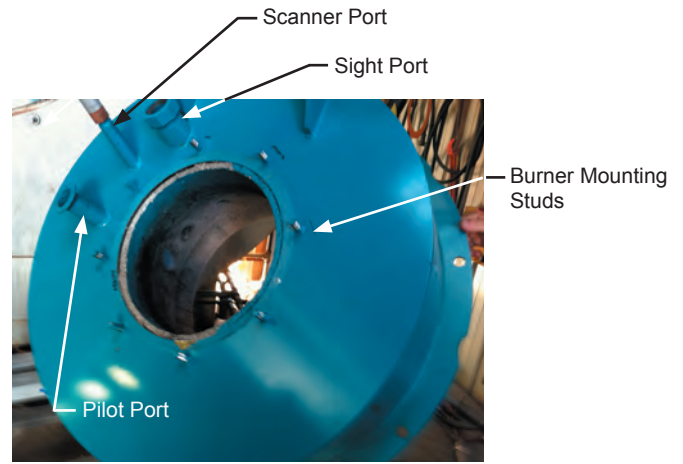


Figure B-15 Typical Refractory Plate

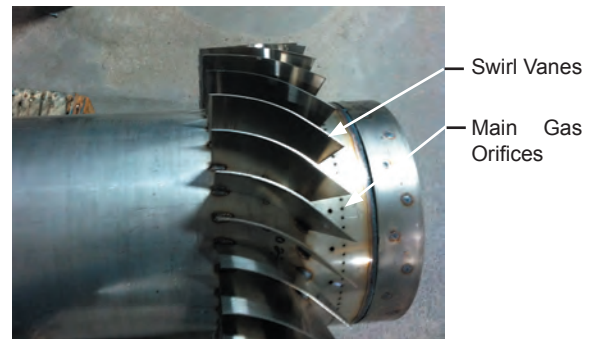


Figure B-15 Firetube Style Gas Manifold

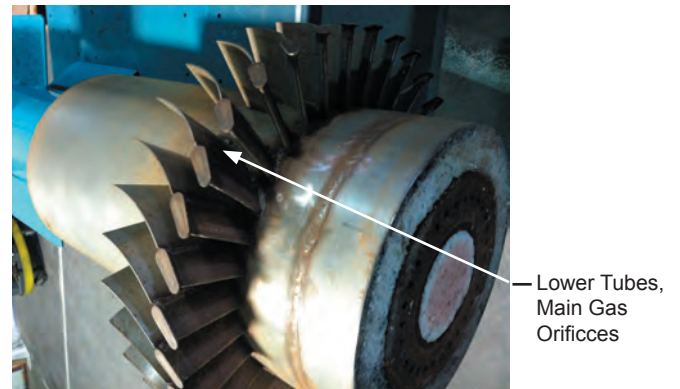


Figure B-15.1 Watertube Style Gas Manifold

5. Oil Fuel Components

Air / steam atomized oil systems are used on all oil burners. An air compressor is normally supplied for the air source, but house air or steam can be used.

Oil Pump

The oil pump is used to supply the oil to the nozzle at sufficient flow and pressure for the nozzle. The oil pump is provided as a separate item that must be mounted, wired and piped. The assembly consists of the pump, motor, coupling, pump-motor bracket and oil pressure regulator. The motor base mount is used to secure the assembly.

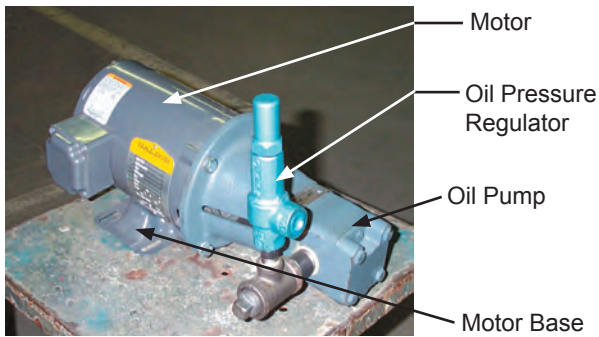


Figure B-16 Oil Pump and Regulator

Oil Pressure Regulator

An oil pressure regulator is used to maintain constant oil pressure to the burner. It is adjusted to provide the oil pressure needed at the nozzle.

Oil Supply Pressure Gauge

This indicates the oil supply pressure from the pump.

Oil Train

The oil train contains the safety shut-off valves, pressure switches and other components that may be required for the specific installation, insurance codes and local regulations and can vary greatly from burner to burner. Oil trains tend to be designed for each application and a unit specific oil train drawing is provided with each unit. Details of the actual components are provided with each burner.

Oil Safety Shutoff Valve

Each oil train has two shutoff valves. The valves can be either solenoid or motorized type and can have an optional POC (proof of closure) switch.

Low Oil Pressure Switch

This switch is set to a pressure below the expected oil pressure and will trip if the oil pressure drops below this level, shutting down the burner.

High Oil Pressure Switch (optional)


This optional switch is set to a pressure above the expected oil pressure and will trip if the oil pressure rises above this level, shutting down the burner.

Manual Ball Valve

A manual valve is provided in the oil line to perform testing of the safety controls as part of the normal startup procedures.

Oil Flow Control Valve

The oil flow control valve regulates the flow of oil to the nozzle. The control valve is in the piping to the nozzle, directly regulating the flow of oil to the nozzle.

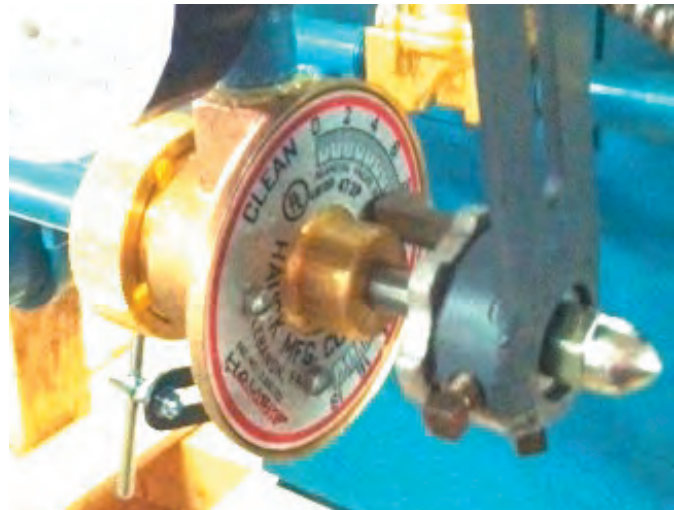

The oil flow control valve modulates with the air damper to provide different input rates. On a single point positioning system (linkage), it is connected to the jackshaft and uses a fuel cam to make fine adjustments to fuel flow. With a parallel positioning system (linkageless), an actuator is connected to the oil control valve and modulated by electronic control to the desired position.

Oil Nozzle

Several different types of oil nozzles may be used depending on the type of oil system, burner size, turndown and application. They all share a common purpose of atomizing the oil into small droplets so that they will easily and quickly burn. All of the nozzles are mounted to the end of the oil gun and are inserted into the support tube. The position of the nozzle can be adjusted by moving the gun in the tube. The oil nozzles and gun have a "Top and Bottom" position that is critical for correct operation. The end of the oil gun is marked with the word "TOP".

Figures B-17 and B-18 shows the components of typical air atomizing nozzles. The nozzle tip and swirler are lapped together to form a perfect fit and can only be used together as a matched set. Other air atomizing nozzles may have slightly different construction.

Figure B-17 Multiport Atomizing Oil Nozzle

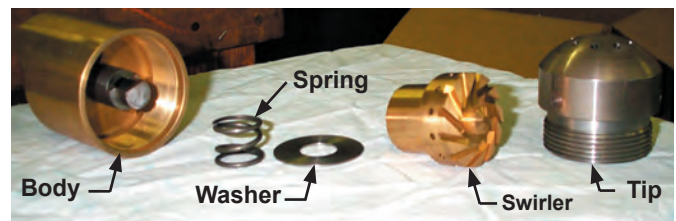
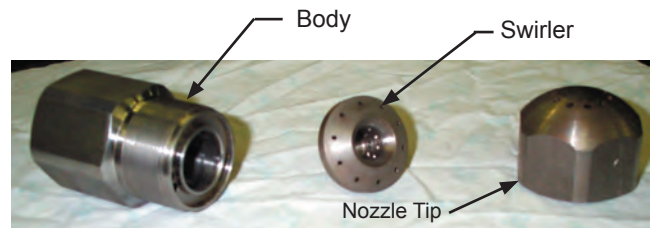


Figure B-18 Deep Groove Atomizing Oil Nozzle

Oil Gun

The oil gun (B-9) consists of the oil nozzle and pipe connections for the nozzle. The oil gun slides into the guide tube. Two blocks are used to keep the gun centered in the guide tube and lock the gun to the end of the guide tube.

The gun assembly must be mounted in the correct (vertical) position, with the word “TOP” located on top of the gun assembly. This will allow for even oil distribution and prevent oil dripping out of the gun and lines after shutoff.

Nozzle Oil Pressure Gauge

This gauge indicates the oil pressure at the oil nozzle. This reading is important in determining proper operation of the nozzle for atomization at any given firing rate. There is a wide range of possible pressures, but typically it is in the range of 15 to 60 psi.

Nozzle Atomizing Air Pressure Gauge

This indicates the atomizing air pressure at the nozzle. This reading is important in determining proper operation of the nozzle for atomizing the oil.

Air Compressor

The air compressor, if used, provides air to the oil nozzle to atomize the oil. The compressor assembly includes the compressor motor, relief valve and flexible connection to isolate the vibration of the air compressor. The large air compressor (Figure B-20) is equipped with rubber mounts that must be used when mounting the compressor to a base.

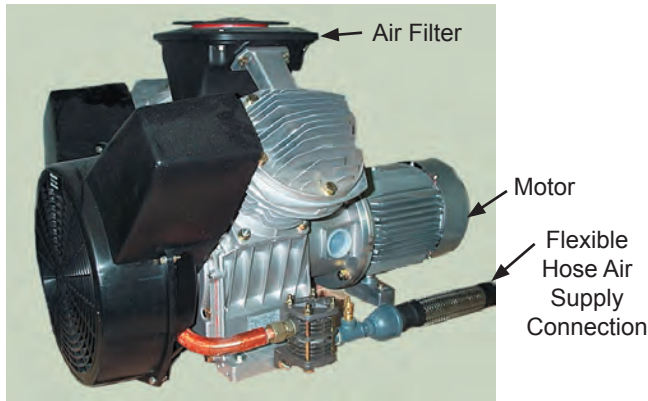


Figure B-20 Large Air Compressor



Figure B-21 Small Air Compressor

Air Bleed Valve and Muffler

An air bleed valve is provided with air atomizing systems to allow some of the air to bleed off and lower the atomizing air pressure to optimize the oil atomization. An air muffler is provided to reduce the noise from this air flow. In some

cases, the bleed valve modulates with firing rate.

6. Flue Gas Recirculation (FGR)

FGR Adapter

The FGR adapter provides an interconnection between the housing and air damper, placed in the air flow stream to introduce the FGR. This location allows the FGR to be “induced” into the air stream, because of the negative pressure downstream of the air damper and created by the burner blower wheel.

FGR Control Valve

The FGR control valve controls the flow of recirculated flue gas. The valve is connected to the FGR adapter, which creates the pressure differential for flow.



Figure B-23 FGR Control Valve

The FGR control valve modulates in conjunction with the fuel and air valves to provide different input rates. On a single point positioning system (linkage), it is connected to the jackshaft. With a parallel positioning system (linkageless), an actuator is connected to the FGR control valve and modulated by electronic control to the desired position.

Smaller FGR Valves are built into the FGR duct as shown in Figure B-1. Larger valves are wafer type, bottled between two flanges as shown in Figure B-23.

FGR Shutoff Valve (Linkage Units)

Single point positioning systems (linkage) require a separate FGR shut-off valve that prevents flow during the purge cycle. The valve is driven by a motor to close the FGR line during the purge cycle. Parallel positioning systems will modulate the control valve shut during purge and do not require a shut-off valve.

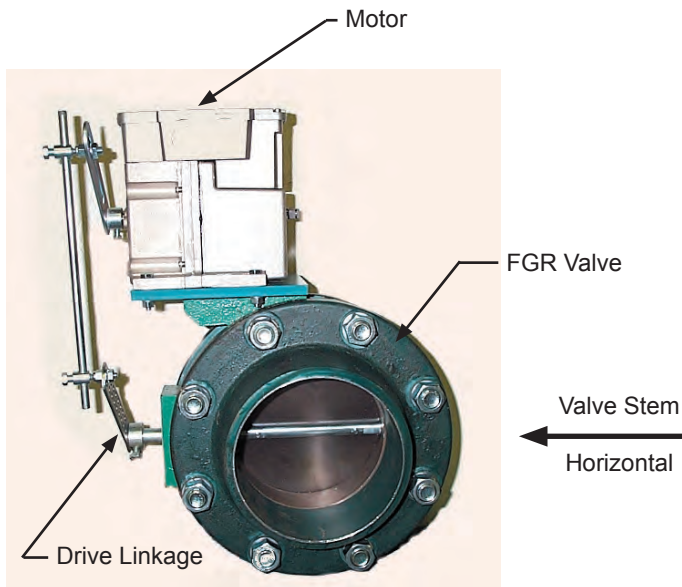


Figure B-24 FGR Shutoff Valve

The shutoff valve should be installed in the FGR duct close to the boiler connection. The valve stem should be horizontal, to prevent condensate from building in the shaft bore, causing it to seize.

When firing oil, this valve may be closed or it may be partially open to provide some FGR. If the valve is intended to be partly open, there will be a potentiometer in the control panel to adjust the position of this valve.

FGR Duct

The FGR duct provides the connection between the boiler outlet and the control or shut-off valve. The design of this duct is very important for proper operation and to prevent maintenance problems (see Section C). This duct is not included with the burner.

7. Fuel-Air-Ratio Controls

The burner may be equipped with single point positioning (linkage), multiple setting modulating motor, parallel positioning system (linkageless) or fully metered systems. All of these systems provide the basic fuel-air-ratio control required for good combustion, however they can provide different features and setup capabilities.

Modulating Control

The burner modulates to match the energy requirements of the load. It does this by using a sensor that measures the pressure or temperature of the system and a matching sensor in the modulating motor that moves to match the readings of the sensor.

In some optional systems, a similar process is used with an external control that provides a signal to the motor to go to a certain rate. These systems may include multiple burner sequencing, outside temperature compensation and numerous other control strategies.

Single Point Positioning (Linkage)

Single point positioning systems use a single modulating motor to vary the fuel input, air flow and other flow

changes like FGR and atomizing air flow. Linkage is used to connect these flow control elements together to provide a unified fuel-air-ratio control system. Other elements in this system would typically include a jackshaft, fuel cam and modulating motor.

Jackshaft

The jackshaft is a shaft that is used to tie the fuel, air and FGR valves together with linkage, to provide a uniform change in the flow as the burner modulates. A modulating motor is used to drive the jackshaft, driven by the requirement for heat in the system and as allowed to operate by the flame safeguard.

The jackshaft is a 3/4" shaft that rotates and is mounted in bearing supports. This provides a common means of modulating all of the valves from a single drive mechanism. The length can vary to meet overall dimensions and individual drive arms are used to connect to each valve.

Fuel Cam

A fuel cam is a mechanical linkage that allows for small fuel rate changes without changing the linkage setting. It can simplify the fuel-air-ratio adjustments during the burner setup (Figure B-3 and B-4).

Modulating Motor

The jackshaft is driven by a modulating motor that rotates 90° to modulate the burner input from minimum rate to maximum rate. Linkage is used to connect the modulating motor to the jackshaft and the fuel cams along with connecting the fuel, air and FGR control valves to the jackshaft.

The standard modulating motor has two internal proving switches. One switch, the Low Fire switch, proves the low fire position where the burner will light. This is also the position the modulating motor will travel to when the burner shuts down. The second switch, the High Fire Purge switch, proves the high fire purge position during pre-purge.

Multiple Setting Modulating Motor

In some burner configurations, there are different ideal settings for oil and gas firing, especially when higher turndown is desired. This can be accommodated with an optional modulating motor that has different low fire and high fire positions for gas vs oil.

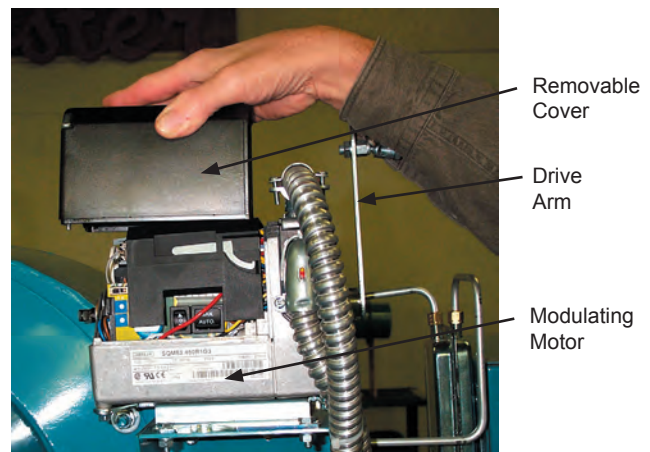


Figure B-25 Landis Mod Motor Adjustments

This optional modulating motor uses four to eight internal switches. One switch is used to prove the high fire purge position during pre-purge. A second switch is used to prove the fully closed position. This is the position of the motor when the burner is off. A third switch is used to prove the ignition position. This is the point at which the burner will light. A fourth switch is the low fire position. This is the position of the lowest firing rate of the burner. It can be different from the ignition position, if desired. If the burner is a combination gas-oil burner, two additional switches may be used. These switches do the same function as the third and fourth switches already listed, but can be set up to allow for different ignition and low fire positions for gas and oil operation. There is also a 7th and 8th switch that can be used to accommodate two different high fire settings. See the burner wiring diagram to determine the switch numbers and functions.

Parallel Positioning System (Linkageless)

The Posi-Control system is a parallel positioning system (linkageless) that uses individual actuators for each control valve and a computer controller that directs each actuator to provide the input change from minimum to maximum capacity. The control provides more flexibility in setting each fuel rate (Figures B-1 and B-2).

Fully metered control system

This system uses flow measurements to determine valve position. These controls require special training to use.

8. Electrical Controls

Control Panel

The control panel (Figure B-5) contains the flame safeguard control, relays, terminal strips for electrical connections and other components required for the control of the unit. Other components may be included for the operation of the boiler, for example, a low water cutout relay.

Flame Safeguard

The flame safeguard (Figure B-5) provides operational control and safety sequencing for the burner. Safety limits are tied to the unit and it controls the operation of the fuel valves. The flame scanner is part of this control and can detect a flame failure causing a safety shutdown. There are several different flame safeguard models available with different features and cost levels. They can provide fault annunciation and communications with other controls. The details of the control used in the burner are supplied with the unit.

On-Off Switch

This switch is used to start and stop the burner by opening or closing the limit circuit to the flame safeguard control.

Manual-Auto Switch and Potentiometer

The Man-Auto switch is used to select what signal source is used for modulation control of the burner. With the switch in the "Man" position, the burner firing rate is determined by the position of the manual potentiometer. With the switch in the

"Auto" position, the burner firing rate is determined by the signal from the boiler modulating controller. When in the "Auto" position, the manual potentiometer can limit the firing rate of the burner from anywhere between low fire and high fire. The modulating motor will always drive open and closed during pre-purge, regardless of the position of the Man-Auto switch and potentiometer.

Fuel Transfer Switch

This switch selects the proper fuel for firing. It has a center off position that prevents moving the switch from one position to the other, without momentarily stopping in the center off position.

Power On light

Indicates power is applied to the control panel.

Call For Heat light

Indicates the burner On-Off switch is closed and the boiler limits are closed.

Fuel On light

Indicates the main fuel valve circuit has been energized.

Alarm light

Indicates the flame safeguard control is in a safety shutdown and lockout condition. The flame safeguard control reset button must be pressed before the burner can operate again.

On some burners the Alarm light may also be used to indicate other failure conditions such as low water, high limit, etc. See the burner wiring diagram for details of what other controls may be wired to the Alarm light.

Junction Box

The junction box contains the electrical connections that are required between the burner and control panel.

Control Transformer (Optional)

The control circuit transformer is used to reduce the main power input to 115 VAC for the control circuit. If this electrical supply could be provided as a separate input, this transformer would not be required. The transformer has two fuses located on the transformer box.

Alarm Bell

The alarm bell (or buzzer) provides an audible noise if the burner were to lock out due to an alarm condition.

Control Relays

Relays are provided to support electrical options. The number and type of relays will vary with the equipment. These relays will be indicated on both the wiring diagram and material list.

Motor Starters

A motor starter for the combustion air fan may be in the panel if a VFD is not used. If other motors are used, for an oil pump or air compressor, these will also be located in the control panel.

C. Installation

1. General Considerations
2. Refractory Frontplate
3. Burner Mounting
4. Gas Piping
5. Gas Pilot
6. General Oil Piping
7. Air Atomized #2 oil
8. FGR System
9. Draft and Stacks
10. Electrical System

This section covers the installation procedures for each of the standard systems offered on the HDRMB burner line. Your specific burner will not have each of these systems and may be supplied to you as an installed burner assembly. If you receive the burner as part of a new boiler for example, the burner will be installed in the vessel with much of the piping already done. For this reason, a complete review of the installation is required to determine which tasks are complete and which need to be done.

THE INSTALLATION OF THE EQUIPMENT SHALL BE IN ACCORDANCE WITH THE REGULATION OF AUTHORITIES HAVING JURISDICTION, INCLUDING THE NATIONAL ELECTRICAL CODE, INSURANCE REGULATIONS.

The equipment shall be installed in accordance with the state and local requirements. Authorities having jurisdiction should be consulted before installations are made.

NOTE TO INSTALLER: The main power disconnect for this equipment must be conspicuously labeled and placed within sight of the operating system and equipped with lockout provisions.

1. General Considerations

In the initial planning of the installation, several items must be covered:

- a. Prior to starting the installation, all the technical literature should be collected and reviewed to identify requirements. As a minimum, these should include the Installation and Operating Manuals for the burner and vessel, the wiring diagrams, the fuel schematics and technical literature on supplied controls.
- b. A general overview of the equipment should be made prior to the installation. Check the location of access doors and insure that they will be able to function properly when all equipment is installed. The burner and control panel should have sufficient clearance for the operator to monitor, inspect and perform maintenance. A minimum clearance of 24 inches all around the burner should be provided for maintenance. The burner drawer and oil gun is pulled out from the front of the burner and there needs to be sufficient space for this activity.
- c. A source of combustion air must be provided for the burner. Local codes often determine minimum requirements, and these must be followed. In absence of other codes, the following can be used.

Webster recommends two air sources be provided, one located high and one low. Each air source must be at least 1 ft². If there are multiple burners, the area must consider all burner requirements. Exhaust fans are not recommended as they create additional air flow requirements that must

be included in the area calculation.

The quantity of air required for combustion and ventilation is 10 cfm/BHP. The maximum air velocity is 250 ft/min from the floor to 7 feet high, and 500 ft/min above 7 feet high. Outdoor louvers may restrict the open area, and if the exact restriction is unknown, a restriction of 20% can be used. Add 3.5% to the area for each 1000 ft above sea level. The calculations are,

$$\begin{aligned}\text{Total air required (cfm)} &= \text{BHP} \times 10 \\ \text{Open area} &= \text{cfm} / \text{velocity} \\ \text{Louvered area} &= \text{open area} \times 1.2 \text{ (or actual)} \\ \text{Area of opening} &= \text{louvered area} / 2\end{aligned}$$

For example, with duct located under 6' high for a 500 HP boiler, what would their area need to be? The total air is (500 BHP x 10 cfm/BHP) = 5000 cfm. The maximum velocity is 250 ft/min, so the open area must be = (5000 cfm / 250 ft/min) = 20 ft². Since these opening will have louvers, the actual openings must be = (20 ft² x 1.2) = 24 ft². There will be two opening, so each will be = (24 ft² / 2) = 12 ft².

The combustion air should not be below 50°F or large amounts of condensation can be generated, causing premature failure of the burner. Depending on the actual temperatures, it can fill the fan housing and destroy the fan and motor. If cool temperatures are experienced infrequently, the condensate can be collected and removed by using the drain tapings on the bottom of the FGR adaptor and fan housing. If cool temperatures are experienced with some frequency, the combustion air should be pre-heated to prevent the condensation.

A TEMP-A-TRIM control is offered as standard equipment on the HDRMB burner. This product will provide an automatic correction for changes in combustion air temperature that would otherwise require combustion tuning to prevent problems like rumbling due to high excess air (with cooler temperatures) or high CO due to low excess air (due to high temperatures). This allows the burners to work within a wide range of combustion air temperatures without frequent combustion tuning. If your burner does not have the TEMP A TRIM option, then you may need to have seasonal tuning performed.

d. There are several people that should be notified before starting, including the owners representative, the mechanical contractor, the electrical contractor, the service organization and the boiler manufacturer.

e. **DO NOT USE TEFLON TAPE** or compounds with Teflon content as an oil or gas pipe sealant. Teflon can cause valves to fail creating a safety hazard. Warranties are nullified and liability rests solely with installer when evidence of Teflon is found.

f. Installer must clearly identify the main electrical power


disconnect and the manual shutoff valve on the gas supply drop line to the burner.

2. Refractory Frontplate

The refractory front plate is used to adapt the burner to the vessel. While the specific dimensions will vary with different vessel and burner configurations, all will be similar in shape to that shown in Figure C-1. A mounting flange on the frontplate is used to clamp the frontplate to the vessel. Bolts on the frontplate are used to clamp the burner to the

frontplate. Fiberglass rope gaskets are used to seal each connection.

The rope gasket is applied to full surface of the frontplate mounting flange (it must cover the full face of the flange) to seal the refractory front plate to the vessel (a spray adhesive can be used to hold the gasket in place temporarily). The refractory frontplate is inserted into the furnace and bolted or clamped to the end of the furnace. The refractory must be centered in the furnace, so that the gap between the refractory and furnace is uniform. Clamp the

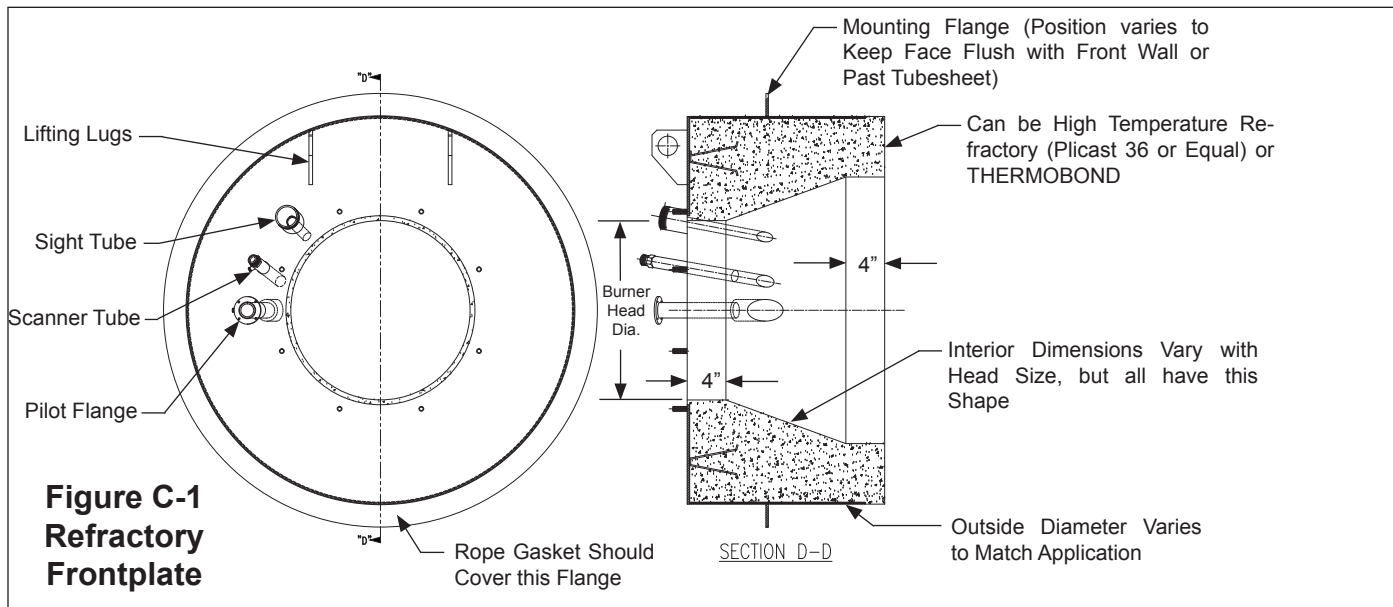

**Figure C-1
Refractory
Frontplate**


frontplate to the furnace with uniform tension on the bolts, starting with a low torque for all bolts and then repeating with higher torque levels until tight.

Pack the gap between the refractory front plate and furnace with ceramic blanket insulation (or ceramic rope) for at least 4 inches from the end of the refractory (Figure C-3). This can be accomplished by reaching in from the center hole, and placing the insulation between the refractory and furnace, then pushing it in with a block.

3. Burner Mounting

A rope gasket is applied to the burner mounting flange, completely covering the flange (the 3/8" fiberglass gasket is provided with the burner). A spray adhesive can be used to hold these in place prior to installation.

The burner is then inserted into the frontplate, centered evenly (the 2 inch recess will center the burner) and clamped into position. Clamp the burner to the frontplate with uniform tension on the bolts, starting with a low torque for all bolts and then repeating with higher torque levels

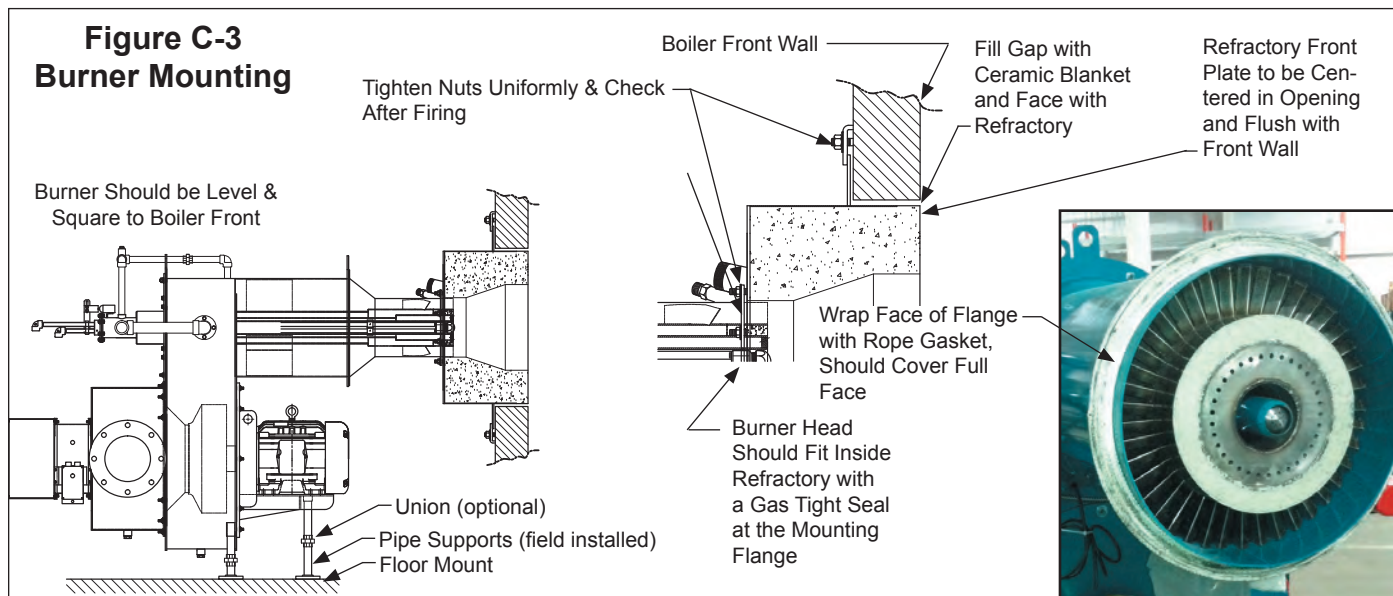

**Figure C-3
Burner Mounting**

until tight.

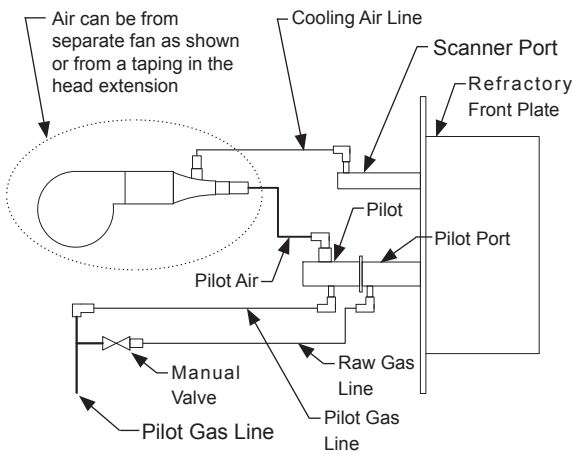


Figure C3.3
Pilot & Scanner Piping Schematic

The burner should be checked for level and must be perpendicular to the vessel. If the burner is not level or perpendicular, loosen the mounting clamps, reposition the burner and retighten. This will properly align the burner flame with the furnace and allow the proper flow of liquid. Oil combustion will not work properly if not level.

The burner is equipped with mounting supports to secure it to the floor. These are pipe couplings attached to the burner. There are two on the housing and for larger burners, one or two in the motor mounting plate. To secure the burner to the floor, pipe sections are installed to these couplings and a flange mount is secured to the floor, as shown in Figure C-3.

WARNING
DO NOT USE TEFLON TAPE OR COMPOUNDS CONTAINING TEFLON. THIS COULD DAMAGE THE VALVES CREATING AN UNSAFE OPERATION

NOTE TO INSTALLER: The manual shutoff valve on the gas supply drop line to the burner must be conspicuously labeled.

4. Gas Piping

Figure C-4 shows a typical gas piping schematic, although some components can vary based on size, insurance and other requirements. Consult the job specific gas train piping schematic (provided with the burner if train is supplied by Webster), along with a detailed list of components for specific details. This must be followed to properly locate the components in the gas .

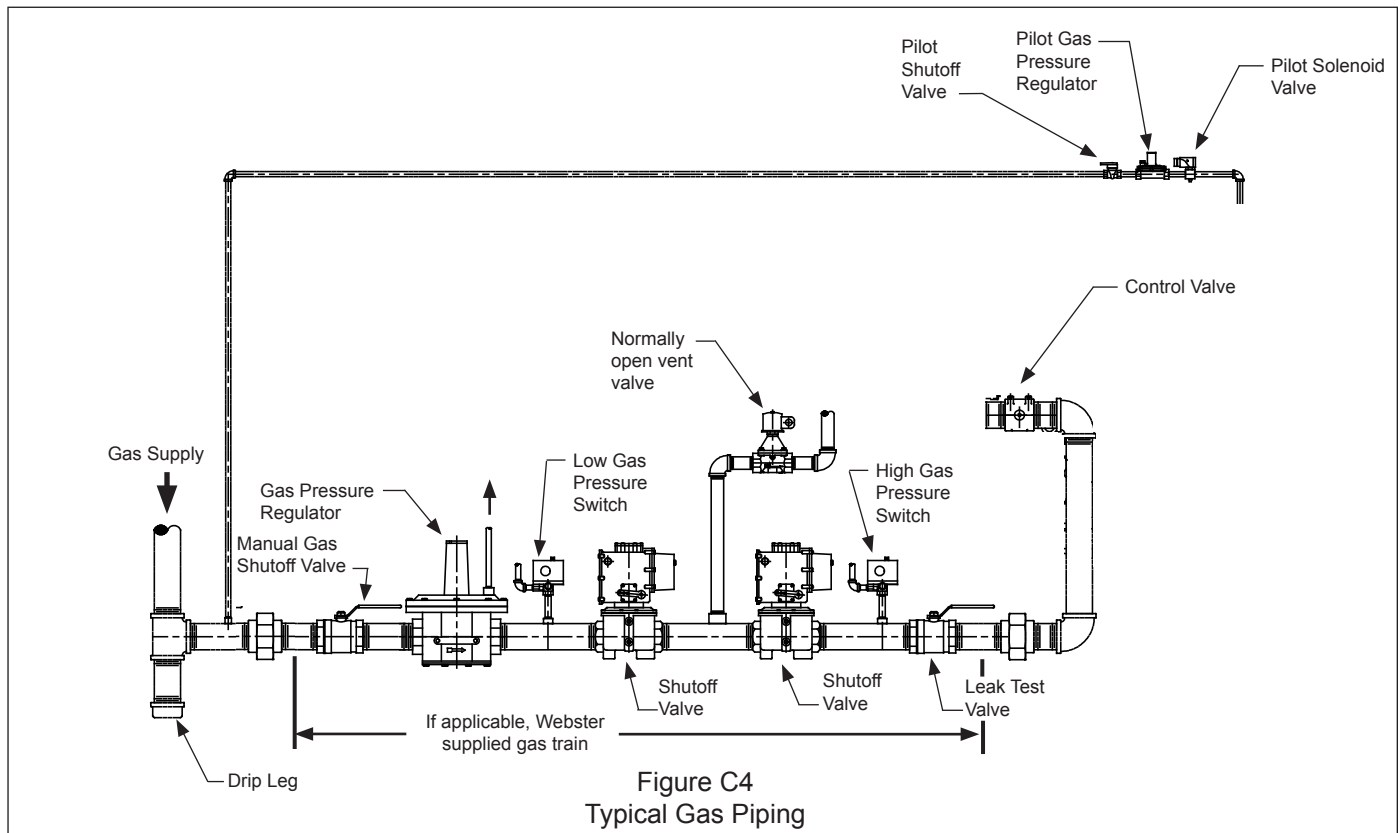


Figure C4
Typical Gas Piping

The gas piping must comply with all local and state codes and must be in accordance with the local gas company and insurance requirements.

If the gas train has not been factory assembled, the components should be assembled as indicated on the gas piping schematic furnished with the burner. The section between the two manual shutoff valves is mounted securely to the base rail on the side of the vessel. A drip leg should be

provided upstream of the first manual valve to collect any moisture or contaminants.

Some general considerations for this installation are:

- a. The piping to the burner must be sized to provide gas at the pressure and volume indicated on the order.
- b. The gas piping should be installed according to local regulations and any applicable insurance requirements.
- c. The gas pressure regulator usually requires a mini-

imum straight length of pipe leading into and from the valve for proper operation. Also some regulating valves require a downstream pressure tap that must also be located at a certain dimension from the valve. These details are provided in the job specific details provided with the burner.

d. The piping between the train and burner must be done in a manner that will minimize the pressure drop. The pipe size should be the larger of the two connection points (on the train or the burner connection) and must use a minimum amount of elbows. If more than three 90° elbows are used, the pressure drop may be too high (consult factory in this case).

e. The gas piping should be cleaned to remove filings and other debris common in the construction process.

f. The piping should be pressure tested with inert gas at two times normal operating pressure before use.

5. Gas Pilot

The gas pilot is located on the refractory front plate along with the scanner and sight port. These items and the related piping and wiring are intended to be done in the field to prevent shipping damage. After the installation of the burner, the pilot, scanner and related gas and air lines need to be connected as shown in figures C-3.3 and C3.5. All of these items are provided with the burner as ship loose components. High Temperature gasket material should be used for the scanner and pilot assembly to prevent air leaks.

There is an air line to both the pilot and scanner. This air could be provided by either a separate small fan or a tapping on the head extension, depending on the burner configuration. Figure C 3.5 shows the head extension tapplings.


There are two gas connections to the pilot, the main gas

connected to the pilot and a raw gas line that is routed through a orifice and manual ball valve to the pilot port. The raw gas manual valve should remain open, but is available as an adjustment if required.

6. General Oil Piping

WARNING
DO NOT USE TEFLON TAPE OR COMPOUNDS CONTAINING TEFLON. THIS COULD DAMAGE THE VALVES CREATING AN UNSAFE OPERATION.

The amount of oil piping required in the field will depend on the type of system and how the burner was purchased. If the burner was factory mounted to the boiler, much of the installation work may already be complete. The items identified in this manual assume that none of the installation work has been done by others.

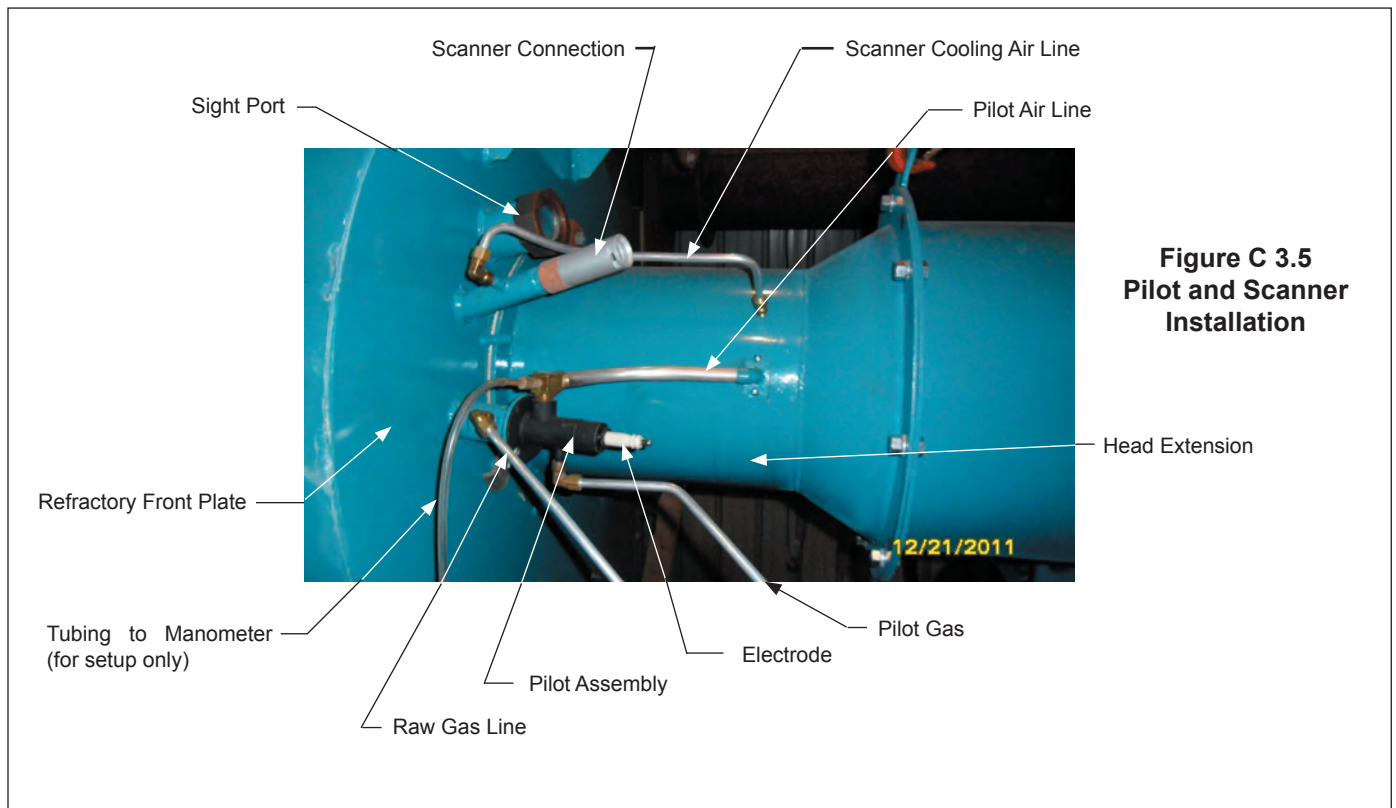

**Figure C 3.5
Pilot and Scanner
Installation**


Figure C-5 Pump Flow Rates				
BHP	MBH Input	Oil Nozzle GPH	Pump Model	Pump GPH
120	5040	36	SG-0525	54
174	7280	52	SG-0535	78
254	10640	76	SG-0550	114
335	14000	100	SG-0570	150
482	20160	144	SG-0510	216
642	26880	192	SG-0514	288
836	35000	250	SG-0519	375
1138	47600	340	SG-0528	510
1472	61600	440	SG-0711	660

The oil piping must be constructed to provide the flow and maintain the pressure required for proper system opera-

tion. Refer to the previous section for details on each of the different types of oil systems and how they operate.

Some of the actions required for successful piping systems are:

- a. Oil storage tanks and piping must conform to The National Fire Protection Association "Standard for the Installation of Oil Burning Equipment NFPA-31", local ordinances and EPA underground storage tank requirements.
- b. Oil lines shall be substantially supported and protected against physical damage. Buried lines shall also be protected against corrosion.
- c. After installation and before covering, buried lines should be pressure tested for leakage.
- d. Cast iron fittings should not be used.
- e. Aluminum tubing should not be used.
- f. Proper allowance should be made for expansion and contraction, jarring, vibration and tank settling.
- g. Always run full size lines.


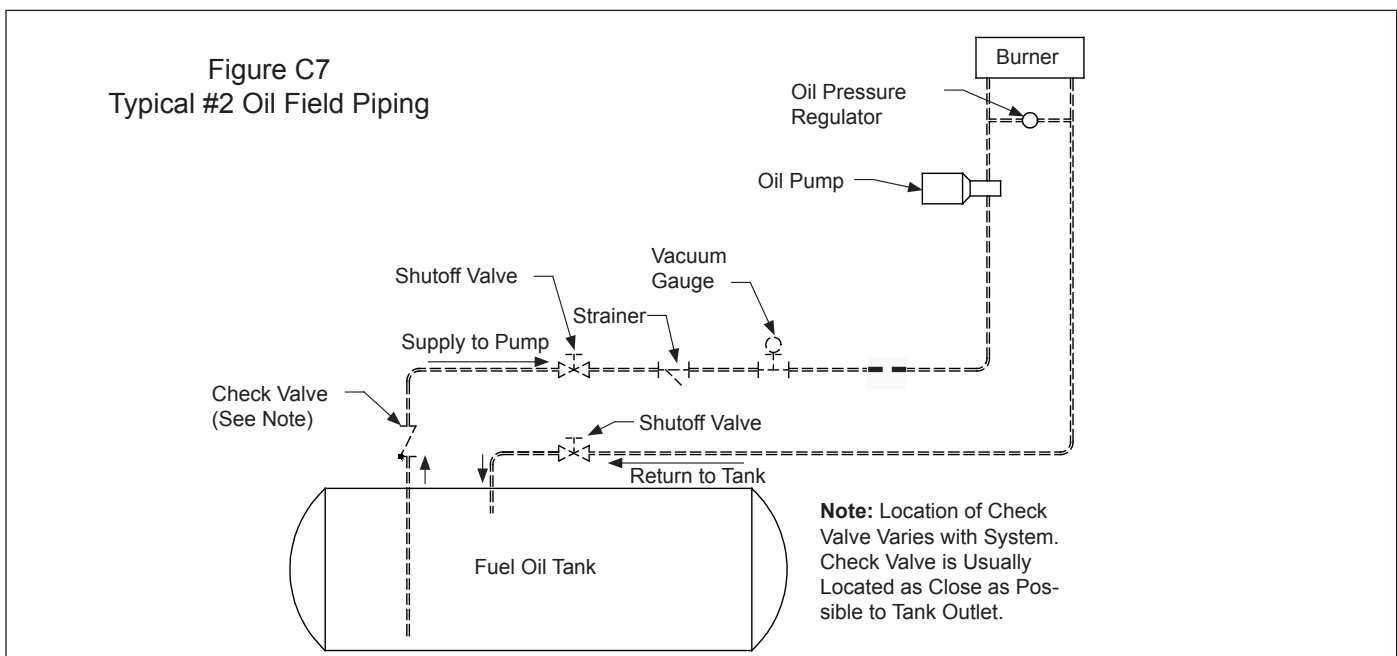


- h. Suction and return lines shall be as short as possible.
- i. The oil lines must be cleaned to remove water, rust and foreign matter. A common method of cleaning the oil piping is to temporarily install a short copper tube to the pump inlet, feeding the pump oil from a bucket. The gauge must be removed and the tapping plugged. The pump is run for a short time by manually engaging the motor starter by pushing it with a piece of wood. If flow does not establish within 2 minutes of engaging the pump, shut the pump off and run through the priming procedure again.
- j. The standard oil pumps supplied on the HDRMB are Viking Model SG operating at 1750 rpm. These pumps can provide suction (vacuum) of 10 inch of Hg when used to pull from a tank. If a transfer pump is used, the maximum inlet pressure that the pump can tolerate is 15 PSIG, although most regulations require a maximum transfer loop pressure of 3 PSIG.
- k. A strainer is required to protect the pump, valves and oil nozzle. This strainer is not part of the standard equipment supplied by Webster, but is intended to be supplied and

installed by others. The strainer should have a maximum filter opening of 0.027" for #2 oil and sized to handle the full flow rate of the pump (Figure C-6 for optional pumps supplied by Webster). The strainer must also handle the pressure (maximum 25" vacuum). Retain and follow the strainer instructions supplied by the manufacturer. It is essential that these instructions be followed to insure proper filtration to protect the pump, valves and nozzle.

- l. The oil lines and most valves are sized to handle the full pump capacity, as shown in figure C-5. The pumps are selected for a capacity of at least 1.5 times the maximum nozzle rate. If pumps are used with substantially higher flow rates, these selections may not function correctly. This is especially critical for the pressure atomized system where the metering valve is sized for the pump flow.

The selection of the oil pipe line size is critical for proper operation of the system. For simple systems, Figure C-6A can be used to select the oil pipe sizes. If the pipe routing or overall length is over 100 equivalent feet, the selection process needs a more detailed design review.

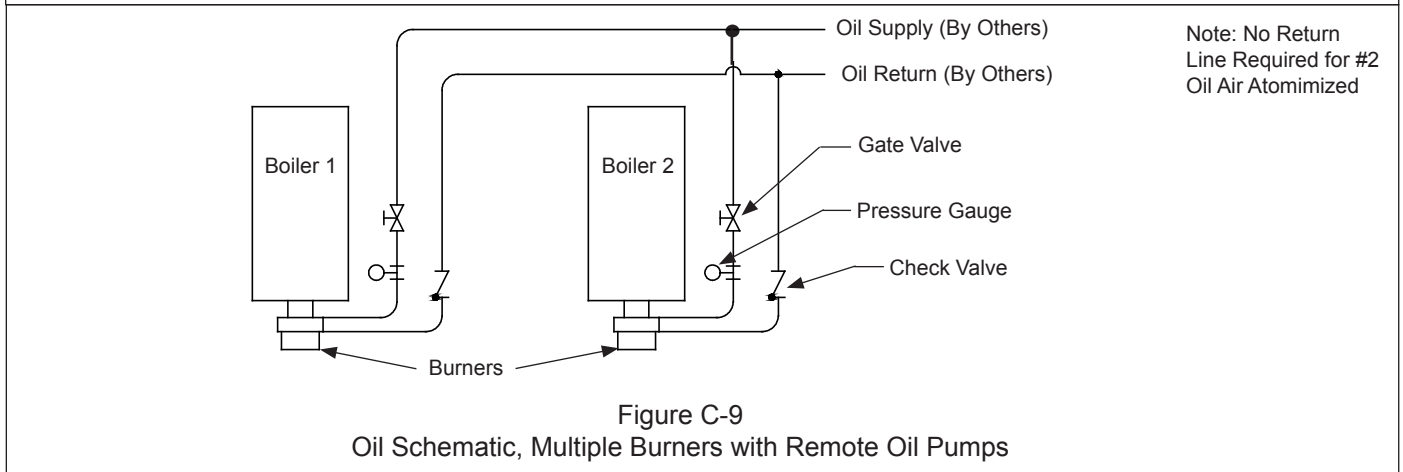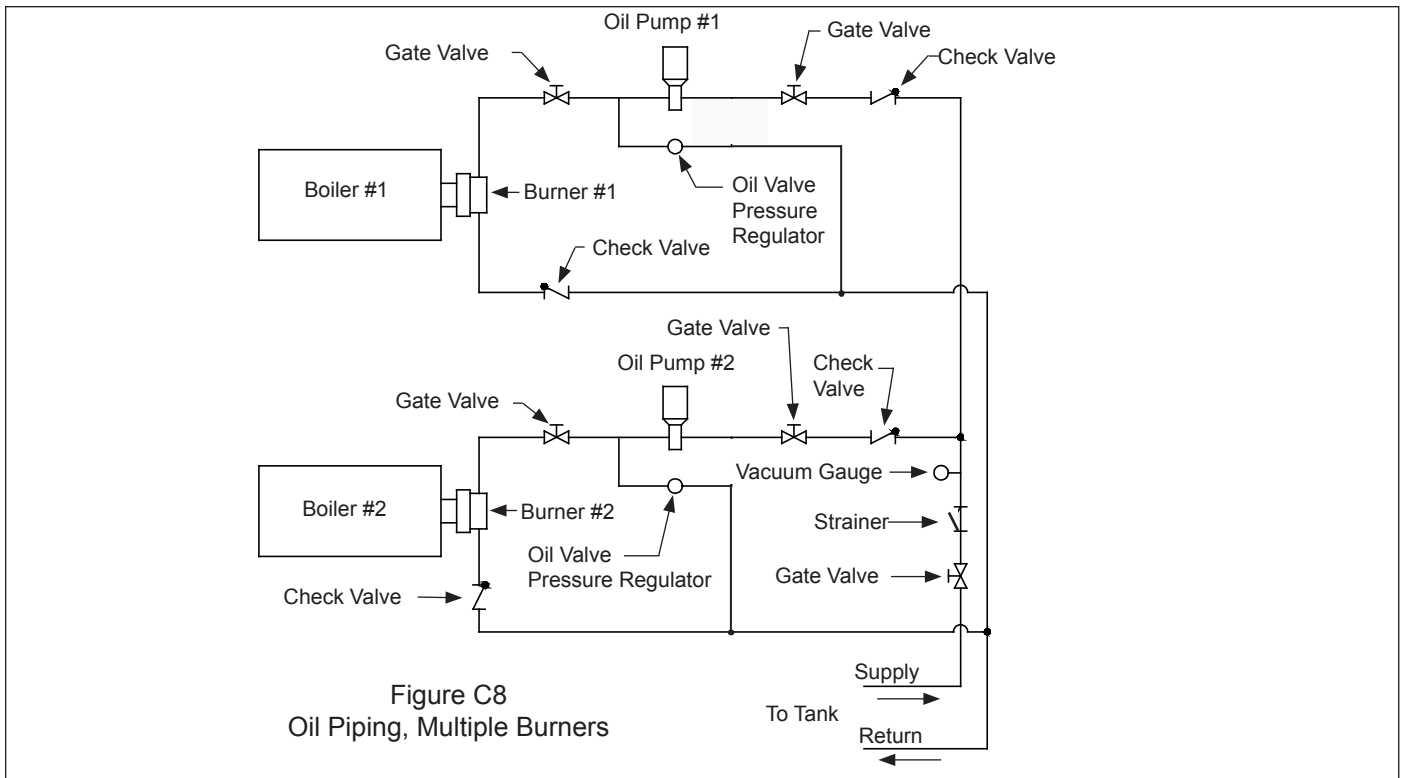

**Figure C-6B
Equivalent Pipe Lengths**

	Pipe Size (Schedule 40 Pipe)					
	3/4"	1"	1 1/4"	1 1/2"	2"	2 1/2"
90° Elbow	2.1	2.6	3.5	4.0	5.2	6.2
45° Elbow	1.1	1.4	1.8	2.2	2.8	3.3
"T" Side Out	4.1	5.3	6.9	8.0	10.4	12.4
"T" Through	1.4	1.8	2.3	2.7	3.5	4.1
Gate Valve	0.5	0.6	0.7	0.9	1.1	1.3
Globe Valve	23	30	39	45	58	69

CAUTION
PUMP FAILURES CAUSED BY FOREIGN MATTER IN THE OIL LINES WILL NOT BE COVERED BY WARRANTY

To determine the equivalent length of the oil piping, use the straight length of piping and add the equivalent length of straight pipe given for each fitting (figure C-6B).

**Figure C-6A
Oil Pipe Line Sizes**

Boiler HP	Light (#2) Oil		
	Pump to Burner (1)	Tank to Pump (1)	Return Line (1)
200-350	1	1	1
400-600	1	1	1
700-1000	1	1	1

Notes: (1) Based on equivalent length of less than 100 ft of pipe.
 (2) For reference only, must be confirmed by design authority.

7. Air Atomized #2 Oil

The standard HDRMB air atomized burner equipped for light oil may not include the optional oil pump (Figure C-5). Oil is to be delivered to the burner at a constant 125 PSIG and with a flow capacity that is at least 50% higher than the rated nozzle capacity. For pump selections, the capacity should be 50% over the nozzle capacity. See section A for ratings.

The general arrangement for this system is shown in Figure D-4. A supply and return line connection are required, along with the components indicated. The lines must be sized correctly to provide the required flow with minimal pressure drop. The pressure in the return line should not exceed 3 PSIG.

The oil supply and return lines must be piped to the burner, with the components installed as shown in the schematic. The oil pressure regulator must be located close to the burner to provide a constant oil supply pressure.

8. FGR System

Flue Gas Recirculation (FGR) is used as the primary method to reduce NO_x emissions. This is accomplished by using a duct to direct some of the flue gas from the stack to mix with the combustion air before the fan. The flow rate of the flue gas is controlled by a butterfly valve located near the burner, and controlled by linkage from the jackshaft or a servo similar to the fuel and air valves.

The size of the duct is critical to obtaining the correct FGR flow required for the NO_x emission level. There are several common factors that determine the duct size, type of vessel, NO_x emission level, the type and number of elbows in the duct, altitude, combustion air temperature and stack temperature. Figure 11 can be used to determine the correct FGR duct size. These charts are divided into sections for Firetube and Watertube boilers as well as the different NO_x emission rates and stack temperature. These charts are based on using a maximum of three long radius 90 degree elbows, a maximum of 1000 ft elevation and a maximum air temperature of 90^oF. By selecting the correct vessel type, NO_x Level and stack temperature, the maximum Boiler HP or MBH input is listed for a variety of different FGR duct sizes. The correct duct size is the one that has meets or exceeds the rating of the burner in question. The analysis performed on your specific burner by Webster Engineering will have a better accuracy because each of these variables is included in the sizing calculations.

The design of the FGR duct must include the following considerations,

a. Normally the duct would connect to the stack as shown in Figure C-12, with a 45 degree cut facing the flue gas flow and with the center of the cut centered in the stack. The duct could be made to the smoke box, but must still be located with the same 45 degree cut

facing the flue gas flow stream and with the center of the cut in the center of the stream.

b. The duct should be routed in a manner that has the minimum number of elbows and provides for the normal expansion and contraction of the piping. Long duct runs can change length by over 1" and can put an extreme load on the connecting points that could cause component failures. The design must include offsets that will allow for the required movement of the piping without undue force on the burner or stack.

c. Duct expansion and contraction can be managed by using two relatively long duct runs that are 90 degrees apposed to each other, similar to that shown in Figure C12. A small movement in the angle between these two legs will provide the space needed to absorb the expansion and contraction. The ends of the FGR duct must be securely attached to allow this to work properly, and prevent high loads from being applied to the burner or stack.

d. A condensation drip leg must be provided upstream of the FGR control valve and the FGR shutoff valve (if used). There must be sufficient condensate drip legs and catch space (volume of drip legs) to prevent the condensation from flowing through the control valves and into the fan. In cases of heavy condensation, a condensate drip leg may be required on the bottom of the housing, to remove condensate.

e. Determine the duct size, as indicated above. Remember that changing the fitting type and number of elbows can have a large impact on the pressure drop. If the pressure drop is too high, the unit will not make the required NO_x or input due to the increased pressure drop. The burner capacity is reduced about 6% for each 1" of pressure drop.

f. Determine the location of the FGR shutoff valve (linkage systems only). It can be mounted in either the vertical or horizontal run, but it must be near the top of a vertical run to reduce the potential for condensation collection. If the valve is mounted in a horizontal run, the valve shaft must be horizontal (so condensation does not collect in the bearing) and the actuator motor must be on top of the valve (with insulation between the line and drive motor). Also, there must be a condensation drip leg in the horizontal run before the shutoff valve to remove any condensation.

g. Determine if pipe reducers are needed for the connection to the FGR control valve and the FGR shutoff valve.

h. The duct must be properly supported, handling both the weight of the duct and to control the thermal

CAUTION

UNCONTROLLED CONDENSATION CAN CAUSE PREMATURE FAILURE OF THE CONTROL VALVES, FAN AND MOTOR. ADEQUATE MEANS MUST BE PROVIDED TO REMOVE CONDENSATION FROM THE SYSTEM. COLD STARTUP WILL GENERATE SIGNIFICANT AMOUNTS OF CONDENSATION.

expansion and contraction. The supports may need to be anchored to provide this stability in the FGR duct.

i. The FGR duct is normally made from schedule 40 pipe because it is easily obtainable and inexpensive. Schedule 20 pipe can also be used for this application.

j. The duct components must be seal welded, flanged or screwed together to provide an air tight duct. Air leakage

**Figure C-11A Firetube Maximum Boiler HP by FGR Size and Stack Temperature
FGR Duct Pipe Size**

		9 PPM NOx on Firetube Boiler										
		Duct Size	4	6	8	10	12	14	16	18	20	24
Gross Stack Temperature (oF)	175	61	139	241	380	538	652	851	1075	1338	1937	
	200	59	134	232	365	518	627	819	1035	1288	1864	
	225	57	129	223	352	499	604	789	997	1241	1796	
	250	55	124	216	340	482	583	761	962	1197	1733	
	275	53	120	208	328	465	563	735	929	1156	1674	
	300	51	116	201	317	450	545	711	898	1118	1619	
	325	50	113	195	307	436	527	689	870	1083	1567	
	350	48	109	189	298	422	511	667	843	1049	1519	
	375	47	106	183	289	409	496	647	818	1018	1473	
	400	45	103	178	280	398	481	628	794	988	1430	
	425	44	100	173	273	386	468	611	772	960	1390	
	450	43	97	168	265	376	455	594	750	934	1352	
	475	42	95	164	258	366	443	578	730	909	1316	
	500	41	92	159	251	356	431	563	711	885	1281	
	525	40	90	155	245	347	420	549	693	863	1249	
	550	39	87	151	239	339	410	535	676	842	1218	
	575	38	85	148	233	330	400	522	660	821	1189	
	600	37	83	144	228	323	390	510	644	802	1161	
625	36	81	141	222	315	381	498	629	783	1134		
650	35	80	138	217	308	373	487	615	766	1108		
675	34	78	135	212	301	365	476	602	749	1084		
700	34	76	132	208	295	357	466	589	733	1061		

		12 PPM NOx on Firetube Boiler										
		Duct Size	4	6	8	10	12	14	16	18	20	24
Gross Stack Temperature (oF)	175	64	144	250	394	558	676	883	1115	1338	2009	
	200	61	139	240	379	537	650	849	1073	1335	1933	
	225	59	134	232	365	518	627	818	1034	1287	1862	
	250	57	129	223	352	499	605	789	997	1241	1797	
	275	55	125	216	340	482	584	763	963	1199	1736	
	300	53	121	209	329	467	565	738	932	1160	1679	
	325	51	117	202	319	452	547	714	902	1123	1625	
	350	50	113	196	309	438	530	692	874	1088	1575	
	375	48	110	190	300	425	514	671	848	1056	1528	
	400	47	107	185	291	412	499	652	823	1025	1483	
	425	46	104	179	283	401	485	633	800	996	1442	
	450	44	101	174	275	390	472	616	778	969	1402	
	475	43	98	170	268	379	459	599	757	943	1364	
	500	42	95	165	261	369	447	584	738	918	1329	
	525	41	93	161	254	360	436	569	719	895	1295	
	550	40	91	157	248	351	425	555	701	873	1263	
	575	39	89	153	242	343	415	542	684	852	1233	
	600	38	86	150	236	334	405	529	668	832	1204	
625	37	84	146	231	327	396	517	653	812	1176		
650	36	83	143	225	319	387	505	638	794	1149		
675	36	81	140	220	312	378	494	624	777	1124		
700	35	79	137	216	306	370	483	610	760	1100		

Figure C-11B Watertube Maximum MBH Input by FGR Size and Stack Temperature											
9 PPM NOx on Watertube Boiler											
	Duct Size	4	6	8	10	12	14	16	18	20	24
Gross Stack Temperature (oF)	175	3003	6816	11803	18604	26372	31925	41691	52672	65560	94893
	200	2890	6558	11356	17899	25373	30716	40112	50677	63077	91298
	225	2784	6318	10941	17246	24447	29595	38648	48827	60775	87966
	250	2686	6096	10556	16639	23586	28552	37287	47108	58635	84869
	275	2595	5889	10197	16073	22784	27581	36019	45506	56641	81982
	300	2509	5695	9861	15544	22035	26674	34834	44009	54777	79285
	325	2429	5514	9547	15049	21333	25825	33725	42607	53033	76760
	350	2355	5343	9253	14584	20674	25027	32684	41292	51396	74391
	375	2284	5183	8976	14148	20055	24278	31705	40056	49857	72164
	400	2218	5033	8715	13736	19472	23572	30784	38891	48408	70066
	425	2155	4891	8469	13348	18922	22907	29914	37793	47040	68087
	450	2096	4756	8236	12982	18402	22277	29092	36755	45748	66216
	475	2040	4629	8016	12635	17910	21682	28314	35772	44525	64446
	500	1987	4508	7807	12306	17444	21117	27577	34840	43365	62768
	525	1936	4394	7609	11993	17001	20581	26877	33956	42265	61174
	550	1888	4285	7420	11696	16580	20072	26212	33115	41219	59660
	575	1843	4182	7241	11414	16180	19587	25579	32316	40223	58219
	600	1799	4083	7070	11145	15798	19125	24975	31553	39274	56846
	625	1758	3989	6908	10888	15434	18684	24400	30826	38369	55536
	650	1718	3899	6752	10643	15087	18263	23850	30132	37505	54285
675	1680	3813	6603	10408	14754	17861	23325	29468	36679	53090	
700	1644	3731	6461	10184	14436	17476	22822	28833	35889	51946	

Figure C-11B Watertube Maximum MBH Input by FGR Size and Stack Temperature											
12 PPM NOx on Watertube Boiler											
	Duct Size	4	6	8	10	12	14	16	18	20	24
Gross Stack Temperature (oF)	175	3124	7089	12275	19348	27427	33202	43359	54779	68183	98688
	200	3005	6820	11810	18615	26388	31944	41717	52704	65600	94950
	225	2896	6571	11379	17936	25425	30778	40194	50780	63206	91485
	250	2794	6340	10978	17304	24530	29695	38779	48992	60980	88264
	275	2699	6124	10605	16715	23695	28685	37460	47326	58906	85261
	300	2610	5923	10256	16166	22916	27741	36228	45769	56968	82457
	325	2527	5734	9929	15651	22186	26858	35074	44311	55154	79831
	350	2449	5557	9623	15168	21501	26029	33991	42944	53452	77367
	375	2375	5391	9335	14714	20858	25249	32974	41658	51852	75050
	400	2306	5234	9063	14286	20251	24515	32015	40447	50344	72869
	425	2241	5086	8807	13882	19679	23823	31111	39305	48922	70810
	450	2180	4946	8565	13501	19139	23168	30256	38225	47578	68865
	475	2121	4814	8336	13140	18627	22549	29447	37203	46306	67024
	500	2066	4689	8119	12798	18142	21962	28680	36234	45100	65278
	525	2014	4570	7913	12473	17681	21404	27952	35314	43955	63621
	550	1964	4457	7717	12164	17244	20874	27260	34440	42867	62047
	575	1916	4349	7531	11870	16827	20370	26602	33608	41832	60548
	600	1871	4246	7353	11590	16430	19890	25975	32816	40845	59120
	625	1828	4149	7184	11323	16052	19431	25376	32059	39904	57758
	650	1787	4055	7022	11068	15690	18994	24804	31337	39005	56457
675	1748	3966	6867	10825	15345	18575	24258	30647	38146	55213	
700	1710	3880	6719	10591	15014	18175	23735	29987	37324	54023	

into the duct will prevent the system from working properly. It is sufficient to only inspect the welds for a proper seal, they do not need to be leak tested.

9. Draft and Stacks

Stacks and breechings must be designed to maintain a relatively constant draft at the boiler outlet without large variations. The draft at the boiler outlet should be maintained within +/- 0.1" wc. at low fire and up to +/- 0.25" at high fire, with intermediate draft proportional to firing rate. More important than the actual draft is the variation in draft at any given firing rate. For example, a tall stack or multiple units in a single stack may have different draft conditions depending on the outside temperature and the number of units running. The draft variation at any given firing rate should be controlled to within +/- 0.1" wc.

The stack should be designed to avoid wind influences from adjacent structures as well as preventing the flue products from entering inlet ducts, windows or other occupied areas. It should be of sufficient height to extend above the roof of the building or adjoining buildings to avoid down drafts in the stack or the possibility of carrying combustion gases to undesirable locations. Local codes should be checked for criteria on heights and exit velocities.

The breeching should be designed to be as straight and short as practical, to minimize pressure fluctuations. Smooth bends, gradual transitions, low velocities and tight construction are all important. Round breechings are preferred to square or rectangular ducts because they are more efficient and less likely to generate noise on the flat side due to resonance. The size should be based on a maximum velocity of 30 ft/sec. Changes in direction must be as slow as possible. Circular elbows should be of at least a four piece construction with a centerline ra-

dius that is at least double the duct diameter (use three times the duct width for square ducts). The breeching should have a slight upward elevation (about 1" per foot) towards the stack to help induce a draft. Figure A shows the total BHP that can be fired within different breeching diameters. These can be multiple boilers of different size.

CAUTION
OIL BURNING EQUIPMENT SHALL BE CONNECTED TO FLUES HAVING SUFFICIENT DRAFT AT ALL TIMES, TO ASSURE SAFE AND PROPER OPERATION OF THE BURNER.

The connection of the breeching to the stack or multiple boilers to a common breeching or stack must be done with care. The ducts should never be connected at a 90 degree angle, but rather a 45 degree angle where the flows will easily join each other. When connecting multiple boilers into a single breeching, the breeching size must be increased to accommodate the larger flow rates before the introduction of the added flow. These breeching size changes must be gradual, with no more than a 10 degree slope change in the duct. When multiple breechings are connected into a common stack, their locations must be staggered to prevent the flow of one breeching interfering with another.

Figure C-13
Maximum BHP in a Breeching

Breeching Diameter (D)	Total BHP
16	200
18	300
20	400

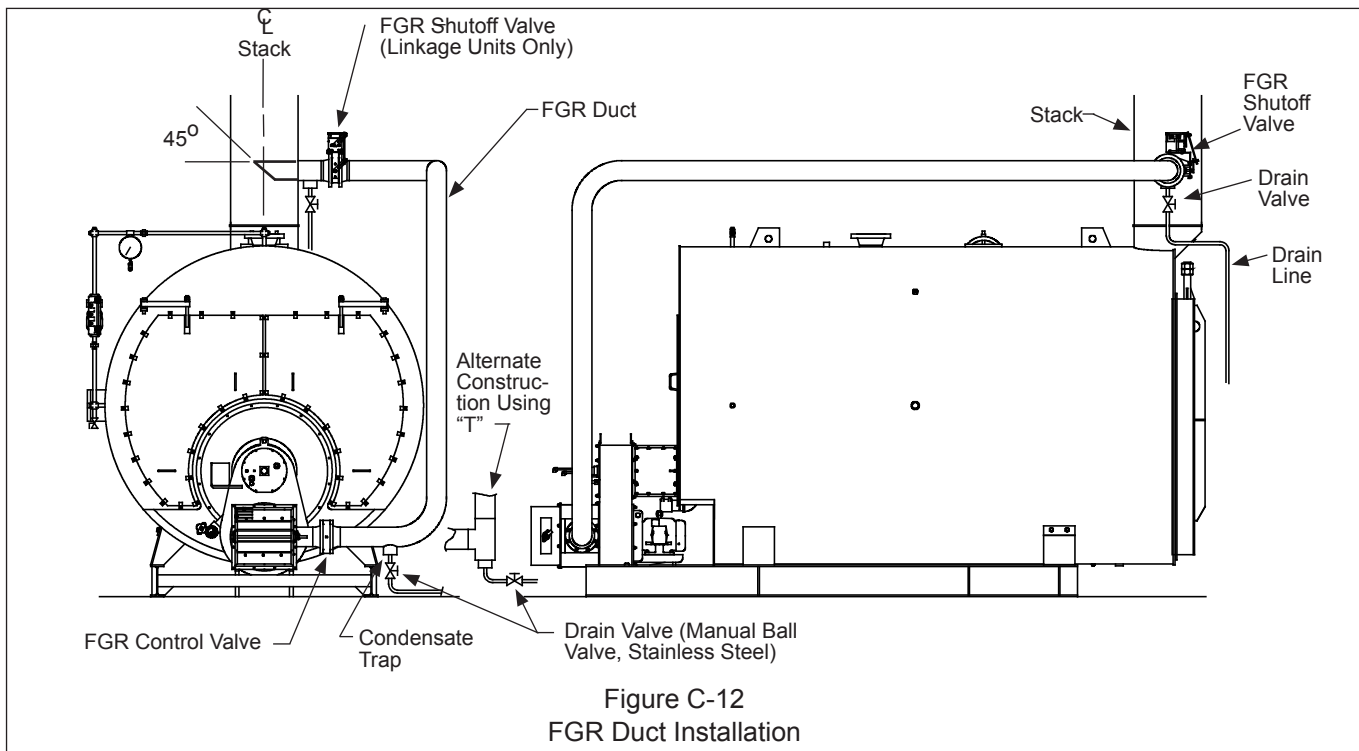


Figure C-12
FGR Duct Installation

22	500
24	700
26	900
28	1100
30	1400
32	1600
34	1900
36	2200
38	2500
40	2900
42	3200

Tall stacks can generate large drafts, and in fact the amount of the draft is related to the stack height. Also, systems with multiple boilers can have draft variations that are well beyond the desired level. These conditions must be corrected to allow the burner to work properly, or the draft variations will cause combustion problems. Controls can be added to compensate for this draft, and bring it back into the desired level. The barometric damper is the most common and least expensive control. Several barometric dampers can be added to provide the total correction to the system draft.

Draft controls are also available to regulate the draft by controlling an outlet damper. The speed of response is critical to allow these units to work correctly. If the draft control does not operate much quicker than the burner changes rate, the result may be large swings in draft as the control attempts to catch up with the burner. A feed forward control is the best means of performing this control. If there are large drafts due to tall buildings, special consideration must be given to the type of damper needed to regulate this draft, and the response of the control to maintain the proper draft.

10. Electrical System

The burner is supplied as standard, with a remote control panel. The panel is either intended for floor or wall mounting. The proper location will allow the operator to see the burner operate while manning the controls. In some areas, there are local regulations that define where the control panel must be mounted in relation to the vessel.


The control panel must be securely attached to either the floor or the wall. This should include lag bolts into the floor or wall.

The wiring diagram for the specific job should be followed for the connections to the panels and external equipment. The National Electric Code, Canadian Electrical Code, Part 1 or similar code for other jurisdictions should be followed.

The following list covers the standard acronyms used on wiring diagrams:

- AUX. – Auxiliary
- CB – Circuit Breaker
- C.C.W. – Counter Clock-Wise
- C.W. – Clock-Wise
- CR() – Control Relay
- FGR – Flue Gas Recirculation
- FTS – Fuel Transfer Switch
- GND – Ground terminal
- H.W.C.O. – High Water Cut Off
- INT – Interlock
- L – 120V line
- L.F.H. – Low Fire Hold switch
- L.W.C.O. – Low Water Cut Off
- MR – Manual Reset
- N. – 120 V Neutral
- N.C. – Normally Closed
- N.O. – Normally Open
- P.L.F.S. – Proven Low Fire Start
- P.O.C.S. – Proof Of Closure Switch
- SW. – Switch
- TDR – Time Delay Relay

Figure C 14
Method of Connecting
Breechings and Stacks

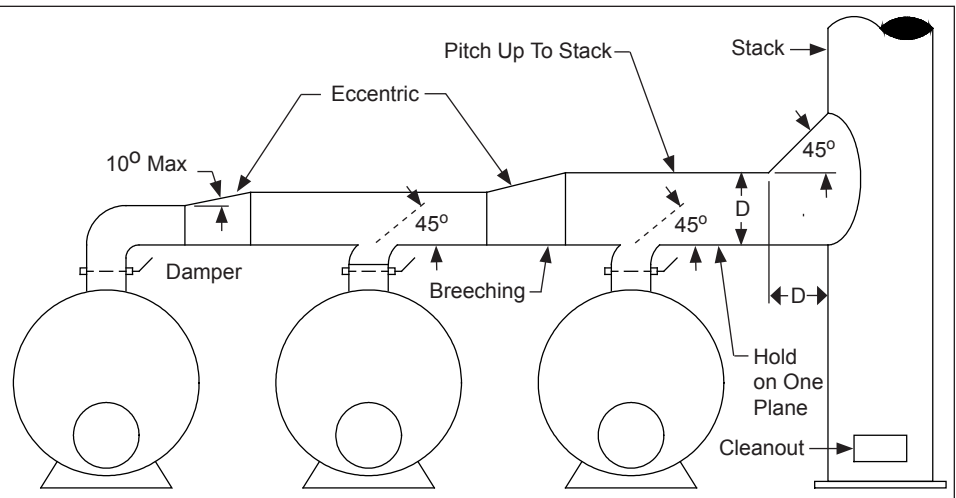

D. Fuel and Electrical Systems

- | | |
|----------------------------|--------------------------------------|
| 1. Gas Systems | 5. Electrical Controls |
| 2. Gas Pilot | 6. Operating and Modulating Controls |
| 3. Air Atomized #2 Oil | 7. Flame Safeguards |
| 4. Fuel-Air-Ratio Controls | |


The burner can be equipped with a wide variety of fuel and operating systems to control the fuel, air, modulation and safety. This section describes how these systems operate and their common components.

Each of the applicable systems must be completely understood prior to operating any equipment. In addition to the basic principles defined here, the component details and specific combination of components on your specific unit must be fully studied and understood. The fuel diagrams, wiring diagram, component manuals and bill of materials for the unit must be included in the study.

1. Gas Systems

All gas fuel systems have a common group of components, including the pressure regulator, shutoff valves, gas control valve and pressure switches. In addition, some systems use a vent valve, pressure switches and proof of closure switches. The type and location of these components can vary with the different applicable regulations, insurance and component supplier.

Figure D-1 shows the common gas trains arrangements used on the HDRMB burner line. There may be other lo-

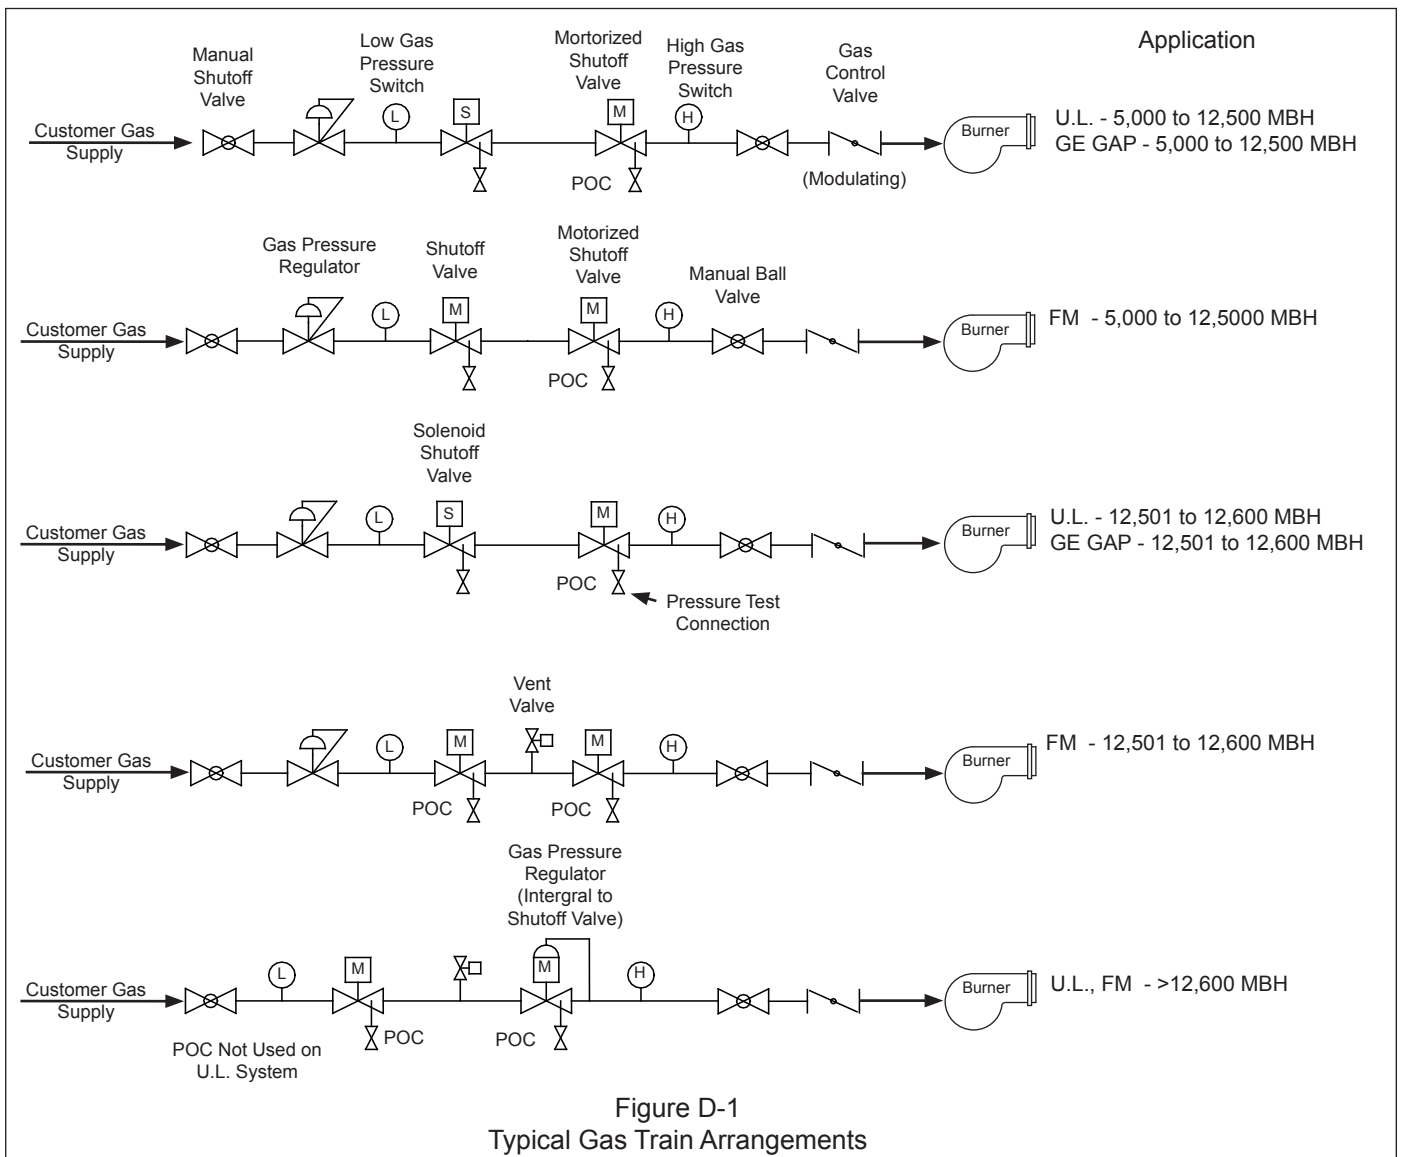

cal or job site requirements that can alter the components in addition to those outlined in this summary.

All gas and oil systems for the HDRMB burner are full modulating. The two gas safety shutoff valves are either motorized or solenoid type and are controlled by the flame

safeguard to provide safe control of the fuel flow.

The gas control valve is a butterfly valve used to control the flow of gas from the low fire to the high fire input. The butterfly valve is driven by a fuel cam (linkage system) or a direct coupled actuator. There are different types

of gas control valves used, which may use mechanical low fire stops and/or may be internally ported as a smaller size.

A vent valve is provided in some applications to allow gas that may leak past the first valve to escape to a safe point of discharge. **Vent valves are not used on propane fuels that are heavier than air or fuels that could be toxic.**

A gas pressure regulator is used to provide a constant supply pressure to the gas train and butterfly control valve. This constant pressure through a variable orifice in the gas control valve obtains consistent gas flow rates. The regulator must be capable of operating through the full range of flows and pressure with consistent and steady pressures. The regulator may be located upstream of the safety shutoff valves or integral with the second safety shutoff valve.

The high and low gas pressure switches are used to detect an improper gas pressure situation and will prevent the burner from firing under these conditions. The low gas pressure switch is located near the supply of gas to the gas train, to detect a loss of supply pressure. The high gas pressure switch is located before the metering valve to detect a surge in pressure to the burner.

The gas train is designed to work with the pressure available at the job site. This supply pressure generally refers to the pressure available at the entrance to the gas train, which is the pressure supplied to the gas trains shown in Figure D-1. The supply pressure may vary depending on the operation of the unit, in which case a minimum and maximum pressure are needed to define the supply pressure. The maximum pressure is the static pressure, or the pressure in the line when there is no flow. The leading components of the gas train are selected to operate up to these pressures. The minimum, or dynamic pressure is that pressure available when the unit is operating a full rate, or the reduced pressure due to the flow in the line. The gas train is sized to this pressure, so that it can deliver the required flow to the burner with this available pressure. The job site supply pressures must be consistent with the pressures listed on the burner material list.

The regulated gas pressure is that pressure required to overcome the pressure drops in the piping, firing head and furnace pressure to deliver the required flow at high fire. Usually, one of the first steps in setting up gas combustion is to adjust the regulator to get rated capacity. This regulator is usually at the beginning of the train, but in some cases, it can be integral to the second shutoff valve. The pressure drops and regulated pressures will be different in these two designs.

The manual valves are provided to lock out the fuel flow during off times and during initial startup checkout. They provide an added level of safety and can simplify maintenance.

The gas piping plays a critical role in the operation of the system. Throughout the system, the piping must carry the required flow without significant loss of pressure. If the drop is too high, there may not be enough pressure to operate the burner a full capacity. This is especially true between the gas train and the burner, where the pressure is lowest. The piping between the train and burner should have a minimum number of elbows and / or turns to prevent high pressure drops.


2. Gas Pilot

Figure D-2 show the typical gas pilot systems. Like the gas trains above, they have the common components of a pressure regulator and shutoff valve. The gas line connects upstream of the gas pressure regulator in the gas train.

The gas pilot is positioned behind the diffuser, with the pilot flame passing through the diffuser. The flame must be large enough to pass in front of the scanner tube for the Flame Safeguard to detect the pilot flame and allow the burner to start. This also insures that there is sufficient pilot flame to ignite the main fuel.

The gas pilot can operate with either natural gas or propane. Different internal orifices are used to regulate the gas flow and maintain the same pilot size with the two different fuels.

The safety shutoff valves determine if the burner is allowed

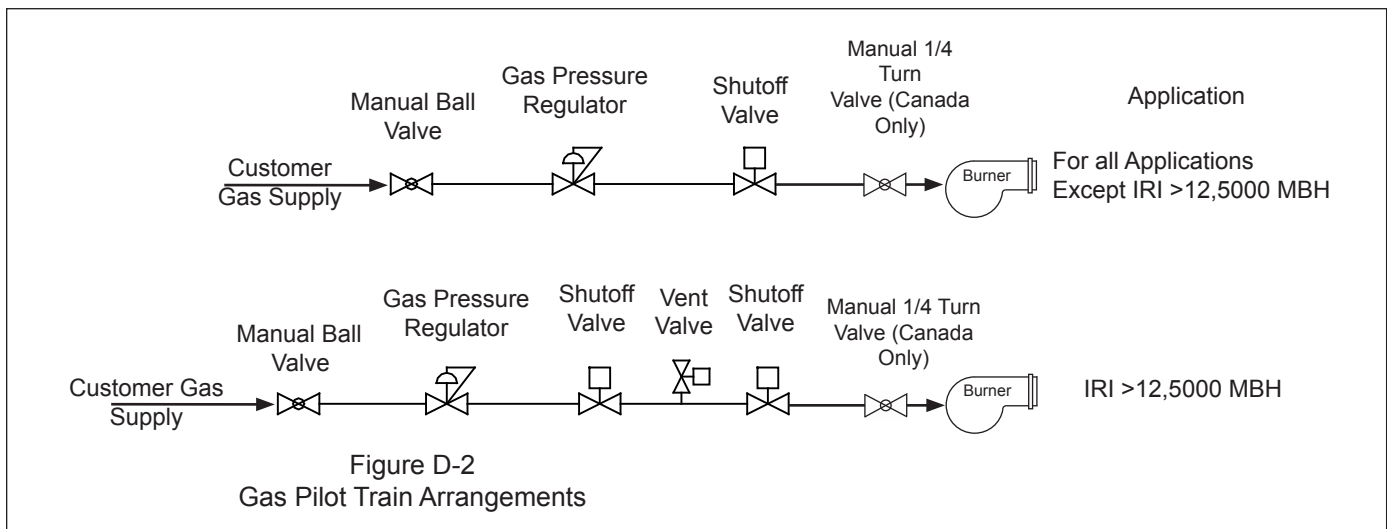

to fire on oil, as controlled by the flame safeguard system. These valves are the solenoid type except units over 89 GPH with FM or IRI insurance, where the valves are motorized with POC (proof of closure) switches to prove closed position prior to allowing the unit to operate.

The low oil pressure switch is used to prove sufficient oil supply to the burner. It is adjusted to a pressure that is below the minimum pressure expected at that location in the system. Four check valves are used to prevent backflow in the air line, fuel supply line, return line and suction line.

3. Air Atomizing #2 Oil

An air atomizing system uses compressed air to atomize the oil. The oil pump and oil pressure regulating valve are optional and may be provided by others.

Figure D-4 shows a schematic of the air atomizing #2 oil system. The oil nozzle has two inputs, oil and air. Oil is supplied to the system at 125 PSIG. An optional remote pump assembly may be used, or it can be provided by other systems. In either case, a backpressure regulator is required to provide a constant pressure to the system.

The oil metering valve regulates the flow of oil to the nozzle and is used to vary the oil flow rate from low to high fire. Modulation is obtained by a fuel cam (linkage system) or by a direct drive actuator.

An air compressor is used to supply air for atomization. The air compressor is provided as a separate assembly and is field piped to the burner. The compressor should be located as close as possible to the burner to prevent loss of airflow. Also, the piping should be done to minimize the use of elbows and turns that result in pressure loss. The following chart should be used to determine the minimum size (Figure D-5).

Atomizing Air Line Minimum Pipe Size		
	Piping Length (feet)	
Boiler HP	0 - 100 feet	100 - 200 feet
200 - 350	1 inch	1 1/4 inch
400 - 600	1 1/2 inch	2 inch
600 - 1200	1 1/2 inch	2 inch

Figure D-5 Air Atomizing Pipe Size

The atomizing airflow rate is regulated by the bleed valve, which can bleed off the excess air not required for good atomization. In some systems, especially with lower turndown rates, the bleed valve is set manually and does not vary. In other systems, especially with higher turndowns, the bleed valve is modulated with firing rate, by connection to the jackshaft or by a direct drive actuator.

4. Fuel-Air-Ratio Controls

All HDRMB burners are full modulation. That means that they can modulate from a lower input to a higher input, based on a measured need for more or less input. The system that adjusts the fuel and air flow is called fuel-air-ratio control and is covered in this section.

For proper operation, the rate of fuel and air flow must be closely matched for clean and efficient combustion. Too little combustion air and not all of the fuel will be burned, wasting fuel and increasing emissions. Too much air and the energy is wasted in heating this excess air to a relatively high stack temperature.

There are two common types of fuel-air-ratio controls, single point positioning (linkage) and parallel positioning (linkageless). The linkage system uses mechanical shafts and connection links to physically tie the air and fuel control valves together. A modulating motor is used to modulate the valves from low to high fire by providing a 90 degree rotation that matches the firing rate required (see section 8). A long shaft, called the jackshaft is used to distribute this 90 degree rotation to each valve. Linkage arms are connected from the jackshaft to the valve. By adjusting the positioning of the linkage, the air and fuel valves can be set to match each other. A fuel cam is used to provide some improved flexibility in adjusting the intermediate fuel rates, to match the air damper settings. The FGR control valve will be tied together with the other valves to provide the correct flow at each firing rate.

The linkageless system uses independent electric actuators for each fuel, air and FGR valve. These are driven by a controller, which is programmed to set the correct position of each valve at multiple firing rates. The linkageless system offers more flexibility in adjusting the valves, including low and high fire positions and different FGR rates for each fuel.

An optional multiple position modulation motor can be used on a linkage system to provide different low and high fire settings for the different fuels, expanding the turndown capabilities of individual fuels.


5. Electrical Controls

The burner is provided with a junction box on the burner and free standing control panel as standard. An integral control panel is provided as an option. The unit specific wiring diagram shows the wiring details of all these components, including the interconnecting wiring that may be required in the field. The motor starters for the oil pump and air compressor (if provided) are also included inside the control panel.

In some cases, the burner wiring diagram shows the interconnection of all the vessel safety and operating controls, like the low water cutoff. In other cases, these are shown on a separate diagram supplied by the vessel manufacturer. In all cases, these controls must be integrated together.

6. Operating and Modulating Control

Burner operation, for on-off cycling and modulation are controlled by the boiler steam pressure or hot water temperature variation from set point. Parallel positioning systems generally use sensors to measure temperature or pressure and are programmed in a unique method, not covered in this manual. Refer to the control manual, provided with the burner, for complete details on setting the controls.

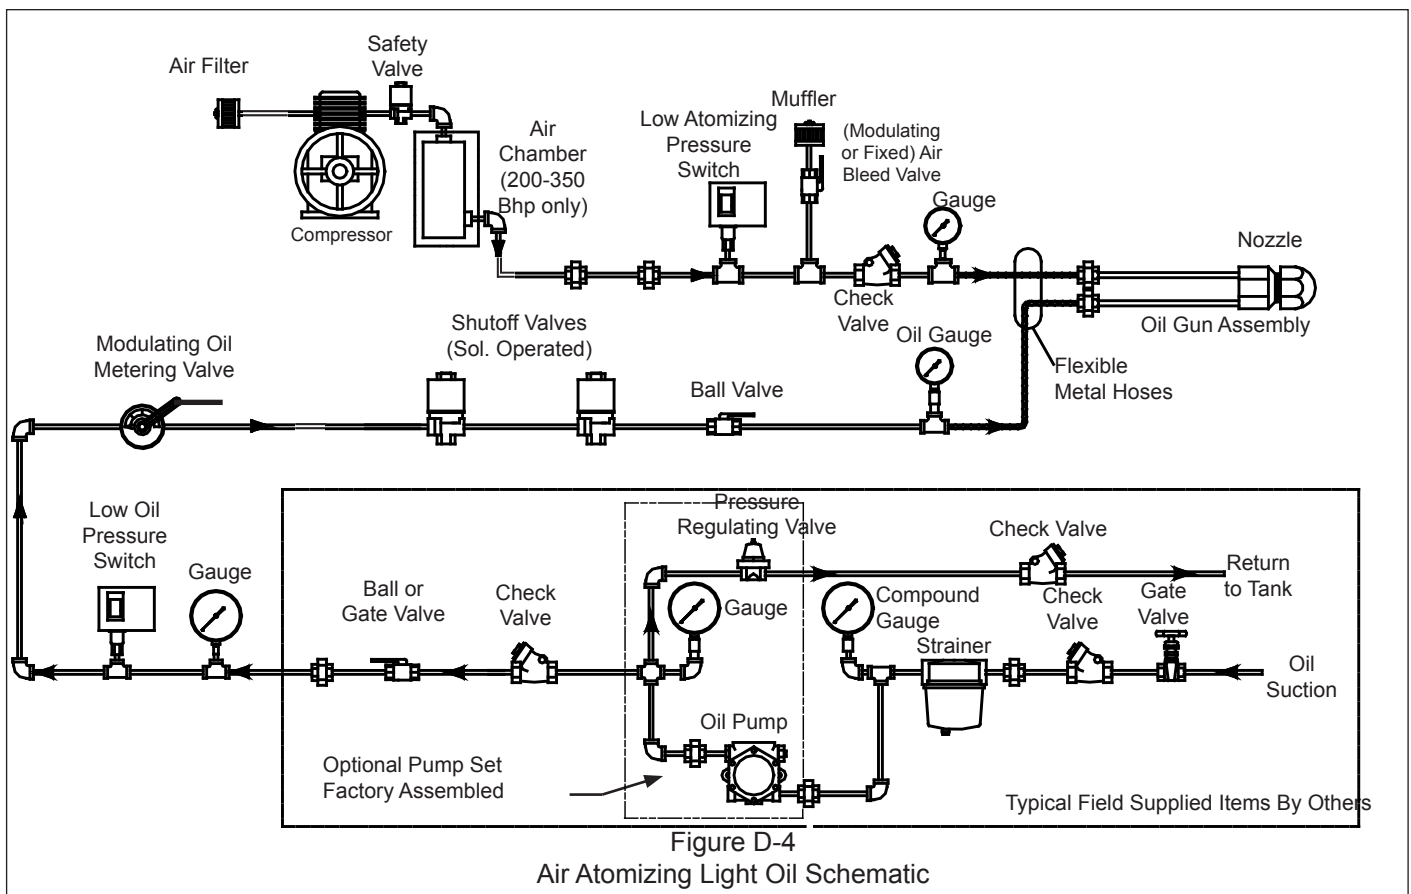

The standard equipment will include a high limit control, an operating control and a modulating control (not normally supplied with the burner). All of these controls are piped to the steam or hot water piping connected to the vessel. These three controls must be adjusted to function together or the burner will operate inefficiently and provide poor system response. If excessive on-off cycling occurs, the components will wear out prematurely. Figure D-8 shows the relationship between the temperature or pressure and burner firing rates.

The high limit control senses the hot water temperature (vessel outlet) or steam pressure. It is used as a safety limit to turn the burner off if the operating control fails. If this limit is tripped, the burner will remain off and will have to be manually reset. The high limit control should be set sufficiently above the operating control (pressure or temperature) to avoid nuisance shutdowns. The high limit control cannot be set above the temperature rating of the vessel or connected piping. This point is indicated on the far right of Figure D-8 and represents the highest temperature or pressure available.

The Operating Control senses the temperature or pressure and automatically turns the burner on to initiate the startup sequence when the temperature or pressure drops below the "Burner On" point ("B" on Figure D-8) and initiates the shut down sequence when the load is satisfied and the temperature or pressure rises above the "Burner Off" point ("A" on Figure D-8).

The modulating control senses the temperature or pressure and signals the modulating motor to set the fuel and air input rates at a level consistent with the indicated tem-

perature or pressure. An increasing load will cause the temperature or pressure to drop and the modulating motor will sense this lower level and increase the fuel and air input accordingly, starting modulation from low fire at point "C" and arriving at high fire at point "D" (Figure D-8). This control must be set to allow normal shutdown at low fire.

As Figure D-8 shows, there should be clear separation between each of the control points for the system to work properly. If the controls are positioned too close to each other, or even overlapping, the burner will have excessive ON-OFF cycling that reduces efficiency, increases wear and can cause premature failure of the components. Standard burner motors in the HDRMB size range should not cycle on and off any more than 2 to 4 times per hour.

7. Flame Safeguards

Several different FSG (Flame Safeguards) are offered for the HDRMB. They all perform the common function of controlling the process of pre-purge, pilot trial for ignition, main trial for ignition and flame safety as well as monitoring limit switches and sensors. The actual details of operation can vary. The manual for the specific FSG is included with the burner and should be studied carefully prior to installation, startup or operation.

The operating sequence, especially the sequence of when the limit switches are checked, will be an important tool in troubleshooting the burner.

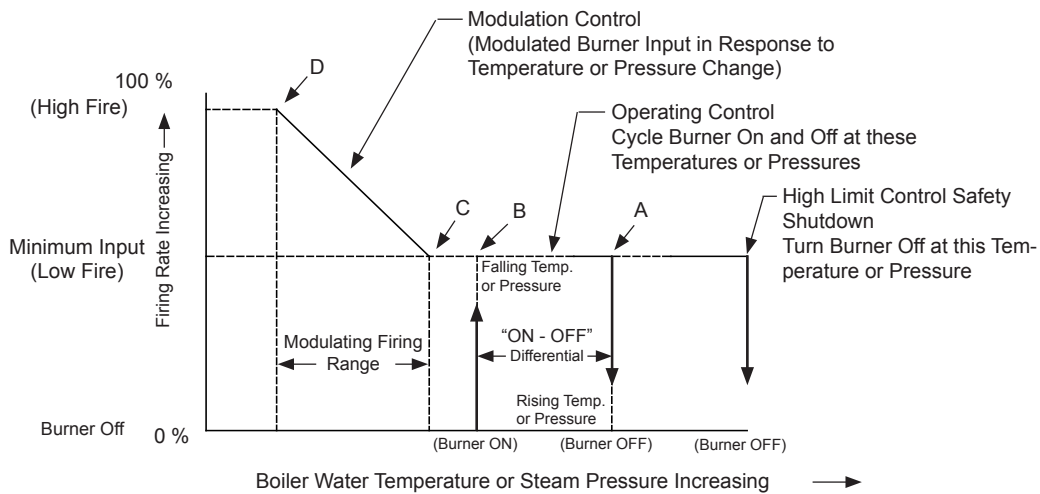


Figure D-8
Operating and Modulating Control

E. PRELIMINARY ADJUSTMENTS

1. Visual Inspection
2. Motor Rotation
3. Oil Gun Setup
4. Fuel, FGR and Air Control
5. Fuel Cam Adjustment
6. Air Damper Adjustments
7. Pilot and Scanner Adjustments
8. Gas Train Adjustments
9. Oil Train Adjustments
10. Air Proving Switch Adjustments
11. Operating and Modulating Controls

The burner is adjusted at the factory to fire into a test vessel. There may be significant differences in the furnace size, furnace pressure, air density, fuel properties and other conditions that must be covered by field adjustments and combustion testing. In addition, several checks and adjustments are required prior to startup. This section covers these preliminary checks and adjustments.

WARNING

ADJUSTMENTS DEFINED IN THIS SECTION ARE ONLY INTENDED TO COVER THE INITIAL BURNER STARTUP. FINAL ADJUSTMENTS AS DEFINED IN SECTION F MUST BE DONE TO PROVIDE THE FULL SAFETY OF THE SYSTEM. FAILURE TO PROPERLY ADJUST THE CONTROLS COULD RESULT IN INJURY OR DEATH.

CAUTION

BURNER ADJUSTMENTS SHOULD ONLY BE PERFORMED BY TECHICIANS TRAINED AND EXPERIENCED IN THIS WORK. FAILURE TO USE PROPERLY TRAINED AND EXPERIENCED TECHNICIANS COULD RESULT IN EQUIPMENT DAMAGE, PERSONNEL INJURY OR DEATH

1. Visual Inspection

The shipment and installation of the burner can result in loose connections, bent arms and other changes. The burner should be visually inspected for any unusual conditions before operating.

- All wiring connections are tight. Test pulls on wire show them to be tight.
- All fuel lines are tight.
- Burner is mounted to vessel and floor, with all bolts secured.
- The linkage and cams are tight.
- The linkages, cams and valve actuators are aligned and have not been bent during installation.
- The air damper, FGR line and control valves are tight.
- The oil lines are tight.
- Servo motors, couplings and valves are aligned.

The burner is adjusted at the factory with initial settings for this application. These settings may be different than the initial values in the chart, these positions are based on test firing and should be used.

2. Motor Rotation

The combustion air fan, air compressor and oil pump motors must be checked for proper rotation. The motors can be momentarily powered by pressing the mechanical actuator on the starter. This should be done with a wood block for insulation value.

The combustion air fan rotation is marked with an arrow on the windbox. The rotation can be observed within the motor to verify correct rotation, or if this is not accessible, the burner drawer can be removed to directly observe the fan. The oil pump has a slot between the motor and pump where the rotation can be observed. An arrow on the pump shows the correct rotation.

3. Oil Gun Setup

If the burner is equipped for oil firing, the oil nozzle position should be set as shown in Figure E-1. These are initial settings, and the final nozzle position must be determined at setup. The oil nozzles used in the HDRMB are different from standard burners, and are designed to maintain the spray angle with the much higher air velocity of this burner. Do not attempt to use standard oil nozzles.

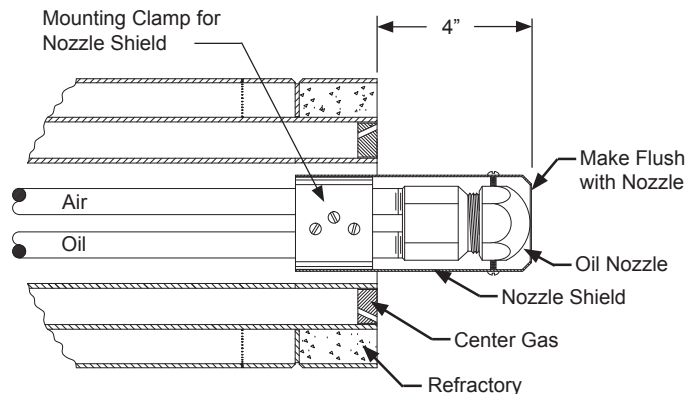


Figure E-1 Oil Nozzle Setting

There is a switch on the oil gun used to prove the position of the oil gun and allow oil firing. The bracket that activates the switch must be positioned to engage the switch when firing oil. The oil gun, when firing gas, should be either removed or pulled back about 6".

The cooling air provided to the oil gun has a manual ball valve in the line. This valve should be in the full open position when firing oil. If the oil gun is removed, the valve can be closed. The cover plate must be placed over the oil gun opening when the oil gun is removed.

4. Fuel, FGR and Air Control

The fuel and air valves have initial positions set at the factory. Differences in air density, fuel properties and supply pressure will require tuning of the burner. The initial positions of the air damper, FGR valve, gas valve and oil valve should be adequate for initial startup, but must be checked so that movement did not occur during shipment or installation. If this is a linkage burner, the linkage

should be adjusted to allow for modulation from low to high fire, with each valve opening 45 to 90 degrees. This should be checked by one of the two methods below.

Honeywell Brand Modulation Motor:

The modulating motor can be operated by removing the cover, and removing the yellow wire to drive the motor to the high fire position. Connecting the yellow wire will cause the motor to drive to low fire position. This is a low voltage (24 VAC) wire that can be handled safely, however, care must be used as high voltage is also present.

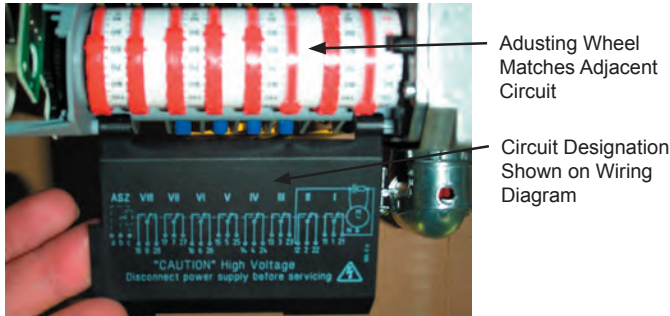


Figure E-3 Multiple Setpoint Modulation Motor (Landis)

Landis Brand Modulation Motor:

This motor has multiple set points, one for gas and one for oil. Removing the cover will expose a manual/auto switch that will allow the motor to be cycled manually to check the linkage and valve positions.

CAUTION
IN MANUAL POSITION, END STOPS DO NOT LIMIT TRAVEL ON THE MULTIPLE SET POINT MODULATION MOTOR. MONITOR AND DECREASE TRAVEL IF THE VALVES APPROACH FULL TRAVEL TO PROTECT THE VALVES FROM DAMAGE.

Figure E-3 shows the internal settings of the multiposition modulation motor. Each adjustable cam setting is related to an electrical connection (or circuit in motor). These circuit numbers are listed on the wiring diagram so that the low and high points of each fuel are identified. These would be adjusted independently to obtain the input rates. The valves and linkage should operate smoothly without strain or jerky actions. If this occurs, check for binding linkage and rod ends that are not within their range of motion and readjust as required.

The FGR valve will modulate with the fuel and air valves and it should travel from the near closed low fire position to a position that is about 45 to 90 degrees open at high fire. Dual fuel units can have additional controls, preventing or limiting FGR from flowing during oil firing. The oil combustion is generally better when some FGR is used at low rates thus NOx level will be reduced.

On combination fuel, linkage burners with FGR, the shutoff FGR valve may require adjustment for oil firing.

5. Fuel Cam Adjustments

The fuel cam needs to be checked for correct travel and alignment. Positions can change during shipment and installation and they must be reviewed prior to startup. The

fuel cams are mounted to the ends of the jackshaft assembly. A cam follower link follows the profile established by the adjusting screws and drives the fuel valve. A thin metal band is used between the screw and cam follower to provide a smooth profile. The adjusting screws are backed by compressed nylon inserts, which provide a resistance to turning.

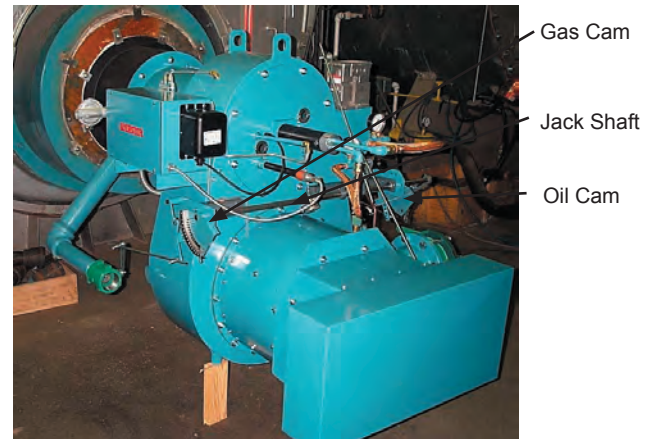


Figure E-7 Typical Linkage

The cam (Figure E-5) should be checked for the following conditions:

- a. At the low fire position, the roller should be between the first two adjusting screws. If not, adjust the position of the cam accordingly, making sure to maintain the same low fire fuel valve position.
- b. When the linkage is modulated from low to high fire, the roller must stay in the center of the adjusting screws within 1/8". If needed, the two cam set screws can be loosened and the cam moved to center it on the roller.
- c. At high fire, the roller should be between the last two adjusting screws.
- d. The adjusting screws should form a smooth contour with no jumps between the screws.
- e. In preparation of startup, the retention plate can be removed temporarily to make it easier to adjust the screws.

THE RETENTION PLATE MUST BE REPLACED WHEN SETUP IS COMPLETE.

If the unit is equipped with a parallel positioning system (linkageless), the control valves can be positioned and operated in a similar manner, but accomplished through the controller. Refer to the instruction manual for details.

CAUTION
LINKAGE AND ACTUATOR MOUNTINGS CAN BE BENT OR MOVED DURING SHIPMENT AND INSTALLATION. THEY MUST BE CHECKED PRIOR TO OPERATION AND ANY FAULTS CORRECTED. FAILURE TO CORRECT A MISALIGNED CONTROL WILL RESULT IN PREMATURE FAILURE.

6. Air Damper Adjustments

Low fire is set at the factory to an approximate position (usually about 15° to 20° with aluminum damper and 5°

for steel damper). Turndown and low fire air requirements will dictate actual position. High fire position is typically 30° to 60° open, depending on the application. The combustion settings and pilot setup will determine final position.

Linkage adjustments are done as with any other equipment. The damper is configured with a slow opening profile, so that the change in airflow from low fire is more gradual than a typical air damper. Extreme linkage setups that attempt to slow the damper opening off of low fire are not required.

7. Pilot and Scanner Setup

The pilot and assemblies are located in the refractory front plate. They should be piped as shown in Figure C-3.3 and C 3.5. Figure E-6 shows the internal components of the pilot.

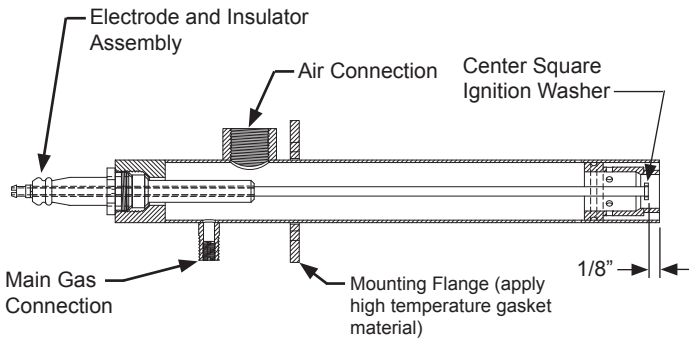


Figure E-6 Pilot Detail

The pilot is supplied with a gas and air mix from the piping shown in Figure C-3.3. The electrode in the pilot is connected to the ignition transformer, and when energized,

will create a spark at the end of the pilot to ignite the gas and air mix. The raw gas supply provides some additional gas to increase the pilot size.

For initial setup, the air damper should be set to create a positive air pressure of 0.8 to 1.2" wc as measured at the pilot air connection (see Figure C-3.5). The main gas pressure to the pilot should be set for 10" to 16" wc at the pilot. The pilot gas pressure regulator can be used to adjust this pressure (see Figure E-8). The raw gas manual ball valve should be in the full open position initially, and can be adjusted if required. The pilot should be adjusted from these initial positions to obtain a stable pilot that generates a strong flame signal from the scanner. The light-off position may be different for the pilot and the low fire burner position, and the controls should be adjusted accordingly.

The scanner has an air cooling line to keep the scanner free of moisture and to help keep it cool. The opening in the refractory should be checked to insure that it is open and there is no refractory blocking the view of the flame.

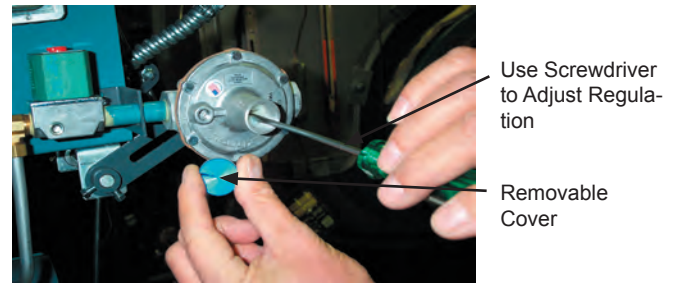


Figure E – 8 Gas Pilot Regulator Adjustment

8. Gas System Adjustments

The gas pressure regulator should be set to the required gas

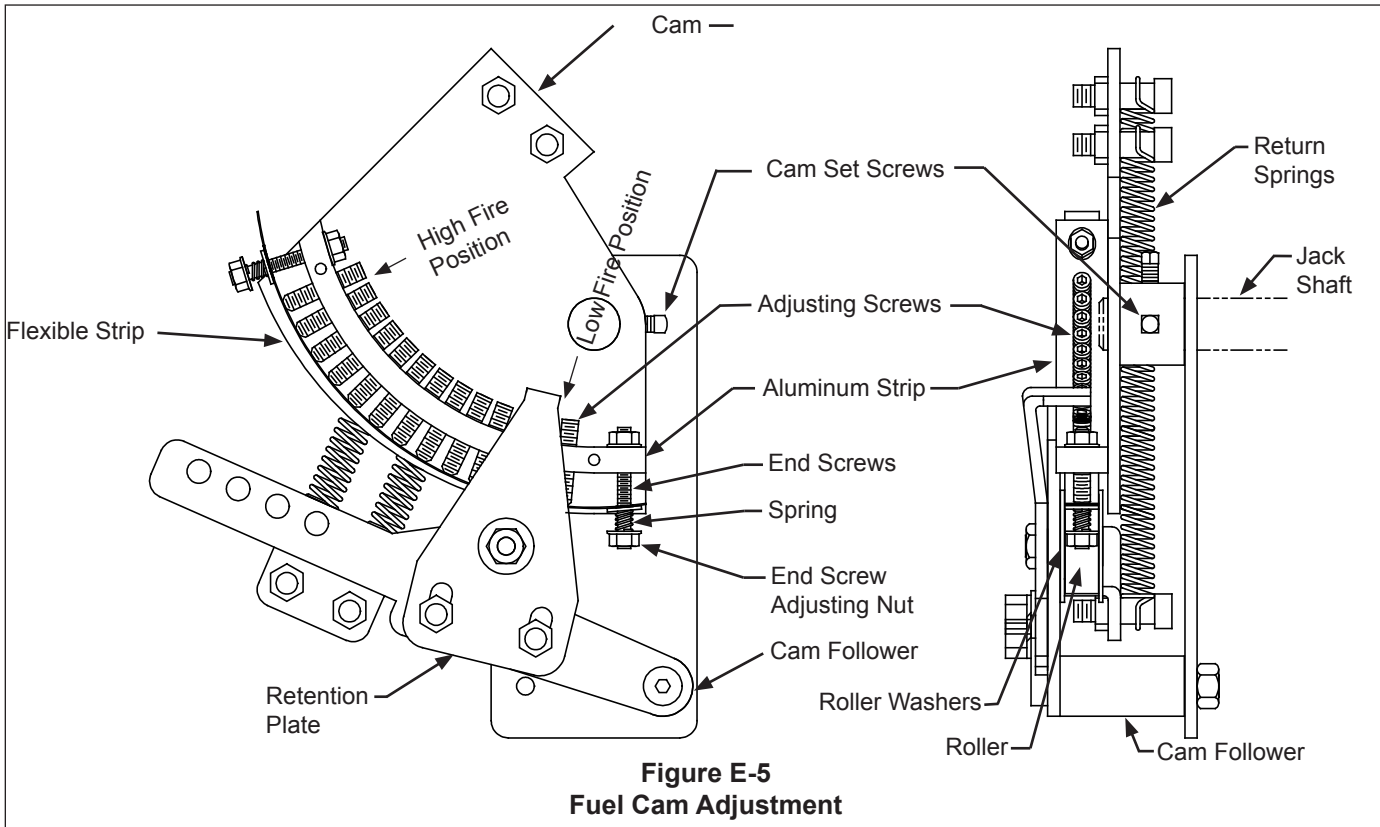


Figure E-5 Fuel Cam Adjustment

pressure. If this value is not known, a value of approximately 50% over the high fire gas manifold pressure (given on burner nameplate) can be used for the initial setting. It will be adjusted at startup to obtain the rated capacity during setup (Figure E-9).



**Figure E – 9
Main Gas Pressure Regulator Adjustment**

The center gas balancing valve is adjusted at the factory for initial light off. It is normally off at four turns open from a full closed position. The low gas pressure switch (if provided) should be set for an initial value of 50% below the lowest expected gas pressure. The high gas pressure switch (if provided) should be initially set at 50% above the highest valve expected at that point. See section B for location of switches (Figure E-10).



Figure E – 10 Gas Pressure Switch Adjustment

9. Oil System Adjustments

The oil pressure supply to the burner should be set for 125 PSIG. The oil pressure regulator is adjusted by removing the cap and turning the regulator screw clockwise (cw) to increase pressure and counterclockwise (ccw) to decrease pressure. The low oil pressure switch (Figure E-12) should be set for a pressure of about 25 PSIG lower than the regulated pressure (Figure E-12).

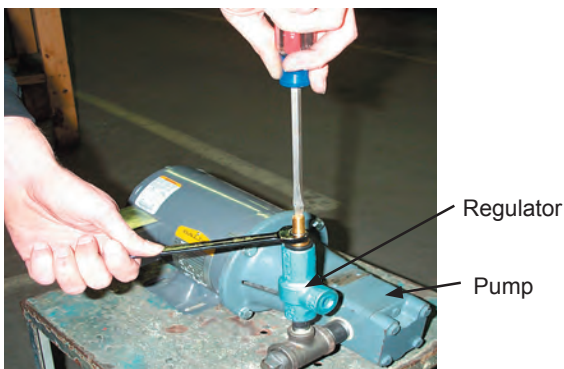


Figure E – 11 Oil Pressure Regulator Adjustment

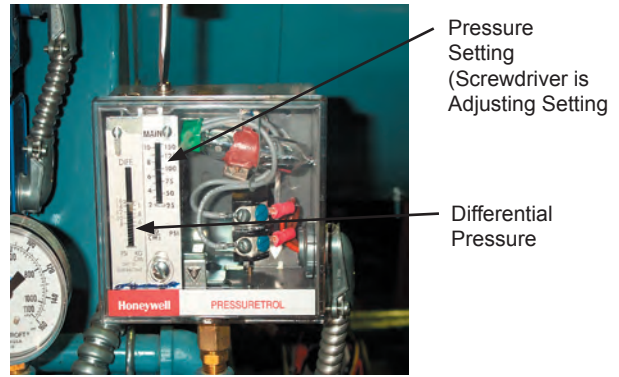


Figure E - 12 Low Oil and Atomizing Air Pressure Switches

10. Air Proving Switch

The air proving switch has been adjusted at the factory for an initial setting. If this switch trips during initial startup, turn the adjustment screw ccw two full turns to reduce the trip pressure setting (Figure E-13).

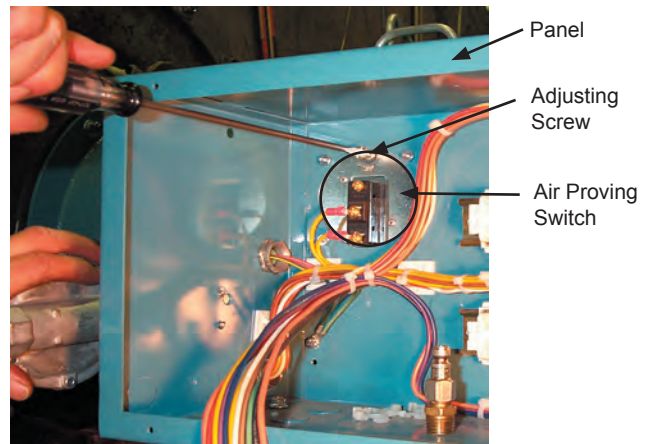


Figure E - 13 Air Proving Switch Adjustment

11. Operating and Modulating Controls

The operating controls will not be used during the burner setup, except that the high limit and operating controls can cycle the burner off and should be set for the highest allowable pressure for the application.

The high limit control should be set at the maximum temperature or pressure allowed for the boiler vessel or piping. The operating control should be set at a high enough pressure to prevent this control from turning the burner off unless the operating temperature or pressure is at the maximum value. The modulating control should be set at a value below the operating control to prevent the unit from modulating immediately after starting.

F. STARTUP and OPERATING ADJUSTMENTS

1. Pre-start Checkout
2. Linkage Adjustments
3. Fuel Cam Adjustments
4. FGR Adjustment
5. Burner Drawer Adjustments
6. Single Fuel Setups
7. Combination Gas and Air Atomized #2 Oil
8. Gas Setup
9. Air Atomized #2 Oil Setup
10. Operating Control Adjustments
11. Limit Tests
12. Pilot Test
13. Burner Shutdown
14. Restarting After Extended Shutdown

This section covers the startup and operating adjustments of the Webster Models HDRMB burner.

WARNING

STARTUP OF AN HDRMB BURNER SHOULD ONLY BE PERFORMED BY A WEBSTER SERVICE PERSON OR A FACTORY APPROVED PERSON. ATTEMPTING TO PERFORM THESE FUNCTIONS WITHOUT THE PROPER TRAINING AND EXPERIENCE CAN RESULT IN DAMAGE TO EQUIPMENT, PERSONAL INJURY OR DEATH.

Before proceeding with the startup and adjustment, be sure that the overall installation is complete. Review the boiler operating and installation manual, as well as all control manuals to verify that all equipment is ready for operation. These manuals must be read and understood prior to starting the equipment.

If you are not qualified to service this equipment, DO NOT TAMPER WITH THE UNIT OR CONTROLS - CALL YOUR SERVICEMAN.

At the conclusion of the startup, document valve and linkage positions, pressures and settings for future reference.

READ AND SAVE THESE INSTRUCTIONS FOR FUTURE REFERENCE.

1. Pre-Start Check List

Before starting the burner, a complete review of the installation, wiring and piping of the burner, boiler and all supporting equipment must be complete and all of these items must be ready for operation prior to starting. The following is a general review:

_____ All wiring is connected. Test pulls on wire show them to be tight.

_____ All fuel lines are connected and tight.

_____ Pilot gas is connected.

_____ Burner is mounted to vessel and floor, with all bolts secured.

_____ The linkage is correct (in low fire position) and tight.

_____ The stack is connected and routed to the outside. Draft controls are installed and operational.

_____ Gas vent lines are connected and routed to the outside.

_____ Do not start the unit unless all cleanout doors are in place and secured.

_____ The vessel is completely installed, filled with water and operating controls checked.

_____ Support equipment is in place and ready (feed pumps, draft controls, steam/hot water systems, boiler limits and controls and feedwater systems).

_____ A load must be available for the burner startup and adjustment process. The burner must be operated at high rates for extended periods of time and the load must be capable of using this energy.

_____ A combustion analyzer with O₂ and CO (for gas) must be available to tune combustion. A smoke spot tester must be available for oil firing. A NO_x analyzer must also be available. All of these analyzers must be recently calibrated and able to provide accurate readings.

_____ Other test equipment, including manometers, gauges and volt meter shall be available.

_____ Manometer or gauge on the gas manifold.

_____ Manometer or gauge before and after gas pressure regulator.

_____ Draft gauge or manometer (at stack outlet).


_____ Draft gauge or manometer for furnace pressure.

2. Linkage Adjustments

Adjusting the air damper and FGR control valve on a linkage system requires an understanding of linkage setups. The rate of change for the fuel valve, air damper and FGR valve must be matched by how the linkage is setup. If the air damper or FGR valve opens too quickly, the flame may become unstable or the NO_x levels may not meet the requirements. There are a few general guidelines that should be followed in setting up the linkage of a burner.

The linkage must provide the correct position and stroke of the valves from low to high fire. There are three adjustments required to properly set the linkage; (1) the initial low fire position, (2) the stroke or amount of travel to the high fire position and (3) the rate of opening, so that the fuel and air change at the same rate. The first adjustment is to obtain the correct low fire position of each valve which can be set by simply adjusting the valve position relative to the driven arm, using the set screws on the driven arm. The stroke and rate of opening are accomplished by linkage adjustments.

Figure F-1 shows how these adjustments are done. The drive arm would be on the jackshaft and the driven arm would be on the valve (gas valve, oil valve, air damper or FGR valve). There are two basic linkage adjustments, the arm length (B) and the angle between the arm and the linkage rod (A). Figure F-1A shows a simple linkage connection where the angles and arm lengths are the same on

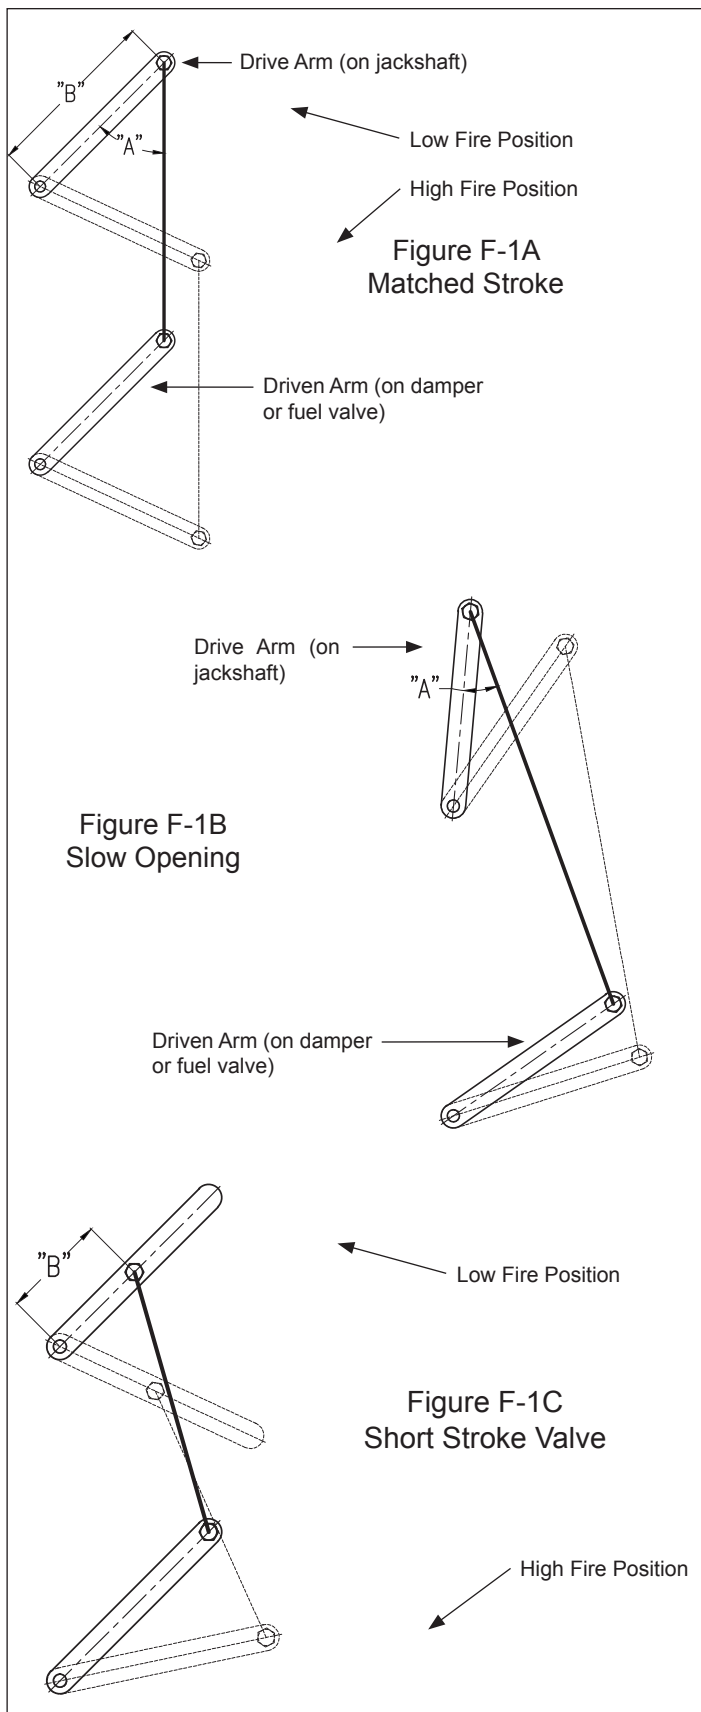

the drive arm and driven arm. In this case, the valve would have the same angular movement as the jackshaft, and the driven arm would match the stroke and opening speed of the drive arm.

In many situations, the damper opens quicker than the fuel valve, as indicated by a high O₂ reading as the unit modu-

lates off of low fire. The speed of the damper opening can be slowed by changing angle "A" and making it smaller. The smaller the angle, the slower the damper will open.

The stroke of the valve can be adjusted by changing the arm length. The longer the arm length of the drive arm, the larger the stroke of the valve. Likewise, a shorter arm length will result in a smaller stroke of the valve.

For this example, the adjustments were made on the drive arm. If the same adjustments are made to the driven arm, the results will be opposite of the drive arm adjustments.

By combining these two adjustments, the linkage can be set to provide the desired combustion results from low to high fire. It will take several attempts to make the operation correct, as changing the speed of opening usually changes the stroke, which requires another adjustment.

3. Fuel Cam Adjustments

The cam is used to adjust the intermediate fuel rate with the low and high fire settings done by the linkage connections. The intermediate rates can be adjusted by turning the adjusting screws in the clockwise direction to increase fuel input and decrease the % O₂ level in the flue gases. Turning the adjustment screws counterclockwise will decrease fuel input and increase % O₂ in the flue gases.

The following guidelines should be used for adjusting the cam:

- a. When adjusting the screws, the adjacent screws must also be adjusted to provide a smooth contour from screw to screw. When complete, the flexible strip between the adjusting screws and the roller must come in contact with each screw, providing a smooth transition from low fire to high fire.
- b. The end screws (or nuts) can be adjusted to hold the strip against the screws, but should not deform the strip.
- c. There should be no upsets in the profile, where the flexible strip is required to move to a screw position where it is initially not in contact with the screw. Also, the movement from one screw to the next cannot be too large (more than 1/8"). This will cause the strip to flex and will lead to premature failure of the strip.
- d. The adjusting screws have a limited range of adjustment. They can be turned in until they are flush with the aluminum bar and adjusted out until the side washers of the roller contact the aluminum bar.
- e. If any adjusting screw does not turn with some resistance, the cam must be replaced.
- f. When the cam adjustment is complete, the retention plate must be installed. The retention plate will help insure that the fuel valve position will not get far from its ideal position, even with interference or sticky valve operation.

WARNING

IF THE CAM ADJUSTING SCREWS DO NOT HAVE RESISTANCE TO TURNING, THE CAM SHOULD BE REPLACED, AS THE SCREWS MAY CHANGE POSITION. FAILURE TO CHANGE A DEFECTIVE CAM MAY RESULT IN INJURY OR DEATH.

CAUTION

LARGE CHANGES FROM ONE ADJUSTING SCREW TO ANOTHER WILL RESULT IN PREMATURE FAILURE OF THE CAM AND MAY PREVENT THE BURNER FROM OPERATING PROPERLY.

g. If the contour has a sharp rise in the cam screw profile, trying to open the valve very quickly in the first few screws, the linkage should be readjusted to cause the air damper to open slower (make the jackshaft drive arm more parallel to the linkage rod). Likewise, the opposite contour can be corrected by speeding up the air damper drive (Figure F-1). The final cam screw profile should be close to the profile of the cam with no abrupt changes.

4. FGR Adjustments

Flue gas is recirculated back into the burner to reduce the flame temperature, which reduces the NO_x level. High quantities of flue gas result in lower NO_x levels, but can also result in flame instability if there is too much FGR. Natural gas fuel can handle larger quantities of flue gas than oil and can have much lower NO_x levels as a result. Generally, the NO_x levels only apply to gas firing and oil firing is not adjusted for NO_x levels. There may be exceptions to this, and the orders details should be reviewed to identify any special combustion requirements.

Dual fuel units may need additional adjustments and compensation to handle the different FGR rates between natural gas and #2 fuel oil. Burners equipped with parallel positioning can be adjusted for individual air and FGR settings on both fuels. Linkage burners equipped with a potentiometer in the control panel that will allow the shut-off valve to partially open and allows a small amount of FGR to flow when firing oil. This keeps the oil inputs close to the gas input (lower FGR rates increases the combustion air rate). The oil combustion is generally better when FGR is used at low rates resulting in a lower NO_x level. Linkage systems can also use a multiple setpoint modulation motor to provide separate gas and oil low fire and high fire positions.

Linkage dual fuel units may also be equipped with the optional multiple set point (Landis) modulation motor in addition to the above potentiometer. This motor allows for different low and high fire settings on gas vs oil to obtain the correct airflow for each fuel and optimize the turndown on gas.

On a dual fuel unit, the natural gas should be done first to properly set the FGR valve. Once gas is setup, oil can be set.

5. Burner Drawer Adjustments

The burner drawer of the HDRMB burner has no adjustable components. The oil nozzle position can be adjusted as defined earlier. The gas orifices, swirl vanes and relative position of components are fixed and not adjustable.

6. Single Fuel Setups

Single fuel burners can be adjusted following the procedures outlined in Section 10 for gas firing; Section 12 for Air atomized #2 oil.

The procedures for each of the systems (linkage, cams, FGR) must be completely understood and followed as part of the setup process.

7. Combination Gas and Air Atomized #2 Oil

Combination burners, firing both gas and oil, require some compromises in the setup because they share common controls for both fuels. Air atomized #2 oil firing can have turndowns and air damper positions very similar to gas firing, simplifying the setup. Gas must be started first to set the FGR control valve positions to obtain the correct NO_x performance. Follow the setup procedures defined in Section 10 for gas setup and Section 12 for air atomized oil setup.

If the burner is equipped with an optional multiple setpoint modulating motor, the low and high fire rates, as well as lightoff rates, can be set independently for each fuel. In this case, the gas is adjusted first, to set the air damper locations for gas firing, as defined in Section 10. Once gas is set, oil is setup as defined in Section 12, except that the multipoint modulating damper motor is adjusted to bring the low fire air setting to match the oil needs.

There are several different options available that can alter the exact setup details, and these must be evaluated prior to startup so that the procedures can be adjusted accordingly. The procedures given are for linkage systems. Parallel positioning (linkageless) systems allow for much more flexibility in the fuel, air and FGR settings on each fuel, and can be tuned to better match each fuels needs. The setup details for linkageless controls will follow the same general sequence, but differ in specifics for setting the valve positions.

The oil nozzle can't remain in position when firing gas, because the nozzle is in a high temperature zone, the residual oil in the nozzle will solidify and plug the nozzle. The oil gun can be removed by disconnecting the hoses and the rear mounting plate. A plug plate is provided to cover the oil gun tube.

If the burner has the retractable oil gun, then it can simply be moved to the retracted position to allow for gas firing. It is still recommended that the gun be removed for extended gas firing.

Vessel Type	NOx PPM	% Excess Air	% O2 (dry)	% FGR	%O2 in Mix Air
Firetube	9	25	4.6	40	16.6
Firetube	12	25	4.6	35	16.9
Firetube	15	20	3.8	30	17.3
Watertube	9	15	3.0	30	17.0
Watertube	12	15	3.0	25	17.6
Watertube	15	15	3.0	20	18.1

Figure F-2
Typical Natural Gas Burner Operating Performance

8. Gas Setup

- a. Place the burner switch in the "OFF" position
- b. Place the "Auto-Manual" switch in the manual position. If this is a combination fuel burner, make sure the fuel selector switch is on "GAS".
- c. Place the manual flame control potentiometer in the MIN (low fire) position
- d. Close the downstream manual shutoff valve (closest to the modulating valve) on the gas train.
- e. Turn the electrical power on for the burner, boiler and related components.
- f. Verify that the gas metering valve is nearly closed, the vent valve (if equipped) is operating and the gas pilot valve is not open (the solenoid will hum and feel warm).
- g. Verify that the FGR control valve is in the near closed position. A linkage system should have the shutoff FGR valve in the closed position.
- h. Turn the burner switch on. This will start the blower motor and initiate the prepurge cycle.
- i. When the prepurge sequence is complete and the low fire start switch is made, the pilot valve will open and the pilot flame should be visible through the sight port.
- j. When the pilot flame is established, the flame safeguard will energize the main gas valve (indicated with the Fuel Valve Light). This operation of the main fuel valves must be visually checked by observing the valve stem operation.
- k. After the timer has completed the trial for main flame, the burner will go out on alarm (the closed manual gas valve prevented the burner from lighting). At this time, the gas valves must be visually checked to verify that they have closed. This test sequence proves the proper operation of the primary control.
- l. Press the reset button and restart the burner. When the pilot has started, open the manual gas valve halfway to allow the main flame to start. On the initial light-off of a new burner installation, the manual valve should be used for course flame adjustment while watching the flame, and prepared to adjust the flame if it is extremely rich or lean, or simply close the valve if the flame does not look correct. The combustion valves can then be re-adjusted to correct the rich or lean operation and the unit restarted.
- m. The shutoff FGR valve should open on a linkage system, after the main flame has been proven. The timing can be adjusted with the time delay inside the control panel, so that the FGR shutoff valve opens as soon as the main flame is established. The control valve of the linkageless system should move from closed to a low flow position after proving

main flame.

NOTE: If the burner is not operating as indicated, follow the troubleshooting guide steps to determine the problem and corrections required.

n. After a few seconds, the combustion analyzer should have an accurate reading of the O2 in the stack. Figure F-3 shows the typical range of O2 at different firing rates, and the burner should be adjusted to be within this range. Rough settings for low and mid fire combustion settings are adequate at this time. Once the high fire is set, the other settings can be fine tuned.

- Turning the cam screw in will add fuel, making it richer and reducing the O2 level.
- Turning the cam screw out will reduce the fuel input, increasing the O2 level.

The NOx level should be close to the desired NOx, as required by the specific order. The FGR valve can be opened to decrease the NOx level, or closed to increase the NOx level.

o. Operate the burner until the boiler is warmed up, and near the operating pressure or temperature. Increase the firing rate, using the manual potentiometer, while monitoring and adjusting the O2 level. Adjust the gas pressure regulator as needed to reach the high fire input.

p. Adjust the FGR valve as needed to obtain the approximate NOx level. Figure F-2 shows the typical range of %O2 and % FGR required for different NOx levels in different vessels. The numbers shown are for high fire. Low fire will typically have higher %O2 and %FGR. Figure F-6 can be used to determine the % FGR for different %O2 levels.

q. Adjust the high fire input to match the maximum input listed on the rating label. At high fire, the gas butterfly valve should be at least 50 degree open (more if available gas pressure is low), and the gas pressure regulator adjusted to obtain the rating. The input should be measured using the following equation:

Calculating Natural Gas Input

$$\text{Gas MBH} = \text{HHV} \times [(\text{Patm} + \text{Pgas})/29.92] \times [520/(\text{Tgas} + 460)] \times [\text{measured ft}^3/\text{sec}] \times [3600 \text{ sec}/\text{hr}]$$

Where:

MBH = 1000's of BTU/M input

HHV = Higher heating value of gas, BTU/cubic feet

Patm = Atmospheric pressure in inches Hg

Pgas = Gas pressure before gas meter in inches Hg
(inches HG = PSIG x 2.04)

Tgas = Gas temperature at the flow meter, in
degrees F

Measured ft³ = volume of gas measured by meter
sec = Time for measured ft³ to flow through meter

Note: Some gas meters require a 6 inch wc correction to Pgas. Consult your meter calibration data.

NOTE: The listed manifold pressure is only an approximate value and can vary with operating conditions and normal tolerances. The fuel flow rate must be measured to obtain an accurate input value.

- r. Adjust the air damper to obtain the correct O₂ level.
- s. Adjust the NO_x level to be about 10% below any guaranteed NO_x performance. A balance of the FGR control valve and air damper are required to obtain the final result, as each can impact the other.
- t. Modulate the burner to low fire, adjusting the O₂ level as the burner modulates.
- u. Adjust the low fire input, using the fuel cam and air damper adjustments. The linkage may need to be readjusted to obtain the correct relationship between the fuel valve and air damper. (Figure F-1)
- v. Re-adjust the midfire points for the correct O₂ level.
- w. If the burner has high CO levels at lower rates, this can be corrected by either adjusting the excess air and/or adjusting the center gas flow rate with the center gas balancing valve. Also check the low fire rate, as firing at a low rate can also cause higher CO.
- x. Adjust the low gas pressure switch to be 10% below the lowest expected gas pressure.
 - With a gauge or manometer at the same location as the low gas pressure switch, modulate the burner to determine the firing rate with the lowest gas pressure.
 - At the lowest gas pressure, adjust the low gas pressure setting up until the switch breaks and causes the burner to shutdown.
 - From the scale reading of the switch, adjust the setting to a pressure that is 10% lower than the shutdown pressure. For example, if the switch opened at 10 inches as indicated on the low gas pressure switch, the switch should be adjusted to a reading of 9 inches.
 - Remove the gauge or manometer and plug the opening.
 - Cycle the burner on and off to determine if the limit works properly.
 - If the limit causes nuisance shutdowns because of small pressure drops during startup, reduce the pressure setting an additional 5%.
- y. Adjust the high gas pressure switch to be 10% above the highest expected gas pressure.
 - With a gauge or manometer at the same location as the high gas pressure switch, modulate the burner to determine the firing rate with the highest gas pressure.
 - At the highest gas pressure, adjust the high gas pressure setting down until the switch opens and causes the burner to shutdown.
 - From the scale reading of the switch, adjust the set-

ting to a pressure that is 10% higher than the shutdown pressure. For example, if the switch opened at 10 inches as indicated on the high gas pressure switch, the switch should be adjusted to a reading of 11 inches.

- Remove the gauge or manometer and plug the opening.
- Cycle the burner on and off to determine if the limit works properly.
- If the limit causes nuisance shutdowns because of small pressure changes during startup, increase the pressure setting an additional 5%.
- z. The burner should be operating at low fire to adjust the air proving switch. Turn the adjusting screw cw (in) until the burner trips out (shutdown caused by the air flow switch). Turn the adjustment screw ccw (out) 1 1/2 turns from the point of shutdown. Check the operation at higher rates.

9. Air Atomized, #2 oil Setup

- a. Place the burner switch in the "OFF" position.
- b. Place the "Auto-Manual" switch in the manual position. If this is a combination fuel burner, make sure the fuel selector switch is on "OIL".
- c. Place the manual flame control potentiometer in the min (low fire) position.
- d. Turn the electrical power for the burner, boiler and related components on.
- e. Verify that the oil metering valve is at the nearly closed position.
- f. Turn the burner switch on. This will start the blower motor and initiate the purge cycle.
- g. When the prepurge sequence is complete and the low fire start switch is made, the pilot valve will open and the pilot flame should be visible through the burner sight port.
- h. When the pilot flame is established, the flame safeguard will energize the main oil valves (indicated with the Fuel Valve Light), and the burner should ignite at low fire. This operation of the main fuel valves must be visually checked by observing the valve stem moving up with a motorized valve or hearing the clicking noise from a solenoid valve.

NOTE: If the burner is not operating as indicated, follow the troubleshooting steps to determine the problem and corrective action.

WARNING

DO NOT ATTEMPT TO START THE BURNER WHEN EXCESS OIL HAS ACCUMULATED, WHEN THE UNIT IS FULL OF VAPOR, OR WHEN THE COMBUSTION CHAMBER IS HOT.

- i. After a few seconds, the combustion analyzer should have an accurate reading of the O₂ in the stack. The O₂ level should be between 4% and 7% (see Figure F-3 for O₂ rates), and the nozzle oil press should be between 5 and 15 PSIG (see Figure F-4). Do not attempt to fine tune combustion until the high fire input has been set. The FGR control valve or limiting potentiometer should be set for the approximate NO_x level required.

**Figure F-3
O2 levels**

	% Rate	Gas Fired at NOx Level			Oil Fired
		9 ppm	12 ppm	15 ppm	
Firetube	20	4.5 - 6.5%	4.5 - 6.5%	4.0 - 6.0%	4.0 - 7.0%
	33	3.5 - 6.0%	3.5 - 6.0%	3.5 - 5.5%	3.5 - 6.5%
	50	3.5 - 5.5%	3.5 - 5.5%	3.0 - 5.0%	3.0 - 6.0%
	75	3.5 - 5.5%	3.5 - 5.5%	3.0 - 5.0%	3.0 - 6.0%
	100	3.5 - 5.5%	3.5 - 5.5%	3.0 - 5.0%	3.0 - 6.0%
Waternube	20	3.5 - 5.5%	3.5 - 5.5%	3.5 - 5.5%	4.0 - 7.0%
	33	3.0 - 5.5%	3.0 - 5.5%	3.0 - 5.5%	3.5 - 6.5%
	50	2.0 - 3.5%	2.0 - 3.5%	2.0 - 3.5%	3.0 - 6.0%
	75	2.0 - 3.5%	2.0 - 3.5%	2.0 - 3.5%	3.0 - 6.0%
	100	2.0 - 3.5%	2.0 - 3.5%	2.0 - 3.5%	3.0 - 6.0%

- Turning the cam screw in will add fuel, making it richer and reducing the O2 level.
 - Turning the cam screw out will reduce the fuel input, increasing the O2 level.
 - The air damper should be positioned for the correct low fire settings.
 - The atomizing air pressure can be adjusted using the air bleed valve. It should be adjusted to get a clean stable flame.
- j. Operate the burner until the boiler is warmed up, and near the operating pressure or temperature.
- k. Increase the firing rate, using the manual potentiometer, while monitoring and adjusting the O2 level. Adjust the cam, oil pressure and atomizing air pressure as needed to reach the high fire input.
- l. Adjust the FGR control valve or potentiometer (linkage system) as required to maintain the NOx level.
- m. At high fire (end of the modulating motor travel), adjust the high fire input to match the maximum input listed on the rating label. Using a flow meter, the fuel input may be measured using the following equation,

$$\text{Oil GPH} = \frac{[\text{Gal end} - \text{Gal start}] \times [3600 \text{ sec/hr}]}{[\text{measured sec}]}$$

Where Gal end = meter gallons at end of test
 Gal start = gallons at start of the test
 Measured sec = measured time of test
 GPH = Gallons of oil per hour

- n. Adjust the NOx level to be about 10% below any guaranteed NOx performance or if performance guarantee exists adjust the FGR to provide some added turbulence but not high enough to impact flame stability. A balance of the FGR control valve and air damper are required to obtain the final result, as each can impact the other. If this is a linkage system, the FGR limiting pot should be adjusted to reduce the FGR rate for stable combustion, with the FGR control valve set when firing gas.
- o. Modulate the burner to low fire, adjusting the O2 level as the burner modulates.
- p. Adjust the low fire input, using the fuel cam and air

damper adjustments.

- q. Adjust the NOx level according to the type of system (limiting potentiometer or matching gas).
- r. Re-adjust the midfire points for the correct O2 levels. The linkage may need to be readjusted to obtain the correct relationship between the fuel valve and air damper. See Figure F-1.
- s. The burner should be operating at low fire to adjust the air proving switch. Turn the adjusting screw cw (in) until the burner trips out (shutdown caused by the air flow switch). Turn the adjustment screw ccw (out) 1 1/2 turns from the point of shutdown. Check the operation at higher rates.

**FIGURE F-4
Atomizing Air and Oil Pressures**

% Rate	Atom Air Pressure	Oil Pressure
20	10 - 25	8 - 20
33	12 - 30	10 - 30
50	15 - 35	15 - 35
75	20 - 40	25 - 50
100	25 - 60	40 - 75

Figure F-5 Turndown and Pressure Drops				
Required		Maximum Turndown	Head Pressure Drop	
NOx ppm	CO ppm		Low Fire	High Fire
9	50	3:1	1.0	9
9	100	4:1	0.5	9
12	50	3:1	0.5	9
12	100	4:1	0.35	9
15	50	3:1	0.4	9
15	100	4:1	0.25	9

10. Operating Control Adjustments

The operating controls must be adjusted to properly cycle the burner "ON and OFF" and provide modulation. See Section E-11 for details. The controls should not force the burner

into rapid “ON-OFF” cycles, as this will cause premature failure of the motor and operating equipment.

The operating control must be adjusted to provide the “ON” pressure or temperature desired. It must allow the burner to come on and start before the temperature or pressure drops into the modulating range. The “OFF” pressure or temperature must be sufficiently above the “ON” point to allow a reasonable run time.

The modulating control must be adjusted to start modulation at some reasonable point below the “ON” temperature or pressure and provide modulation to high fire at the lowest temperature or pressure.

11. Limit Tests

Once the burner has been started and the operating pressures have been set, the limit switches need to be adjusted so that they will trip if the pressure exceeds the operating value, but will not trip with normal variations. The switch should be checked for proper operation by allowing the pressure to vary below (or above) the recommended level to insure that they provide safe shutdown before the burner operation is affected. In some high pressure or temperature switches, where the temperature or pressure cannot be set high enough to trip the switch, the switch can be checked by lowering the set point to prove that the switch will provide a safe shutdown.

The limit switches would include the air proving switch on the burner. Limits for gas operation could include the high and low gas pressure switches and for oil firing, the high and low oil pressure switches and the atomizing air pressure switch. If in doubt about which limits are on a burner, refer to the wiring diagram that will show each item.

Limit switches need to be checked at regular intervals to ensure they are operating properly. See the maintenance section for details.

12. Pilot Test

Once the burner has been set for the firing rates intended for the burner, the pilot must be checked for proper operation and safety.

The minimum pilot test is done to insure that a pilot which can be seen by the scanner will light the main flame.

- a. During a startup sequence, measure the time required to light the main flame after the fuel valves have been energized. This will be used to monitor the test with reduced pilot.
- b. Lock the flame safeguard into the pilot position (refer to the manual for the flame safeguard for this setting)
- c. Adjust the gas pressure regulator to the pilot for a minimum value while still holding the minimum signal strength for the scanner.
- d. Release the flame safeguard from the pilot position and allow it to cycle through the main flame proving sequence.
- e. This reduced pilot must reliably light the main flame. Monitor the time from the main fuel valve opening and do not allow the burner to continue if the time is more than an additional two to three seconds from the initial time measured above.

sured above.

WARNING

THE MINIMUM PILOT TEST REQUIRES CLOSE SUPERVISION OF THE COMBUSTION PROCESS. FAILURE TO CLOSELY MONITOR THE MAIN FLAME TEST TIME COULD RESULT IN DAMAGE, INJURY OR DEATH.

- f. Run through two or three cycles.
- g. If this is a combination fuel burner, repeat the test on the other fuel.
- h. Failures due to reduced scanner signal are also acceptable.
- i. If the pilot does not light the main flame under these test conditions, check and adjust the pilot as shown in figure E-1 and E-6.

The pilot must be tested for hot refractory pickup. This test is performed to make sure that the scanner does not see hot refractory that could be mistaken for a flame.

- a. After the burner has been operating for some time at high input levels and the refractory in the vessel is hot, the burner should be cycled off while monitoring the scanner signal.
- b. The flame signal should drop off quickly as the flame goes out and should be well below the minimum level (indicating a flame) at the end of the post purge cycle.
- c. If the flame signal does not drop out as required, check the location of the pilot and scanner, as shown in Figure E-1. This may also indicate a faulty scanner or amplifier.

13. Burner Shutdown

Normal operation of the burner will allow the operating controls to shut the burner down when the load demand is satisfied. If the burner needs to be shut down for any reason, the “ON-OFF” switch can be used to quickly turn the burner off. This will instantly cause the fuel valves to close and start a post purge cycle to remove any unburned fuel from the vessel (some controls may drive to low fire before they cycle off).

In an emergency shutdown, all fuel and electrical power should be de-energized or turned off to secure the burner. This would include the main power disconnect, the manual gas shutoff valve at the drop down line and if equipped, the manual oil valve to the nozzle.

It is recommended that the burner be manually driven to low fire before turning the burner off, as this reduces the dynamic and thermal stress. If the burner will remain off for some time, the manual fuel valves, fuel pumps and power supply should be turned off.

CAUTION

ALWAYS KEEP THE FUEL SUPPLY VALVE SHUT OFF WHEN THE BURNER IS SHUT DOWN FOR AN EXTENDED PERIOD OF TIME.

14. Restarting after Extended Shutdown

Extended shutdowns require the same startup process as those outlined above. In addition, the following advanced

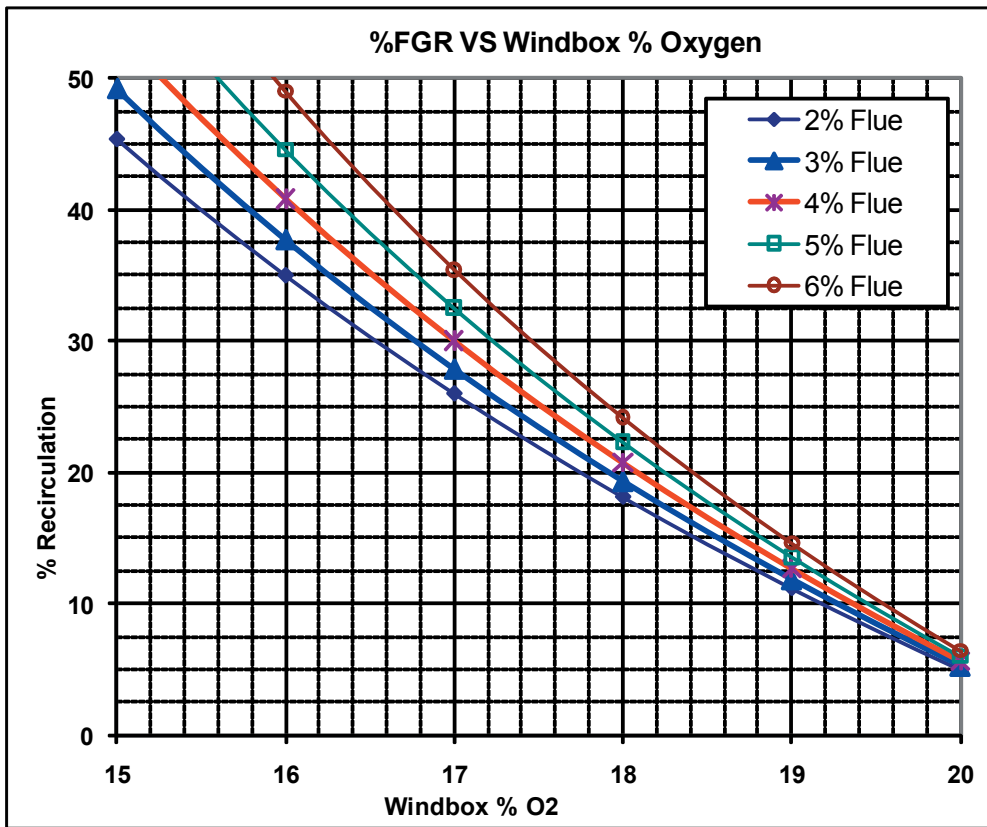


Figure F-6
% FGR vs Windbox
% Oxygen

cleaning must be done,

- a. The oil nozzle should be removed and cleaned. Use care in cleaning to preserve the sharp edges of the nozzle, which are required to maintain good atomization.
- b. The oil filter and strainer must be removed and cleaned prior to starting.

CAUTION
DO NOT START THE BURNER UNLESS ALL CLEANOUT DOORS ARE SECURED IN PLACE.

Check and clean the fuel systems after the initial burner setup. It is common for debris to be in the fuel lines and equipment on a new installation and this can get into the valves and nozzle and prevent them from working properly. As a minimum, the gas strainers and oil nozzle should be checked for foreign material. If these components contain debris, the other control valves in the system should also be checked.

G. MAINTENANCE

1. General
2. Physical Inspection
3. Fuel-Air-Ratio
4. Gas Fuel Systems
5. Oil Fuel Systems
6. FGR System
7. Combustion Air Fan
8. Burner Refractory and Internals
9. Inspection and Maintenance Schedule
10. Combustion Chart

1. General

This burner has been designed to provide many years of trouble free operation. The reliability can be greatly improved with some simple inspection and maintenance programs.

One of the best tools for a good maintenance program is to keep a log on the key parameters of the burner and boiler. These would include operating temperatures, pressures, inspections and preventative maintenance activities. This document can be used to detect any changes in the operating characteristics of the burner, which can be used for preventative maintenance.

The maintenance schedule can be used to help generate this log. There are also many other good references that can be use to help develop your log. Adding check points for other equipment into a common log can help. It is common to integrate the boiler and burner log, so that all components are checked at the same time.

The frequency of inspection given in the following charts is only a guideline. Initial results should be used to adjust the time intervals to be more frequent when problems or potential problems are observed.

2. Physical Inspection

Listening and looking at the burner can detect many problems. For example, leakage can usually be seen early with a small buildup of oil . Valve and linkage problems can usually be detected early on by simply watching the movement and detecting rough uneven changes. The jackshaft, linkage and valve movement should occur smoothly with no rough jerks.

The operation of the burner, including the sound and vibrations can be an indication of a serious condition. If any of the conditions listed below appear, it is recommended that a complete equipment inspection, by qualified individuals, be performed to determine the source of the problem and proper corrective actions.

Flame failures, especially during operation, are an indication of a control or equipment problem. Repeated flame failures, especially at higher rates are an indication of a serious issue, and the unit should be taken out of service immediately and the issue corrected.

Burner vibrations can be an indication of a combustion is-

sue. Often it is related to a rich or lean operation, where the excess air is above or below the normal limits. This burner, and all Ultra low emission burners have a narrow operating range, and the equipment must be maintained to continue to operate in that narrow range. Typical vibrations can occur when the O₂ level is outside the range shown in Figure F-3 or if the NO_x level is lower than it should be. These values can be easily checked with a CEMS or properly calibrated combustion analyzer

Swings in the excess air levels or changes in the NO_x level when firing at the same rate is an indication of a potential controls problem. This is where it is important to maintain a log of operating data, so that changes in operating conditions can be detected early. Remember that some differences can be due to firing rate and fuel. If the unit does not have a TEMP-A-TRIM control, changes in combustion air temperature can also impact the values, and should be part of the record keeping.

3. Fuel-Air-Ratio Controls

The fuel-air-ratio controls must be maintained in good operating condition. Over time, these items will wear and may not operate smoothly. Corrective action must be taken.

There are several different types of controls and the corrective action of each could be different. The following general guidelines can be used for initial steps.

WARNING

LINKAGE CONTROLS RELY ON FREQUENT VISUAL INSPECTION TO INSURE PROPER OPERATION AND SAFETY OF THE UNIT. DAMAGE FROM WEAR OR MECHANICAL ACTIONS CAN RESULT IN UNSAFE FUEL-AIR-RATIOS, AND CAN DAMAGE EQUIPMENT, CAUSE PERSONEL INJURY OR DEATH.

Linkage based controls should be inspected for wear. If there is any noticeable play in the linkage rod ends or shaft bearing, they should be replaced. Likewise, any control valves that exhibit sloppy or hard to turn movement should also be replaced.

Fuel cams should have adjusting screws that are held firmly in position and can not move due to normal vibrations. The moving parts must be in good condition with no noticeable wear or play. Worn connections will result in hysteresis and reduced combustion efficiency.

The cam and jackshaft should be visually checked on a frequent or daily basis for obvious problems, including free movement, no loose parts and correct position of components.

On a monthly basis, the linkage and cams should be inspected for wear and loose parts. Annually, the cam and linkage should be operated manually to check the movement of all components and valves. Any worn parts should be replaced immediately.

4. Gas Fuel System

The safety interlocks must be checked at regular intervals to ensure that they provide the proper safety. See the Inspection and Maintenance Schedule Chart (Figure 8) for frequencies.

The drip leg should be cleaned annually.

Monitoring the outlet gas pressure from the regulator will verify this control is working properly.

5. Oil Fuel System

The oil system has additional components that require regular maintenance, depending on the type of system used.

- a. Oil added to air compressor. The air compressor has a visual sight glass showing the oil level. This must be inspected every shift (while operating).
- b. Air compressor belt tight and in good condition. Check the condition of the air filter.
- c. The oil strainer should be checked and cleaned periodically. A high vacuum reading on the suction side of the pump (over 10") is a good indication that the strainer needs to be cleaned. Strainers provided by Webster will use a wire mesh basket inside a canister. After turning the pump off (and making sure there is no pressure on the strainer), unscrew the yoke to gain access to the basket. The canister does not need to be drained. Be careful with the gasket when removing or replacing the cover to insure a good seal. The basket can be lifted out and cleaned with a soft brush and cleaning solution.
- d. Vacuum within the 10" limit on suction side of pump (indicates need to clean strainer, as described above). If cleaning the strainer does not resolve this, check the other valves between the tank and gauge for plugged or closed position.
- e. Oil nozzles should be cleaned periodically, depending on the type of operation and the observed need for cleaning. Extended operation at low rates can cause carbon buildup on the outside of the nozzle. This can be cleaned with a rag and cleaning solution. If the fire is showing some deterioration, and the external surfaces are clean, then the nozzles should be removed, disassembled and cleaned using a soft brush and cleaning solution.
- f. If the edges of the air atomizing nozzle are not sharp, or the nozzle shows sign of wear and the combustion is deteriorated, the nozzle should be replaced.
- g. Check safety limits, including pressure and temperature switches

6. FGR Systems

The flue gas is corrosive and requires regular inspection of the equipment to ensure proper and safe operation. The potential for corrosion and frequency of the inspection can vary greatly based on the application. Applications with condensation will have more corrosion and will need more maintenance. Frequent cycling, cold startups, cool operating temperatures, cool air temperatures and outdoor installations are good examples of where high levels of condensation can occur.

Areas to inspect for corrosion:

- FGR control valves (s)
- FGR Duct
- Air inlet louver box
- Fan and fan housing
- Burner housing
- Firing head and blast tube

Other checks:

- a. The condensation traps must work properly and be installed to capture all of the condensation. If condensation passes through to the burner windbox, a condensate drain should be added to the bottom of the windbox.
- b. Linkage and valve movement must operate freely and smoothly.
- c. If the FGR valve is modulated partly open (oil firing on dual fuel burner) check position of FGR valve.
- d. NOx emissions level.
- e. Other general items like refractory.
- f. Stack temperature of boiler – high temperatures will increase NOx levels.
- g. Operation of safety equipment.
- h. Time delay on FGR on-off valve (if equipped).

7. Combustion Air Fan

If the fan and motor are ever removed, the following should be observed in re-assembly.

- a. There should be about 1/4" overlap of inlet cone and fan.
- b. Never re-use the fan to motor shaft set screws, always use new screws of the same size and style to maintain balance and fan retention.
- c. When tightening the fan hub set screws, rotate the fan to place the screws on the bottom. This way the screw is not lifting the fan.
- d. The motor shaft and fan hub must be clean and free of burrs.
- e. Torque the fan hub set screws to:
 - o 250 in-lbs for 3/8" set screws
 - o 600 in-lbs for 1/2" set screws
 - o 97 ft-lbs for 5/8" set screws

8. Burner Refractory and Internals

The refractory and firing head components should be inspected closely on an annual basis for signs of overheating and refractory damage. If the metal shows signs of overheating, it is an indication of a control or setup problem that must be corrected.


Refractory cracks under 1/8" are normal, and will close when heated. In larger refractory assemblies, the cracks can be up to 1/4" without a concern. Larger cracks or broken sections must be repaired. The refractory downstream of the firing head, which is used to properly shape the flame, has a critical role in maintaining good combustion, and may require replacement if it is damaged. Repairs should only be performed by qualified individuals.

9 - Inspection and Maintenance Schedule

Frequency						Component / Item	Recommended Action or Test	Performed By	
Daily	Weekly	Monthly	Seasonal	Annual	Annual As Required			Boiler Operator	Trained Burner Technician
X						Burner Flame	Visual inspection of burner flame.	X	
X						Jackshaft and Linkage	Visual inspection for smooth and free travel.	X	
X						Air Damper	Visual inspection for smooth and free travel.	X	
X						Fuel Metering Valves	Visual inspection for smooth and free travel.	X	
X						Draft Controls (Stack)	Visual inspection for smooth and free travel.	X	
X						Gas Fuel Pressure	Record in log book, compare trends.	X	
X						Oil Pressure	Record in log book, compare trends.	X	
X						Atomizing Air Pressure	Record in log book, compare trends.	X	
X						Pilot	Visually inspect pilot flame, check and record flame signal strength if metered.	X	
	X					Flame SafeGuard - Pilot Test	Close manual fuel valve on pilot during cycle and check for safety shutdown, recording time.	X	
	X					Flame SafeGuard - Main Flame	Close manual fuel valve on pilot during cycle and check for safety shutdown, recording time.	X	
		X				Flame SafeGuard	Check flame safeguard components, including scanner.		X
				X		Flame SafeGuard	Replace flame safeguard components in accordance with manufacturers instructions.		X
				X	X	Pilot Turndown Test	Conduct pilot turndown test annually or after any component change.		X
				X	X	Hot Refractory Test	Conduct hot refractory hold in test. This test is required annually or after any component change.		X
		X				Oil Pressure and Temperature Interlocks	Check oil pressure and temperature switch for smooth operation and correct action.		X
		X				Atomizing Air Pressure	Check air atomizing pressure interlock switch for smooth operation and correct action.	X	
		X				Interlock Controls	Check other interlocks that may be used on the burner for smooth operation and correct action.		X
			X			Firing Rate Control	Check firing rate control and verify settings.		X
			X			Combustion Tunning	Conduct a combustion test, verify setting and NOx emission levels.		X
	X					Pilot and Main Fuel Valves	Make visual and manual check for proper sequencing of valves.		X
				X		Pilot and Main Fuel Valves	Check all coils, diaphragms, interlock switch & other parts of all safety shutoff valves.		X
				X		Pilot and Main Fuel Valves	Perform leak tests on all safety shutdown control valves.		X
				X		Low Pressure Air Switch	Test low air pressure switch for proper operation and adjustment.		X
				X		Mod Damper Switch	Check damper low fire proving switch per manufacturers instructions.		X
				X		Linkage and Fuel Cams	Check linkage and cams for wear and replace any items with wear indication or stress cracks.		X
X						FGR Control Valve	Visual inspection for smooth and free travel.	X	
			X			FGR Control Valve	Clean and lubricate FGR control valve.	X	
	X					FGR Shutoff Valve	Visually inspect for smooth and complete travel.	X	
			X			FGR Shutoff Valve	Clean and lubricate FGR shutoff valve	X	
X						FGR Condensate Drain	Open FGR condensate drains, remove all condensate.	X	
					X	FGR Shutoff Valve Switch	Check operation of shutoff FGR valve for full rotation and position proving switch.		X
					X	FGR Duct	Inspect and clean FGR duct.	X	
					X	Combustion Air Fan	Clean combustion air fan and housing		X
X	X					Burner Components	Visually check the burner components for signs of cracks, deformation, slippage or other unusual indication.		X
		X				Burner Mounting	Check burner mounting clamps and brackets for tightness.	X	
		X				Refractory and Seals	Check burner refractory for cracks or signs of leakage.	X	
		X				Oil Nozzle	Check and clean oil nozzle.	X	
X						Air Compressor	Check air compressor for lubrication oil and air filter.	X	
					X	Air Compressor	Check air compressor relief valve operation.		X
		X				Air Compressor	Check / replace air filter		X

10- Combustion Chart

This graph shows the relationship between excess air, %Oxygen and %CO₂, which is typically obtained from a flue gas analyzer. The values are based on a dry reading, where the flue gas is extracted and cooled before the analysis if done.

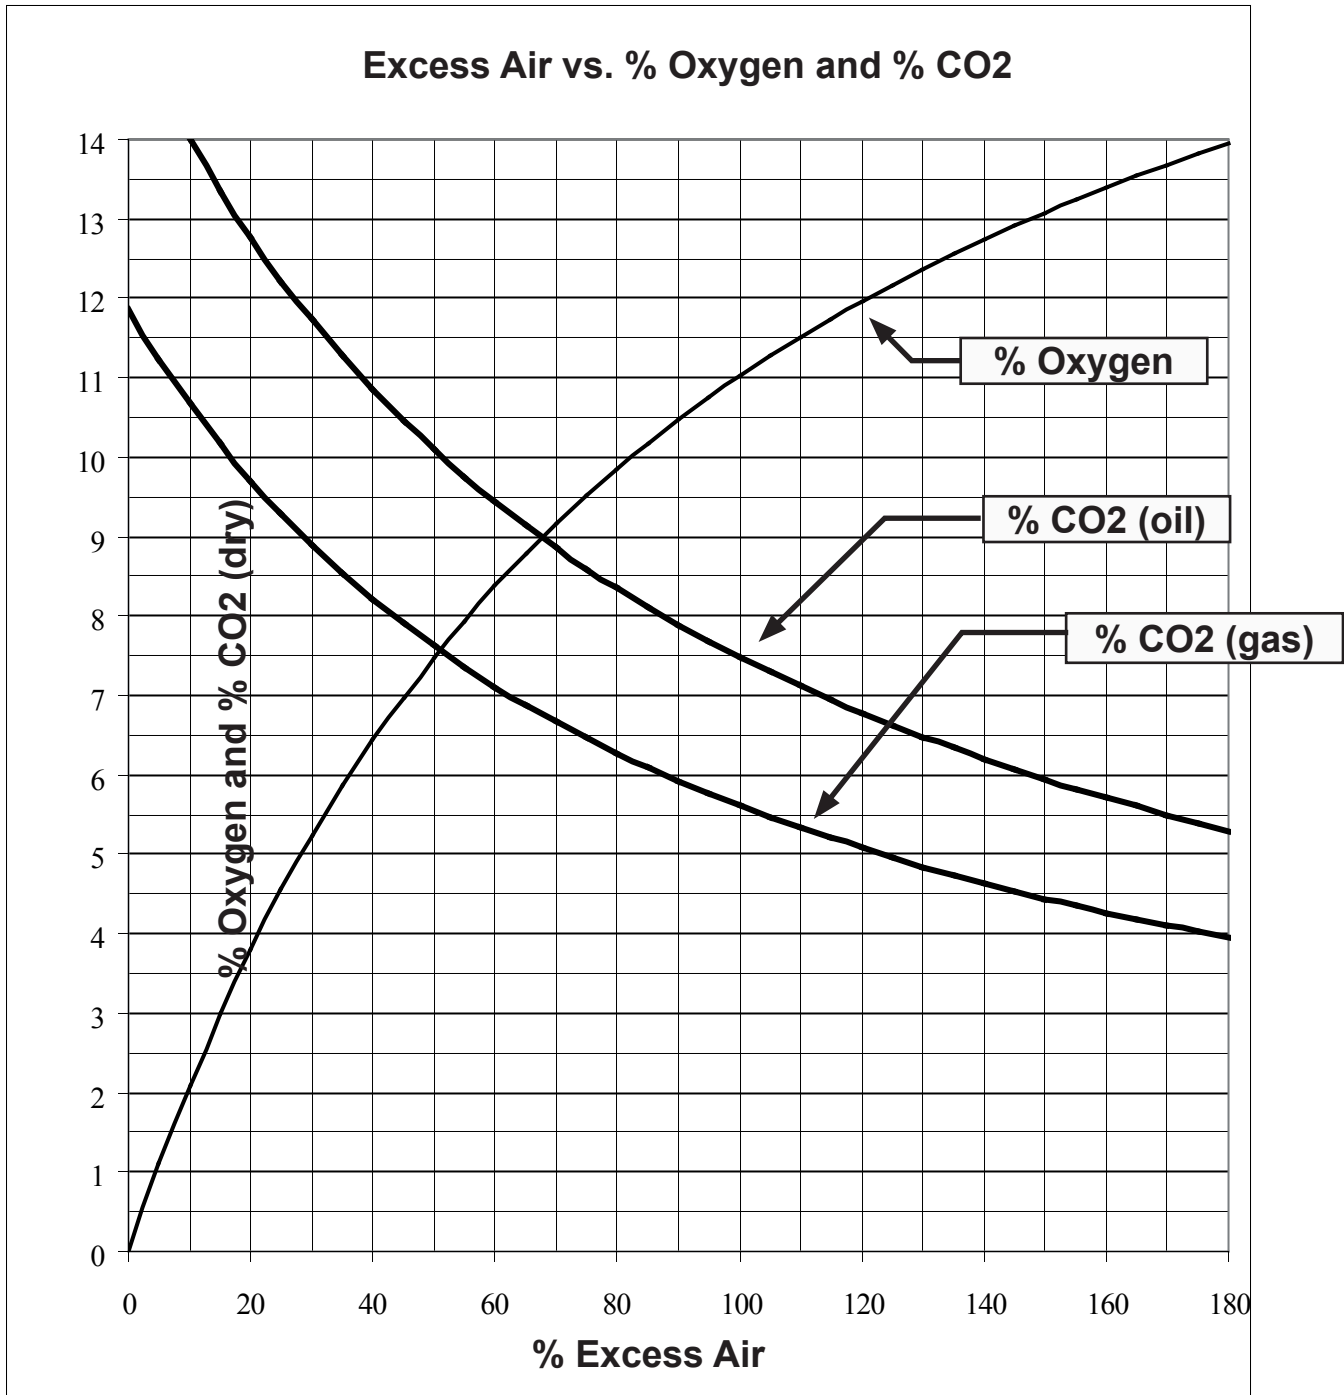

H. Troubleshooting

No.	System	Cause	Correction
1	No Ignition (lack of spark)	Electrode is grounded. Porcelain is cracked.	Replace
		Improperly positioned electrode	Recheck dimensions
		Loose ignition wire connection	Reconnect or tighten
		Defective ignition transformer	Check transformer, replace
2	No Ignition (spark, no flame)	Lack of fuel, no gas pressure, closed fuel valve	Check fuel supply and valves
		No voltage to pilot solenoid	Check electrical connections
		Defective pilot solenoid valve	Replace
		Incorrect location of pilot	Check location of pilot
		Improper raw gas tube position	Check location of raw gas tube
		Improperly positioned electrodes	Recheck dimensions
		Too much combustion air flow	Check air damper position
3	Pilot not detected (flame present)	Scanner tube not positioned correctly	Check location of scanner tube
		Scanner tube dirty	Clean scanner tube
		Scanner or amplifier faulty	Replace
		Pilot improperly positioned	Check pilot position
		Incorrect gas pressure to pilot	Readjust pressure
		Combustion air flow rate too high	Readjust damper
4	No main gas flame (pilot OK)	Weak scanner signal	Clean scanner lens and tube
		Damper or fuel control valve setting incorrect	Readjust
		Fuel valve(s) not opening	Check wiring to valves
5	No main oil flame (pilot OK)	Weak scanner signal	Clean scanner lens and tube
		Damper or fuel control valve setting incorrect	Readjust
		Fuel valve(s) not opening	Check wiring to valves
		Oil nozzle or line obstructed	Check nozzle and lines, clean
		No atomizing air pressure	Check compressor wiring
		Compressor pressure too low or high	Readjust
6	Burner stays at low fire	Manual pot in low fire position (low fire hold)	Readjust to high fire position
		Manual-auto switch in wrong position	Change position of switch
		Modulating Control	Check wiring or replace
		Loose linkage	Readjust and tighten
		Binding linkage or valve	Readjust or replace
7	Burner shuts down during operation	Loose electrical connection	Check and tighten connections
		Loss of fuel supply	Replenish fuel supply
		Limit switch breaks (opens)	Readjust limit switch
8	Burner does not start	Main disconnect switch is open	Close switch
		Loose electrical connection	Check electrical connections
		Operating controls are tripped	Check and reset operating limits
		High or low fuel pressure	Check fuel supply - reset switches
9	High CO at low fire (firing gas)	Improper excess air level	Readjust excess air
		Input too low for burner components	Check input, compare to rating label

No.	System	Cause	Correction
	High CO at low fire (con't)	High stack draft (especially at low fire)	Stabilize draft
	(firing gas)	Fluctuating gas pressure (regulator not holding pressure)	Check regulator pressure, sensing line and supply pressure: sized properly
10	Gas combustion noise	Input too low for burner components	Check input, compare to rating label
	(rumbling)	Improper excess air	Readjust excess air
		Fluctuating gas pressure (regulator not holding pressure)	Check regulator pressure and supply
		High stack draft (especially at low fire)	Stabilize draft
		Poor air flow distribution (off center flame)	Check fixed air straightening vanes
		Wrong center gas flow	Adjust balancing valve
11	Oil combustion smoking	Oil nozzle dirty or plugged	Clean oil nozzle
		Improper excess air	Readjust excess air
		Input too low for burner components	Check input, compare to rating label
		High stack draft (especially at low fire)	Stabilize draft
		Incorrect nozzle position	Adjust the nozzle to diffuser position
		Fluctuating oil pressures (regulator not holding)	Check regulator pressure and oil supply
		Poor air flow distribution (off center flame)	Adjust air straightener blade
		Too much FGR (if equipped)	Reduce FGR rate
12	Fuel-Air-Ratios are	Linkage flexing	Realign linkage, straighten rods
	not consistent	Linkage slip	Check linkage and tighten all joints
		Fuel cam screws have moved	Replace fuel cam
		Fuel line plugged	Check and clean lines, strainers & filters
		Fuel supply pressure changing	Check and/or replace pressure regulator
		Combustion air temperature changed	Retune burner
		Draft condition changed	Check draft and outlet damper
		Plugged or leaky FGR line	Clean / repair
		Gas control valve - low fire stop not set	Adjust low fire stop
13	Fuel-Air-Ratios have changed	Linkage wear	Check linkage and tighten all joints
	over time	Fuel cam screws have moved	Replace fuel cam
		Air damper seal worn	Replace air damper seals
		Fuel lines plugged	Check and clean lines, strainers & filters
		Fuel control valve worn	Replace fuel control valve
		Gas orifices or gas manifold plugged	Clean and/or replace
		Combustion air temperature changed	Retune burner
		Draft condition changed	Check draft and outlet damper
		Vessel plugged	Clean vessel
		Plugged or leaky FGR valve	Clean / repair
14	Cannot obtain capacity on	Wrong spring range in regulator	Install higher spring range
	gas	Too many elbows before control valve	Rework piping to reduce elbows
		Gas line too small, high pressure drop	Use larger pipe size
		Supply pressure lower than stated	Increase supply pressure
		Supply pressure drops too low at high fire	Use larger gas line sizes / orifice in service regulator
		Regulator too small for flow and pressure	Change regulator
15	Cannot obtain rated input on	Oil nozzles plugged	Replace nozzles
	oil firing (pressure atomized)	By-pass seal on nozzle leaking	Replace nozzles

No.	System	Cause	Correction
	Cannot obtain rated input on	Oil pressure too low	Increase oil pressure
	oil firing (pres. atom.) (con't)	Flow valve set too low (should be closed at high fire)	Adjust oil control valve
		Oil flow valve set too low (should be closed at high fire)	Adjust oil control valve
16	Cannot obtain rated input on	Oil nozzles plugged	Replace nozzles
	oil firing (air atomized)	Air pressure too low	Replace nozzles
		Oil pressure too low	Increase oil pressure
		Flow valve set too low	Adjust oil control valve
17	Cannot obtain NOx levels on	Inlet tube in wrong position	Adjust inlet tube to center of fan inlet
	gas	" "	Taper FGR valve to be full open
		FGR valve not full open	Adjust FGR valve to full open
		FGR valve full of condensate	Clean duct and add drains
		FGR duct not directed to flue stream	Add angle cut in center of stack
		FGR line too small	Check sizing, use fittings with less drop
		Operating on propane, not natural gas	Resize FGR for propane operation
		Shutoff valve is not full open	Check FGR shutoff valve position

NOTES

Webster Combustion Technology
 619 Industrial Road, Winfield, KS 67156
www.webster-engineering.com

WARRANTY MATTERS AND EXCLUSION OF IMPLIED WARRANTIES

The following warranty applies: All Products manufactured by the Company are warranted to be free from defects in material and workmanship under normal use and service for a period of eighteen months from the date of shipment or twelve months from the date of start-up; whichever should occur first. Products which are purchased by the Company and resold without further processing by the Company are not covered by the Company's warranty. The Company shall pass to the Buyer whatever warranty the Company receives on such products. The Company will repair or replace, at its option, its products which prove to be defective within the warranty period, F.O.B. the factory. The Company's warranty shall be voided by any abuse, misuse, or neglect of the products by use not in accordance with the Company's published instructions. The remedies for any failure of the Company's product to meet warranty specified herein shall be those remedies herein and no others; these remedies being exclusive remedies as a condition of sale irrespective of the theory upon which any claim might be based, including negligence, breach of contract or strict liability.

IN ALL EVENTS, THE COMPANY WILL NOT BE LIABLE FOR AND WILL NOT REIMBURSE ANY LABOR, MATERIAL, OR OTHER REPAIR CHARGES INCURRED BY ANYONE OTHER THAN THE COMPANY ON ANY WARRANTY EQUIPMENT, UNLESS SUCH CHARGES HAVE BEEN SPECIFICALLY AUTHORIZED IN ADVANCE IN WRITING, BY THE COMPANY. THIS PARAGRAPH CONTAINS THE COMPANY'S SOLE WARRANTY. THE COMPANY MAKES NO IMPLIED WARRANTY, AND THERE IS NO IMPLIED WARRANTY OF MERCHANTABILITY OR FITNESS FOR ANY PARTICULAR PURPOSE.

DAMAGE LIMITATION

Under no circumstances shall the Company be liable for any loss of profits, down time, or any incidental, consequential, special, punitive, exemplary, enhanced, or indirect damages of any kind with respect to its products or the transaction by which its products are sold.

IN NO EVENT SHALL THE COMPANY'S AGGREGATE LIABILITY ARISING OUT OF OR RELATED TO THE EQUIPMENT OR THE TRANSACTION BY WHICH THE EQUIPMENT IS SOLD, WHETHER ARISING OUT OF OR RELATED TO BREACH OF CONTRACT, TORT (INCLUDING NEGLIGENCE), OR OTHERWISE, EXCEED THE TOTAL OF THE AMOUNTS PAID TO THE COMPANY WITH RESPECT TO SUCH EQUIPMENT.

EXCUSE

In no event shall the Company be liable for any loss or damage resulting from any delay or failure in shipment or other failure, loss or damage that is the proximate result of any act of government authority, revolution, riot, civil disorder or disturbance, act of enemies, delay or default in transportation, inability to obtain materials or facilities from normal sources of fire, flood, act of God, or any cause not within the reasonable control of the Company, whether of the class of causes enumerated or otherwise. Without limiting the generality of the foregoing, the Company may, without causing a breach or incurring liability, allocate goods which are in short supply irrespective of the reasons therefore among customers in any manner which the Company in its sole discretion deems advisable. If an event occurs that is beyond the control of the Company's performance and causes its cost of production to increase because of the delay, the Company may pass such increase on to the Buyer.



WEBSTER COMBUSTION TECHNOLOGY
619 Industrial Road - Winfield, KS 67156
Phone 620-221-7464 Fax 620-221-9447

sales@webstercombustion.com service@webstercombustion.com
www.webstercombustion.com